

SYSTEM MANUAL

**KNOW
HOW
INSTALLED**






Table of contents

1	About this document	6
1.1	Purpose.....	6
1.2	Related documents	6
1.3	Marketing and sales contact person	6
1.4	Change history	6
2	Safety	7
2.1	Target group.....	7
2.2	Safety notes	7
2.3	Data protection.....	7
2.4	Availability	7
2.5	Qualified persons involved.....	8
3	System overview	9
3.1	Topology overview	9
3.2	Components overview.....	10
3.3	Applications.....	12
3.3.1	Drinking water hygiene.....	12
3.3.2	Facility management	13
4	System components	14
4.1	Geberit Gateway	14
4.1.1	Intended use	14
4.1.2	Safety notes	14
4.1.3	Structure.....	15
4.1.4	Technical data.....	16
4.1.5	Simplified EU declaration of conformity	16
4.1.6	Wired interfaces	16
4.1.7	Wireless interfaces.....	17
4.1.8	LED display	17
4.1.9	System logs.....	19
4.1.10	Installation.....	20
4.2	Geberit bus converter for urinals and washbasin taps.....	23
4.2.1	Technical data.....	23
4.2.2	LED display	23
4.3	Geberit bus converter with integrated power supply unit	24
4.3.1	Technical data.....	24
4.3.2	LED display	24
4.4	Geberit bus cable (GEBUS cable)	25
4.5	Terminal block for Geberit Gateway.....	26
4.6	Geberit Connect end devices.....	27
4.6.1	Connection of the end devices to Geberit Gateway.....	29
4.7	Geberit Control app.....	30
5	Planning	31
5.1	General planning rules.....	31
5.2	Planning rules for connection via GEBUS	32

5.3	Additional planning rules for connection via Bluetooth®.....	35
5.4	Zone division.....	36
5.5	Connection of the end devices to Geberit Gateway.....	38
5.5.1	Connection of Geberit type 185/186 washbasin taps.....	38
5.5.2	Connection of Geberit Piave and Brenta washbasin taps.....	39
5.5.3	Connection of Geberit urinal flush controls with electronic flush actuation, surface mounting, hidden.....	40
5.5.4	Connection of Geberit urinal flush controls with electronic flush actuation, concealed installation, hidden.....	41
5.5.5	Connection of Geberit urinal flush controls with electronic flush actuation, with type 01/10/30/50 cover plate.....	42
5.5.6	Connection of Geberit Preda, Selva and Tamina urinals, with integrated flush control.....	43
5.5.7	Connection of Geberit WC flush controls with electronic flush actuation.....	44
5.5.8	Connection of the Geberit HS50 hygiene flush units.....	46
5.5.9	Connection of the Geberit HS30 and HS50 hygiene flush units in the concealed cistern with Geberit bus converter.....	47
5.5.10	Connection of Geberit HS50 hygiene flush units in the concealed cistern with external power supply unit.....	48
5.5.11	Connection of Geberit temperature and volumetric flow rate sensors for GEBUS.....	49
5.6	Connection to building automation systems.....	50
5.7	Connection to Geberit Cloud.....	52
5.8	Practical example 1: Connection of the end devices via Geberit Bus (GEBUS).....	53
5.8.1	Required components for connectivity.....	54
5.8.2	EDE file for building automation.....	54
5.9	Practical example 2: Connection of the end devices via Bluetooth®, battery operation.....	55
5.9.1	Required components for connectivity.....	56
5.10	Practical example 3: Connection of the end devices via Bluetooth®, retrofitting.....	57
5.10.1	Required components for retrofitting.....	58
5.10.2	General procedure for retrofitting with Geberit Connect.....	58
6	Commissioning.....	60
6.1	Commissioning procedure.....	60
6.2	Checking requirements.....	61
6.3	Connecting Geberit Control app to Geberit Gateway.....	62
6.4	Assigning end devices connected via GEBUS.....	64
6.5	Assigning end devices connected via Bluetooth.....	68
6.6	Configure LAN/WLAN.....	71
6.7	Configuring BACnet/IP.....	72
6.8	Making settings for Geberit Connect end devices.....	73
6.9	Creating and transferring the commissioning report.....	75
6.10	Finalising commissioning.....	76
7	Use.....	77
7.1	Operating and configuring end devices.....	77
7.1.1	Centralised operation.....	77
7.1.2	Local operation.....	79
7.1.3	Functions per zone.....	81
7.2	Managing zones and end devices.....	82
7.2.1	Adding end devices.....	82
7.2.2	Managing zones and removing end devices.....	82

7.3	Replacing end device.....	84
7.4	Displaying and evaluating statistics	86
7.5	Updating firmware	87
7.5.1	Firmware update with USB stick	87
7.5.2	Firmware update with Geberit cloud services	88
7.5.3	LED sequence during firmware update of the Geberit Gateway.....	88
7.6	Troubleshooting	89
7.7	Deactivating the Bluetooth® connection	92
8	Disposal	93
8.1	Constituents	93
8.2	Disposal of waste electrical and electronic equipment	93
9	Appendix.....	94
9.1	List of abbreviations	94
9.2	Geberit Gateway BACnet certificate	95
9.3	BACnet objects	96
9.4	EDE file for practical example 1	106

1 About this document

1.1 Purpose

This system manual describes the connectivity between all Geberit Connect-enabled devices. It contains all the information required for the purposes of planning, installation, commissioning and operation.

1.2 Related documents

This system manual contains comprehensive information on connectivity of Geberit Connect-enabled end devices.

The following product-specific instructions are not included. These are available either as a product supplement or in the online product catalogue.

- Installation instructions for the end devices and system components
- Operating and maintenance instructions for the end devices

The product range can be viewed in the online catalogues of the relevant sales companies.

1.3 Marketing and sales contact person

For competent advice on Geberit Connect, please contact the relevant Geberit sales company.

1.4 Change history

Date	Changed by	Type of change	Versions
01/07/2023	J. Vollenweider	Newly created	This document: 00 Geberit Gateway firmware: 02 Geberit Control app: 1.4
20/11/2023	J. Vollenweider	Geberit Gateway: <ul style="list-style-type: none"> • WLAN support Geberit Control app: <ul style="list-style-type: none"> • Notifications by email • Service request • Extended malfunction diagnosis • Extended log functions • Centralised and local access to end devices • Simplified firmware update via Geberit Cloud 	This document: 01 Geberit Gateway firmware: 03 Geberit Control app: 1.5

2 Safety

2.1 Target group

This system manual is intended for professionals who are entrusted with the connectivity of Geberit Connect end devices. These are, for example:

- Plumbers with experience in the field of building automation or with appropriate training provided by Geberit
- Qualified electricians
- Building computer technicians
- Technical building equipment planners
- Network technicians
- Facility managers
- Systems integrators

A qualified professional is a person who, due to their specialist education, training and/or experience, is qualified to recognise risks and avoid hazards that may arise when planning, installing and using the products.

2.2 Safety notes

When using Geberit Connect devices, the following safety instructions must be observed:

- The laying and connection of cables may only be carried out by trained electricians.
- Disconnect the power supply before connecting the cables.
- Protect the place of installation from moisture.
- Only carry out the installation within the defined protective areas in the bathroom and take the appropriate safety measures.
- Only use original spare parts when making repairs.
- Do not modify the product or add any additional modules.

The safety instructions enclosed with the devices must also be observed.

2.3 Data protection

All information on data protection when using Geberit mobile apps and IoT services is contained in the Conditions of Use and the Privacy Policy of the Geberit Control app. The Conditions of Use must be accepted during installation of the Geberit Control app.

2.4 Availability

Geberit ensures the functionality of the Geberit Connect devices over their entire service life. Functionality is ensured by the availability of spare parts and by firmware updates.

The spare parts availability for Geberit Connect devices is based on the General Terms and Conditions of the respective Geberit sales company. The spare parts availability is usually 10 years from the last year of production.

2.5 Qualified persons involved

Planning, installation and commissioning of a Geberit Connect system may only be carried out by qualified persons. Typically, the following qualified persons are involved:

Task	Qualified person	Additional information
Planning		
Determining the placement of Geberit Connect end devices.	Plumber, electrician, Geberit qualified person	→ See "Planning", page 31.
Determining the placement of the Geberit Gateway.	Building automation specialist, qualified electrician, Geberit qualified person	
Determining cable routing.	Qualified electrician, Geberit qualified person	
Defining functionality in the building automation system.	Building automation specialist, building IT technician, systems integrator	→ See "Connection to building automation systems", page 50. → See "BACnet objects", page 96.
Installation		
Mounting end devices and Geberit bus converters.	Plumber	→ See the installation instructions for the specific end devices and Geberit bus converters.
Mounting Geberit Gateway.	Qualified electrician	→ See the installation manual for the Geberit Gateway.
Pulling in the Geberit bus cable (GEBUS cable).	Qualified electrician	→ See "Geberit bus cable (GEBUS cable)", page 25.
Routing the mains cable (230 V AC) to Geberit Connect end devices and Geberit Gateway.	Qualified electrician	→ See the installation instructions for the specific end devices and Geberit bus converters. → See the installation manual for the Geberit Gateway.
Routing LAN cable to Geberit Gateway.	Qualified electrician	–
Commissioning		
Assigning end devices via the GEBUS or Bluetooth® to the Geberit Gateway.	Geberit qualified person, plumber	→ See "Commissioning", page 60.
Making settings for the end devices.	Geberit qualified person, plumber	
Configure LAN/WLAN and BACnet/IP.	Geberit qualified person, building automation technician, building computer technician, systems integrator	
Operation		
Reading out and processing logs.	Building operator	→ See "Use", page 77.
Maintaining end devices.	Building operator, plumber	

3 System overview

3.1 Topology overview

Geberit Connect end devices such as washbasin taps, urinal flush controls, WC flush controls or hygiene flush units are connected via a Geberit bus cable (GEBUS cable) to a Geberit Gateway. Alternatively, the end devices can also be connected via Bluetooth® Low Energy (BLE)¹⁾. Mixed operation (GEBUS/Bluetooth®) is also possible. A maximum of 30 end devices can be connected to one Geberit Gateway, of which a maximum of 10 end devices can be connected via Bluetooth®. The Geberit Gateway monitors and controls the connected end devices.

A Geberit Connect system consists of a Geberit Gateway and the assigned Geberit Connect end devices.

A Geberit Gateway is integrated into higher-level systems such as building automation systems via LAN. Currently, the BACnet/IP²⁾ network protocol is supported. The Geberit Cloud Services can be used via LAN or WLAN.

The Geberit Control app is available for controlling and monitoring the end devices via the Geberit Gateway. The Geberit Control app communicates with the Geberit Gateway by Bluetooth®.

- 1) The Bluetooth® brand and its logos are the property of Bluetooth SIG, Inc. and are used under licence by Geberit.
- 2) BACnet is a trademark of the American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE). BACnet certificates for Geberit products are available at: <https://www.bacnetinternational.net/bt/search.php>.

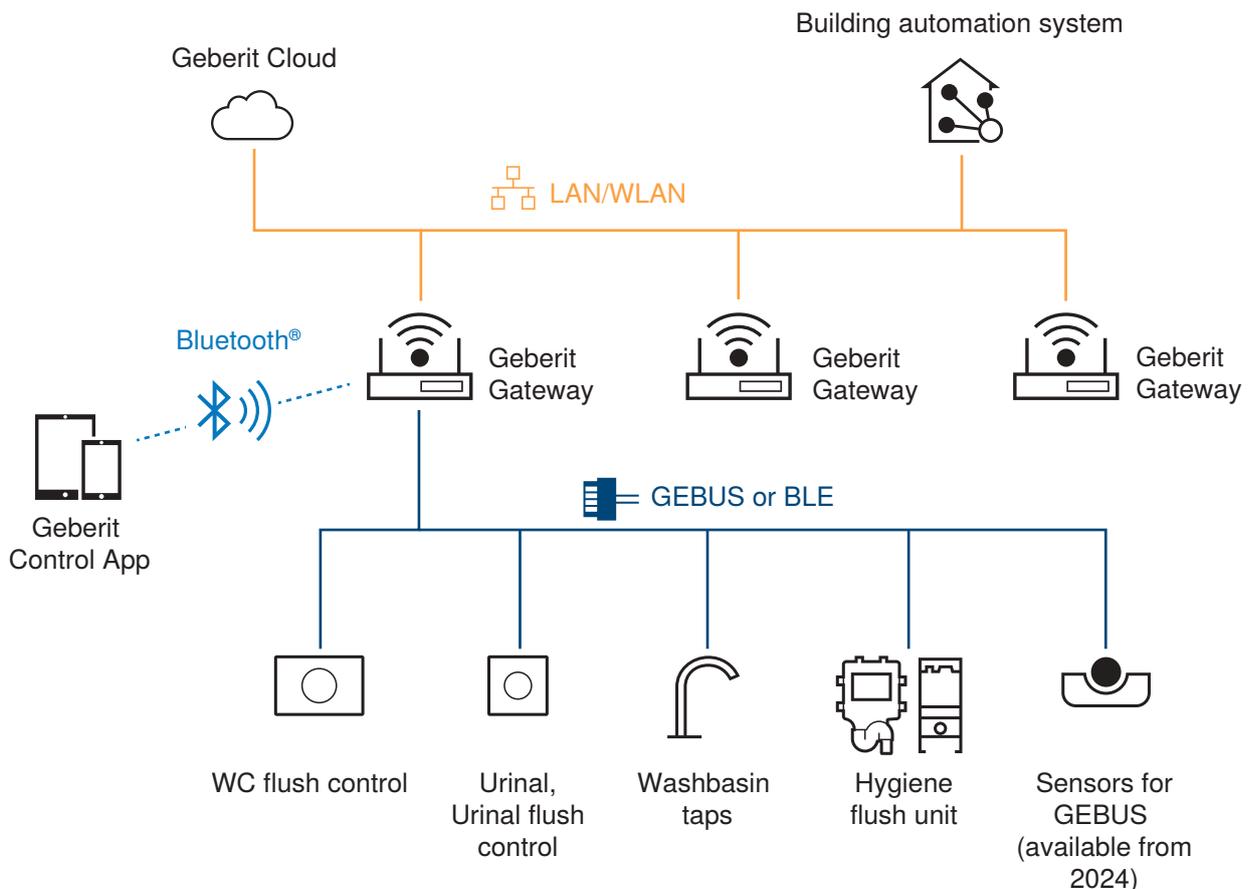








Figure 1: Geberit Connect topology

3.2 Components overview

The following components are available for Geberit Connect:

Category	Component	Description
Network components	 Geberit Gateway	→ See "Geberit Gateway", page 14.
	 Geberit installation box for Gateway	→ See "Geberit Gateway", "Installation", page 20.
	 Geberit bus converter for urinals, concealed urinal flush controls and washbasin taps	→ See "Geberit bus converter", page 23.
	 Geberit bus converter with integrated power supply unit, for WC flush controls and hygiene flush units in concealed cisterns	→ See "Geberit bus converter with power supply unit", page 24.
	 Geberit bus cable (GEBUS cable)	→ See "Geberit bus cable (GEBUS cable)", page 25.
	 Terminal block for Geberit Gateway	→ See "Terminal block for Geberit Gateway", page 26.
	 Geberit set of cables for GEBUS interface, for Geberit HS50 hygiene flush unit	→ See "Connection of the Geberit HS50 hygiene flush units", page 46.
Geberit Connect end devices ¹⁾	 Geberit type 185/186 washbasin taps (networkable from 2024)	→ See "Geberit Connect end devices", page 27.
	 Geberit Piave and Brenta washbasin taps	
	 Geberit urinal flush controls with electronic flush actuation, surface mounting, hidden (networkable from 2024)	
	 Geberit urinal flush controls with electronic flush actuation, concealed installation, hidden (networkable from 2024)	
	 Geberit urinal flush controls with electronic flush actuation, with type 01/10/30/50 cover plate	

Category	Component	Description
Geberit Connect end devices ¹⁾		Geberit Preda, Selva and Tamina urinals with integrated flush control
		<ul style="list-style-type: none"> • Geberit WC flush controls with electronic flush actuation • Geberit HS05 hygiene flush unit
		Geberit HS30 and HS50 hygiene flush units
		Geberit HS30 and HS50 hygiene flush units in concealed cistern
		Sensors for GEBUS (available from 2024): <ul style="list-style-type: none"> • Geberit temperature and volumetric flow rate sensors for GEBUS • Geberit temperature sensors for GEBUS
Software		Geberit Control app
		→ See "Geberit Connect end devices", page 27.
		→ See "Geberit Control app", page 30.

2 / 2

¹⁾ Geberit Connect-enabled end devices are marked with the Geberit Connect logo on the specification plate.



3.3 Applications

The following chapters describe various applications for the connectivity of Geberit Connect end devices.

3.3.1 Drinking water hygiene

Drinking water hygiene is an optimal interaction between the pipe routing, the arrangement of the extraction points and their use.

The drinking water in the supply pipes should be replaced every 3 days according to the recommendations of guideline VDI 6023 and should not exceed a cold-water temperature of 25 °C. This prevents the drinking water from becoming contaminated. With regular use of the extraction points, this is usually guaranteed. Ensuring water replacement with automatically controlled hygiene flush units is recommended if regular use cannot be guaranteed (for example, due to holiday absences or reutilisations).

Connectivity of Geberit HS50 hygiene flush unit and Geberit HS30/HS50 hygiene flush units in the concealed cistern offers the following additional benefits:

- Central definition of local flushing programmes in the hygiene flush units
- Central readout of flushing logs
- Central status display
- Realisation of flushing programmes in the building automation system by integrating the Geberit hygiene flush units via BACnet objects

Geberit recommends the following topology to ensure regular replacement of the drinking water in a drinking water installation:

- Looped piping (cold and hot water)
- Planning of the most frequently used point of use (for example, the toilet) or a hygiene flush unit at the end of the supply pipe
- Use of a Geberit Gateway for central access to sanitary appliances
- Installation of sensors for GEBUS to monitor the water temperature or record the water volume (available from 2024)

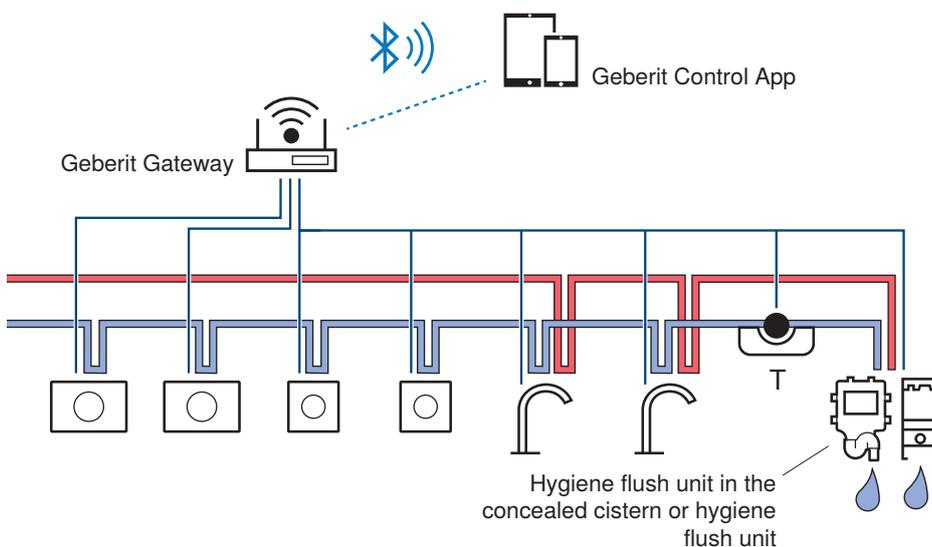


Figure 2: Topology of a supply system with monitoring by Geberit Gateway. Water replacement by the WC with Geberit hygiene flush unit in concealed cistern or Geberit hygiene flush unit.

Further information on drinking water hygiene can be found in the corresponding publications of the Geberit sales companies.

3.3.2 Facility management

Users of public or semi-public sanitary facilities expect cleanliness and proper functioning of the sanitary appliances. The operator wants to implement these requirements as cost-effectively and efficiently as possible.

Geberit Connect provides the necessary data and functions for this, such as:

- Activating cleaning mode for all Geberit Connect end devices in a zone
 - Save time during cleaning
- Record the number of uses
 - Save money with needs-based cleaning intervals in the sanitary room
 - Save money with needs-based maintenance intervals of the specific end devices
- Central malfunction indication
 - Shorter downtimes in the event of malfunctions
- Firmware updates for Geberit Gateway and end devices
 - Ensuring functionality and safety

Data points for integration into a building automation system are available for Geberit Gateway and all end devices. → See "Connection to building automation systems", page 50. The evaluation of data must be programmed on the building automation system side.

The Geberit Control app is suitable for on-site access to Geberit Connect end devices.

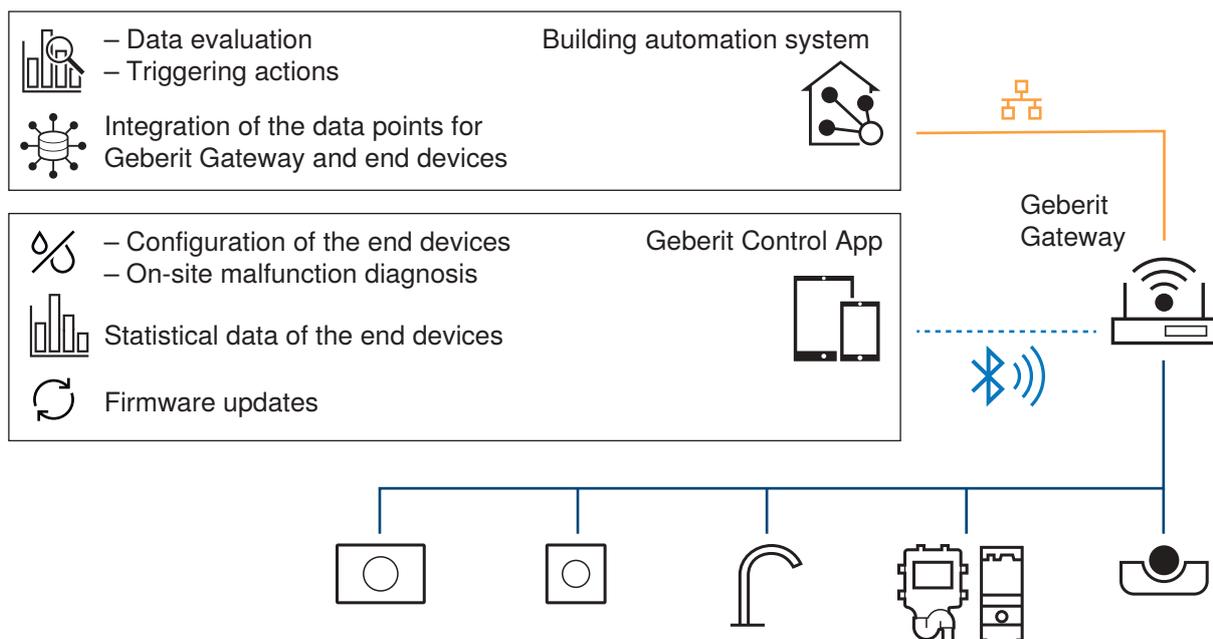


Figure 3: Example of data and functions for facility management

4 System components

4.1 Geberit Gateway



4.1.1 Intended use

The Geberit Gateway is intended for connectivity of Geberit Connect end devices and integrating them into higher-level systems.

4.1.2 Safety notes

When using the Geberit Gateway, the following safety instructions must be observed:



DANGER **Electric shock**

Incorrect installation can lead to death or serious injuries.

- ▶ Only trained electrically skilled persons are permitted to set up the electrical connection.
 - ▶ Disconnect the power supply before connecting the cables.
 - ▶ Only carry out the installation within the defined protective areas and take the appropriate safety measures.
-
- Only install in a concealed housing (installation box) or in an electrical distribution cabinet with a lockable door.
 - The place of installation must be protected from moisture.
 - Do not route the electrical connection via switched elements such as key switches, timers or hotel card switches.
 - Only use the power supply of the Geberit bus cable (24 V) to supply the connected Geberit Connect end devices.
 - Have contact protection dismantled by a qualified electrician only.
 - Only operate the pairing button when contact protection is fitted.
 - Ensure access to the Geberit Gateway for all types of mounting.
 - Route the GEBUS cable in a conduit pipe.
 - Only use original spare parts when making repairs.
 - Do not modify the product or carry out additional installations.

4.1.3 Structure

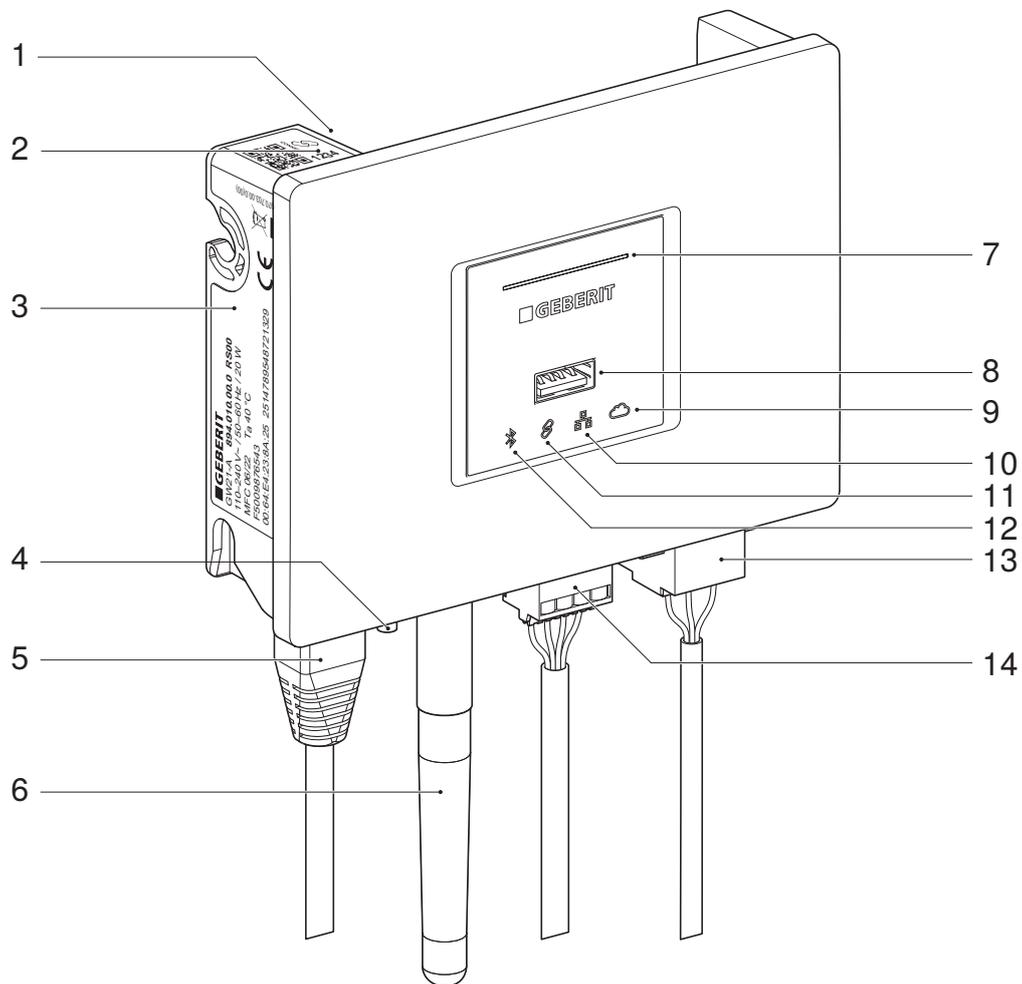


Figure 4: Geberit Gateway

1	USB port, rear	8	USB port, front
2	Pairing secret	9	Cloud LED
3	Specification plate	10	LAN/WLAN LED
4	Pairing button	11	Connect LED
5	LAN connection (Ethernet)	12	Bluetooth® LED
6	Antenna for Bluetooth® and WLAN	13	Mains connection (110–240 V AC)
7	Mains connection LED	14	Connection for Geberit bus (GEBUS)

4.1.4 Technical data

Nominal voltage	110–240 V AC
Mains frequency	50–60 Hz
Power consumption	25 W
Protection class	I
Degree of protection	IPX4 (mounted in concealed housing)
Ambient temperature	0–40 °C
Relative humidity	< 100 %
Power reserve of the real-time clock	Typically 72 h
Width	12 cm
Height	9.2 cm
Depth	4.3 cm

4.1.5 Simplified EU declaration of conformity

Geberit International AG hereby declares that the Geberit Gateway radio equipment type is in compliance with Directive 2014/53/EU.

The full text of the EU declaration of conformity is available at the following internet address: <https://doc.geberit.com/971243000.pdf>

4.1.6 Wired interfaces

The Geberit Gateway has the following wired interfaces:

Interface	Properties	
Geberit bus (GEBUS)	Use	To integrate the Geberit Connect end devices
	Interface type	RS485 with proprietary protocol
	Voltage level	24 V DC
	Output power	Max. 15 W
	Connection	4-pole plug
	Specification	→ See "Geberit bus cable (GEBUS cable)", page 25.
LAN	Use	For connection with Geberit cloud services and building automation system
	Standards	Fast Ethernet, 100BASE-T, Gigabit Ethernet
	Transmission rate	1,000 Mbit/s
	Connection	1x RJ45
USB port, front	Use	For firmware update and diagnosis
	Connection	1x USB 2.0 type A, max. 100 mA
USB port, rear	Use	For future extensions
	Connection	1x USB 2.0 type A, max. 100 mA

4.1.7 Wireless interfaces


The Geberit Gateway has the following wireless interfaces:

Interface	Characteristic	
Bluetooth®	Use	To communicate with the Geberit Control app
	Wireless technology	Bluetooth® Low Energy
	Frequency range	2400–2483.5 MHz
	Maximum output power	10 dBm
WLAN	Use	For wireless connection to Geberit Cloud Services
	Wireless technology	Wi-Fi
	Frequency range	2.4 GHz and 5 GHz (channels for Europe region)
	Maximum output power	20 dBm

4.1.8 LED display



The behaviour of the LEDs is shown in this document as follows:

 	LED dark	 	LED flashes
 	LED lit		LED flashes alternately

The Geberit Gateway has the following LED indicators:

LED	Status	Description
Electrical connection		No mains voltage
		Start-up process or firmware update active
		Geberit Gateway ready for operation
Bluetooth® (connection to Geberit Control app)		Bluetooth® deactivated
		Bluetooth® active, no connection to the Geberit Control app
		Pairing via Bluetooth® active
		Connected to the Geberit Control app
		New firmware version available for Geberit Gateway, start firmware update via Geberit Control app
		Geberit Gateway not configured
		Localisation of the Geberit Gateway, for example via BACnet

LED	Status	Description
Connect (connection of the end devices via GEBUS or Bluetooth®)		End devices assigned via GEBUS or Bluetooth®, no error
		Connectivity of the end devices via GEBUS is started
		Firmware update active for one or more end devices
		One or more end devices have more recent firmware than the Geberit Gateway
		New, unassigned end device detected
		<ul style="list-style-type: none"> • Short circuit or overload on GEBUS • One or more end devices not reachable • Firmware update for end device failed
LAN/WLAN		LAN/WLAN deactivated
		LAN/WLAN connection active, no error
		Configured WLAN connection cannot be established
		Invalid network configuration <ul style="list-style-type: none"> • DHCP configured, but no server reachable • Manually configured, but IP addresses are missing
Cloud (for Geberit Cloud Services)		Cloud connection deactivated
		Connection to the cloud server established, no error
		Connection is established
		Cloud version is not supported
		Error when establishing a connection

2 / 2

4.1.9 System logs

The Geberit Gateway and the assigned end devices provide various logs and files. These can be downloaded via the Geberit Control app.

Protocol	File format	Application	Target group
Flushing and usage logs of the end devices	CSV	<ul style="list-style-type: none"> • Logging of flushes <ul style="list-style-type: none"> – For example, on the obligation to prove that drinking water hygiene is ensured • Usage analysis <ul style="list-style-type: none"> – For example, to determine the cleaning intervals for the sanitary room 	<ul style="list-style-type: none"> • Facility management • Technical building systems
Commissioning reports from Geberit Gateway and end devices	PDF	<ul style="list-style-type: none"> • Logging of commissioning and configuration of the system <ul style="list-style-type: none"> – For handover to the building operator 	<ul style="list-style-type: none"> • Building operator • Electrician • Plumber • Systems integrator
Event logs from Geberit Gateway and end devices	CSV	<ul style="list-style-type: none"> • Logging of events such as errors, restarts or configuration changes <ul style="list-style-type: none"> – To trace the behaviour of the system 	<ul style="list-style-type: none"> • Building operator • Systems integrator • Service technicians
BACnet documentation	CSV	<ul style="list-style-type: none"> • EDE file for Geberit Gateway and all assigned Geberit Connect end devices <ul style="list-style-type: none"> – For integration into a building automation system via BACnet/IP 	<ul style="list-style-type: none"> • Building computer technician • Building automation technician • Systems integrator

4.1.10 Installation

The Geberit Gateway can be mounted in a concealed installation box or in a control cabinet. For surface mounting, a control cabinet must be used to ensure contact protection.

Access to the Geberit Gateway must be ensured for all types of mounting.

Concealed installation in an installation box

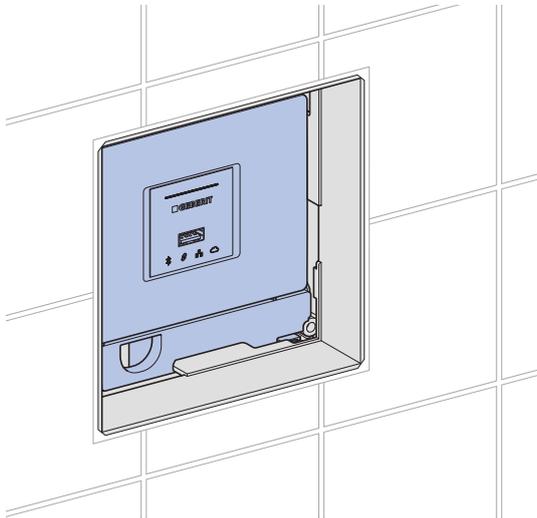


Figure 5: Mounting in installation box

The installation box is intended for concealed installation in solid or drywall construction. The installation box can be mounted on Geberit Duofix or Geberit GIS mounting plates or on a Geberit Duofix element for washbasins.

The following cover plates are available to cover the service opening of the installation box:

- Geberit cover plate for concealed function box, art. no. 116.425.11.1
- Geberit flush-mounted cover plate for concealed function box, art. no. 116.421.00.1

Installation rules:

- When mounting in the installation box, the protection cover must always be mounted so that contact protection is fixed below the Geberit Gateway.
- The installation box is not suitable for surface mounting.

→ See [971.375.00.0](#) (installation box) and [971.356.00.0](#) (Geberit Gateway) installation manuals.

Mounting in the control cabinet

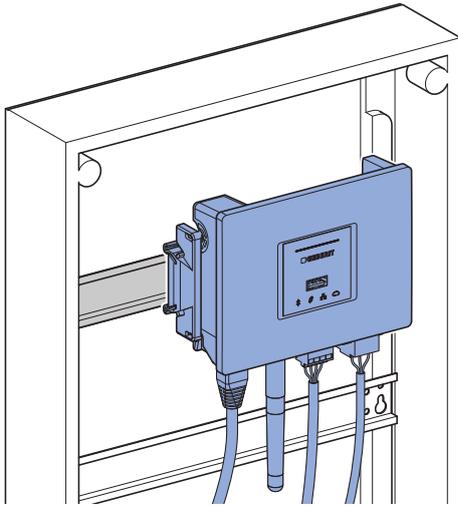


Figure 6: Mounting in the control cabinet

The Geberit Gateway can be mounted in standard control cabinets on 35 mm DIN top-hat rails. Plastic control cabinets are preferable so that communication via Bluetooth® and WLAN is not impaired.

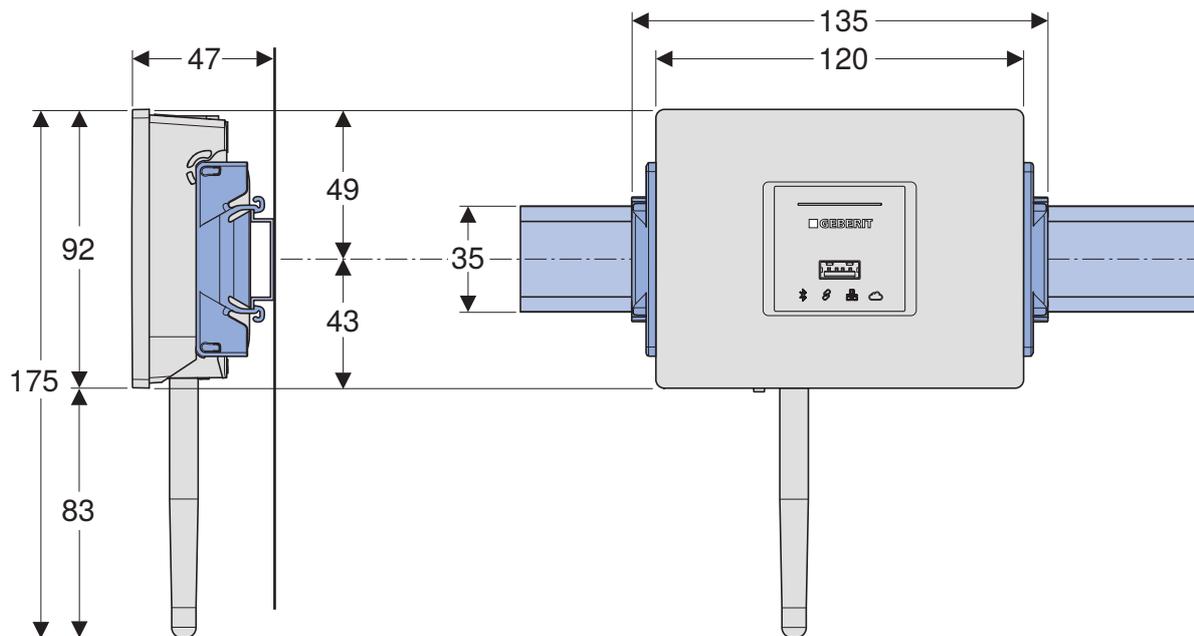


Figure 7: Dimensions for mounting on DIN top-hat rails

→ See [971.356.00.0](#) (Geberit Gateway) installation manual.



DANGER Electric shock

- ▶ Provide a cover in the control cabinet to protect against contact with the 230 V AC plug.

A sufficiently large opening for the LEDs must be provided in the cover of the control cabinet. If the entire Geberit Gateway is to be visible, an opening with a width of 8 pitch units must be provided.

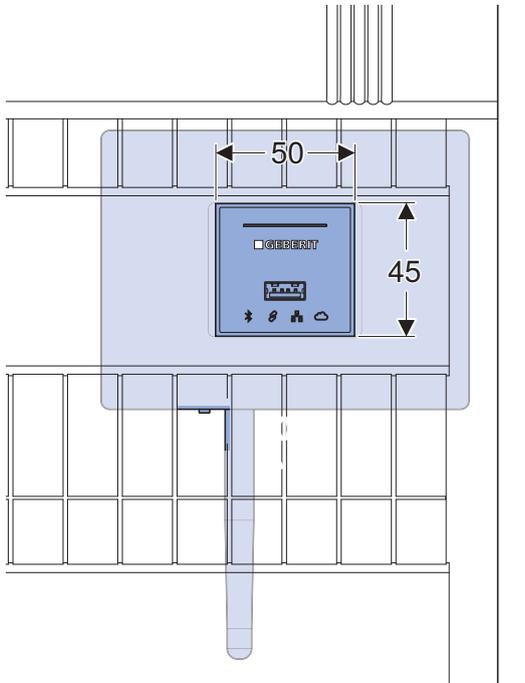


Figure 8: Minimum size of the openings in the control cabinet cover

The terminal block, art. no. 116.492.00.1, is available for connecting the GEBUS cable of the Geberit end devices to the Geberit Gateway. The terminal block can be plugged onto the top-hat rail.

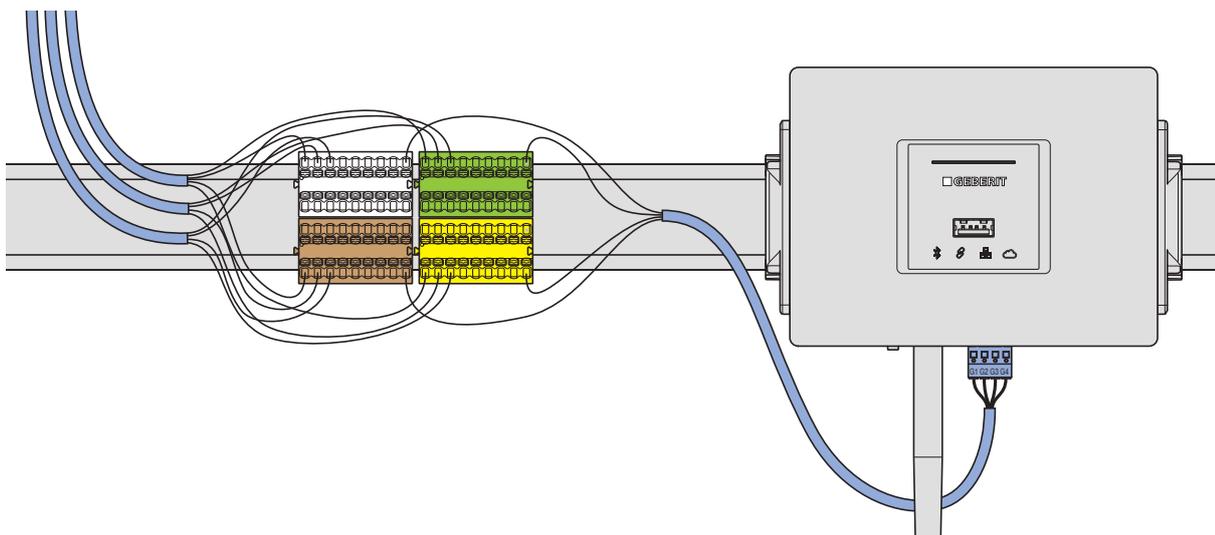


Figure 9: Terminal block for connecting the GEBUS cable

ATTENTION

Malfunctions due to live lines

- ▶ Do not run 230 V AC cables in parallel under the Geberit Gateway in the control cabinet.

4.2 Geberit bus converter for urinals and washbasin taps



Geberit bus converters (GEBUS converters) are used to connect the following Geberit Connect end devices to the Geberit bus (GEBUS):

- Geberit Piave and Brenta washbasin taps (Geberit bus converter, art. no. 116.371.00.1)
- Geberit urinal flush controls with electronic flush actuation, with type 01/10/30/50 cover plate (Geberit bus converter, art. no. 116.371.00.1)
- Geberit urinal flush control with electronic flush actuation, concealed (Geberit bus converter, art. no. 116.371.00.1)
- Geberit Preda, Selva and Tamina urinals, with integrated flush control (Geberit bus converter, art. no. 116.370.00.1)

Geberit bus converters are available as accessories and are mounted in the function box of the Geberit Connect end device instead of the power supply unit. → See [970.195.00.0](#) and [970.196.00.0](#) installation manuals. The power supply of the Geberit bus converter and the end device is provided via the GEBUS cable.

ATTENTION

Malfunctions in end devices with Geberit bus converters

For end devices with Geberit bus converters, the control unit and the Geberit bus converter are linked together. Replacing Geberit bus converters between end devices leads to malfunctions.

- ▶ Do not replace Geberit bus converters between end devices.

4.2.1 Technical data

Operating voltage	24 V DC, via GEBUS
Output voltage	4.5 V DC
Protection class	III
Degree of protection	IPX4
Ambient temperature	5–40 °C

4.2.2 LED display

Status	Description
	No power supply via GEBUS
	Normal operation, no error
	Addressing via GEBUS pending ▶ If the LED does not change to green approx. 60 seconds after power-on, check the GEBUS cable.
	<ul style="list-style-type: none"> • Voltage at GEBUS too low, end device is not powered • GEBUS cable incorrectly connected
	Localisation of the end device, for example via BACnet

4.3 Geberit bus converter with integrated power supply unit



The Geberit bus converter (GEBUS converter) art. no. 116.097.00.1, is used to connect the following Geberit Connect end devices to the Geberit bus (GEBUS):

- Geberit WC flush controls with electronic flush actuation
- Geberit HS05 hygiene flush unit
- Geberit HS30 and HS50 hygiene flush units in concealed cistern

Geberit bus converter is available as an accessory and is mounted in the installation element. → See [971.628.00.0](#) installation manual. Geberit bus converter contains an integrated power supply unit for supplying power to the Geberit Connect end device in the installation element.



Geberit bus converter must be connected to the red plug on the Geberit Connect end device. Geberit bus converter is not compatible with older end devices without a red plug.

ATTENTION

Malfunctions in end devices with Geberit bus converters

For end devices with Geberit bus converters, the control unit and the Geberit bus converter are linked together. Replacing Geberit bus converters between end devices leads to malfunctions.

- ▶ Do not replace Geberit bus converters between end devices.

4.3.1 Technical data

Nominal voltage	90–260 V AC
Mains frequency	50–60 Hz
Output voltage	12 V DC
Output power	12 W
Degree of protection	IPX4
Ambient temperature	5–40 °C

4.3.2 LED display

Status	Description
	No mains voltage
	Normal operation, no error
	Addressing via GEBUS pending ▶ If the LED does not change to green approx. 60 seconds after power-on, check the GEBUS cable.
	<ul style="list-style-type: none"> • Voltage at GEBUS too low, end device is not powered • GEBUS cable incorrectly connected
	Localisation of the end device, for example via BACnet

4.4 Geberit bus cable (GEBUS cable)



The GEBUS cable can be obtained from Geberit or procured on site.


The GEBUS cable is available from Geberit under art. no. 116.493.00.1 (length 100 metres) and 116.493.00.5 (length 500 metres).

The following specifications must be observed for on-site procurement:

Cores	
Number	4
Design	Stranded wire, twisted in pairs, without shielding
Cross-section	≥ 22 AWG (0.35 mm ²)
Conductor resistance per core	≤ 58 Ω/km
Colours	Pair 1 (G1/G2): white/brown Pair 2 (G3/G4): green/yellow
Core material	Copper
Material insulation	PE
Jacketing	
Design	LSZH, flame retardant, halogen-free

In addition, the country-specific regulations and the requirements of the installation situation must be observed.

GEBUS plug assignment

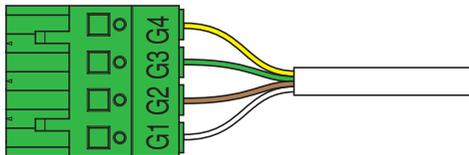

G1	VBUS (24 V DC)	white	
G2	GND	brown	
G3	RS485 A (D-)	green	
G4	RS485 B (D+)	yellow	



It is recommended to use a cable with these wire colours (GEBUS cable or on-site cable with identical wire colours). The wire colours are matched to the colours of the terminal block in the Geberit installation box and thus simplify troubleshooting.

Cabling

To ensure that the GEBUS cable is sufficiently protected, it must be laid in a conduit pipe.

4.5 Terminal block for Geberit Gateway



The terminal block serves as a node for connecting the GEBUS cables of the individual Geberit Connect end devices to the Geberit Gateway.

The terminal block is included in the Geberit installation box, art. no. 116.491.00.1. For mounting in the control cabinet, the terminal block is also available as an accessory with art. no. 116.492.00.1.

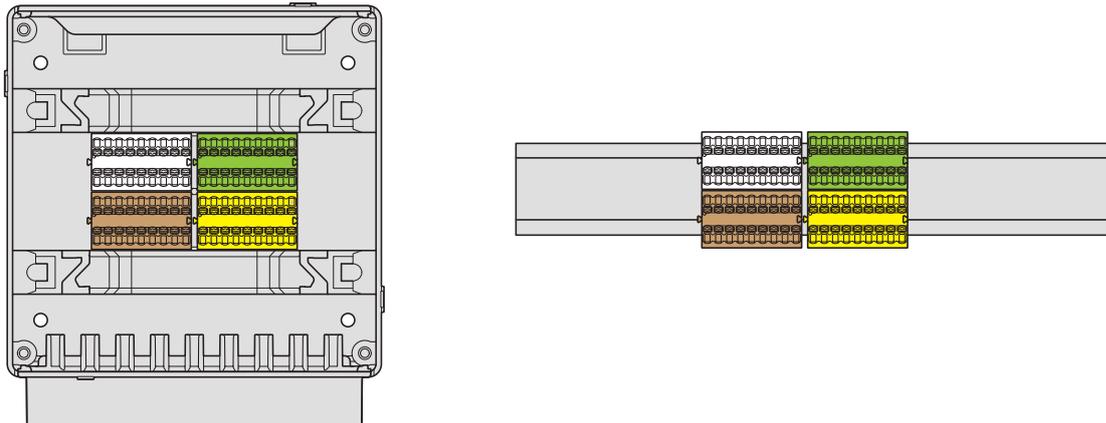


Figure 10: Terminal block in the installation box (left) and mounted on a top-hat rail for control cabinet installation (right)

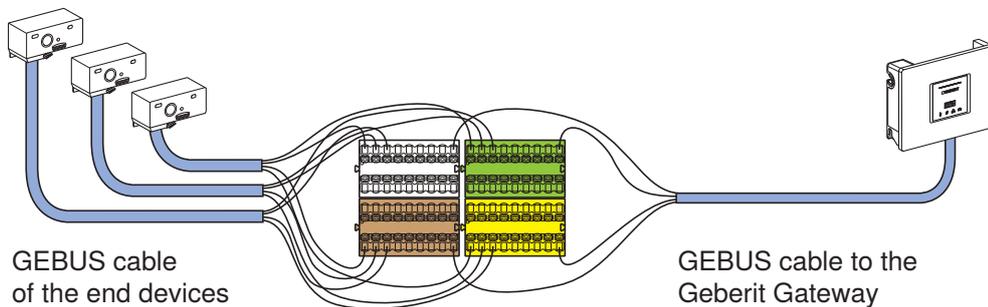



Figure 11: Example for the connection of 3 Geberit Connect end devices with the Geberit Gateway

4.6 Geberit Connect end devices

The following Geberit Connect end devices can be used with Geberit Connect. The connection to the Geberit bus is made directly or via a Geberit bus converter.

End device ¹⁾		Compatible with Geberit Control app, Connection to Geberit Gateway via Bluetooth®	Connection to Geberit Gateway via GEBUS	Power supply
	Geberit type 185/186 washbasin taps (networkable from 2024)	✓	Not possible	Mains, battery or generator
	Geberit urinal flush controls with electronic flush actuation, surface mounting, hidden (networkable from 2024)	✓	Not possible	Mains or battery
	Geberit urinal flush controls with electronic flush actuation, concealed installation, hidden (networkable from 2024)	✓		24 V DC from GEBUS to Geberit bus converter
	Geberit urinal flush controls with electronic flush actuation, with type 01/10/30/50 cover plate	✓	With Geberit bus converter for concealed urinal flush controls and washbasin taps, art. no. 116.371.00.1	24 V DC from GEBUS to Geberit bus converter Battery (connection via Bluetooth® only)
	Geberit Piave and Brenta washbasin taps	✓		
	Geberit Preda, Selva and Tamina urinals with integrated flush control	✓	 With Geberit bus converter for Preda, Selva and Tamina urinals, art. no. 116.370.00.1	24 V DC from GEBUS to Geberit bus converter Battery (connection via Bluetooth® only)

End device ¹⁾		Compatible with Geberit Control app, Connection to Geberit Gateway via Bluetooth®	Connection to Geberit Gateway via GEBUS	Power supply
	Geberit WC flush controls with electronic flush actuation, Geberit HS05 hygiene flush unit	✓	 With Geberit bus converter with integrated power supply unit, art. no. 116.097.00.1	230 V AC to power supply unit in the Geberit bus converter Battery (connection via Bluetooth® only)
	Geberit HS30 hygiene flush unit	✓	Not possible	230 V AC to power supply unit
	Geberit HS50 hygiene flush unit	✓	Direct, with cable for GEBUS interface, art. no. 616.238.00.1	
	Geberit HS50 hygiene flush unit in concealed cistern	✓	Direct, with cable for GEBUS interface, art. no. 616.238.00.1	230 V AC to power supply unit
	Geberit HS30 and HS50 hygiene flush units in concealed cistern	✓	 With Geberit bus converter with integrated power supply unit, art. no. 116.097.00.1	230 V AC to power supply unit in the Geberit bus converter
	Sensors for GEBUS (available from 2024): <ul style="list-style-type: none"> • Geberit temperature and volumetric flow rate sensor for GEBUS • Geberit temperature sensors for GEBUS 	Not possible ²⁾	Direct, with GEBUS cable on the sensor (length 1 m)	24 V DC from GEBUS

2 / 2

1) Geberit Connect-enabled end devices are marked with the Geberit Connect logo on the specification plate.



2) Access with Geberit Control app possible via GEBUS and Geberit Gateway

4.6.1 Connection of the end devices to Geberit Gateway

Depending on the end device, the connection to the Geberit Gateway is established via GEBUS (directly or via Geberit bus converter) and/or via Bluetooth®. Power is supplied either via GEBUS (24 V DC), via a separate power supply unit or via a battery.

For details → see "Connection of the end devices to Geberit Gateway", page 38.

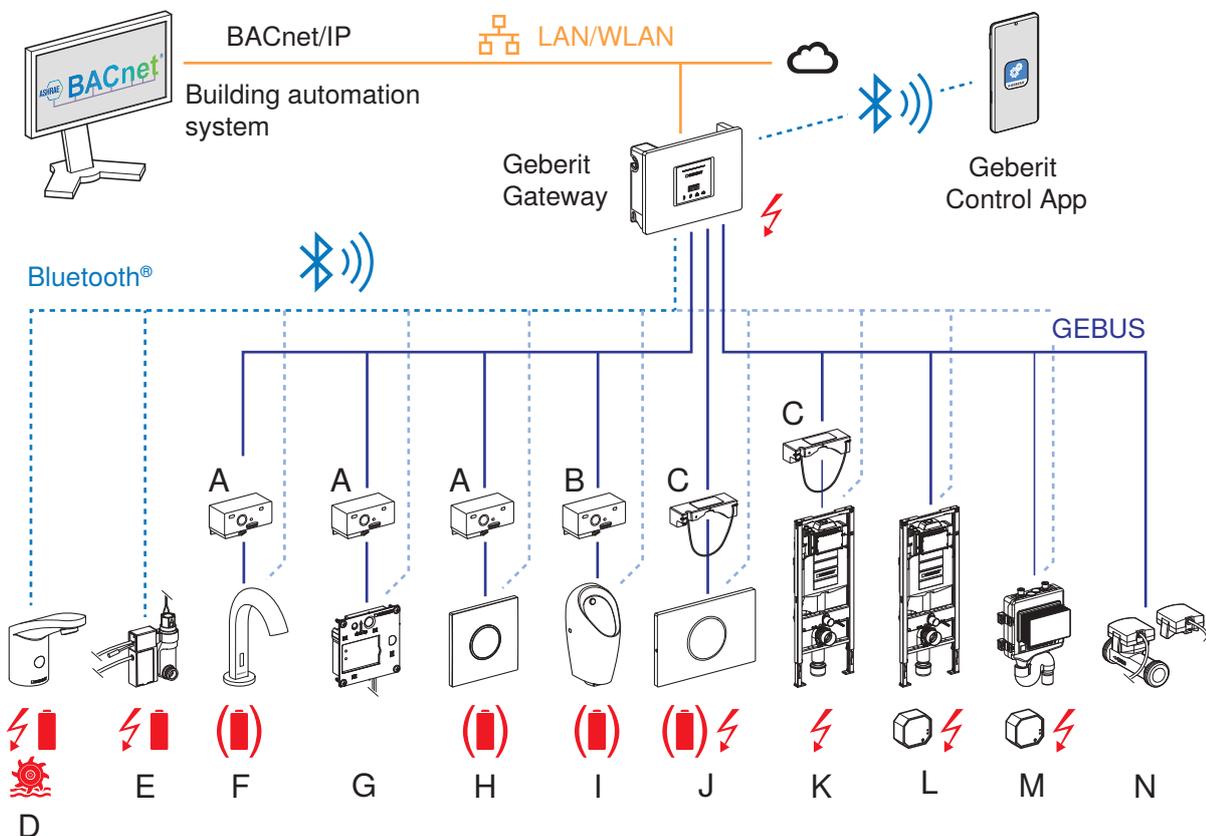


Figure 12: Connection of the Geberit Connect end devices to Geberit Gateway

- A Geberit bus converter for concealed urinal flush controls and washbasin taps
 - B Geberit bus converter for Preda, Selva and Tamina urinals
 - C Geberit bus converter with integrated power supply unit
 - D Geberit type 185/186 washbasin taps
 - E Geberit urinal flush controls with electronic flush actuation, surface mounting, hidden
 - F Geberit Piave and Brenta washbasin taps
 - G Geberit urinal flush controls with electronic flush actuation, concealed installation, hidden
 - H Geberit urinal flush controls with electronic flush actuation, with type 01/10/30/50 cover plate
 - I Geberit Preda, Selva and Tamina urinals with integrated flush control
 - J Geberit WC flush controls with electronic flush actuation
 - K Geberit HS30 or HS50 hygiene flush unit in concealed cistern with Geberit bus converter with integrated power supply unit
 - L Geberit HS50 hygiene flush unit in concealed cistern with external power supply unit
 - M Geberit HS30 or HS50 hygiene flush unit with external power supply unit (HS30 via BLE only)
 - N Geberit temperature and volumetric flow rate sensor for GEBUS/Geberit temperature sensor for GEBUS
- ⚡ 🔋 ☀️ Power supply with mains voltage 230 V AC, battery or generator (not via GEBUS)
- (🔋) Power supply alternatively with battery (connection to Geberit Gateway only possible via Bluetooth®)

4.7 Geberit Control app



The Geberit Control app is used to configure and operate devices in the Geberit Connect system. The connection to the units is established via Bluetooth®. The Geberit Control app is available free of charge for Android and iOS devices in the respective app stores.

iOS



[App Store](#)

Android



[Google Play](#)

Access to the app

The Geberit Control app can be downloaded directly from the respective app store. The QR code on each Geberit Connect device also leads to the Geberit Control app.



Figure 13: Example: Specification plate and sticker on Geberit Gateway, URL in the QR code = <https://gbrt.io/dsvF500>

The QR code leads to a landing page with the following content:

- Links to the app stores for downloading the Geberit Control app
- Link to the respective product page in the online product catalogue with product data and instructions

Range of functions

- Geberit Connect end devices: operation and configuration
- Geberit Gateway:
 - Configuration of the Geberit Connect system
 - Central access to all connected end devices
 - Configuration of the Geberit Gateway
 - Configuration of the network settings
 - Configuration of the connection to a building automation system
 - Provision of various logs
 - Display of malfunctions and warnings

Geberit ID

A personal Geberit ID is required to access the Geberit Gateway. This can be created directly in the Geberit Control app.


If the notification function is activated in the Geberit Control app, faults and warnings are reported by email to the email address stored in the Geberit ID.

For security reasons, the Geberit ID must be confirmed monthly in the Geberit Control app.


5.2 Planning rules for connection via GEBUS

Topology

- Star topology

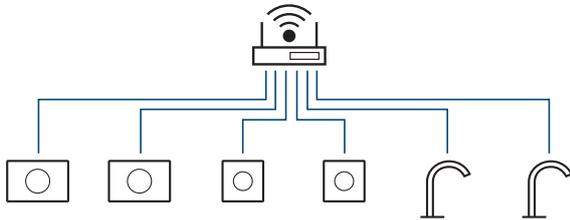

- Advantages: high failure safety, simple cabling, simple malfunction diagnosis
 - Disadvantages: larger quantities of cable, more connection terminals required in installation box
- Row or tree topology

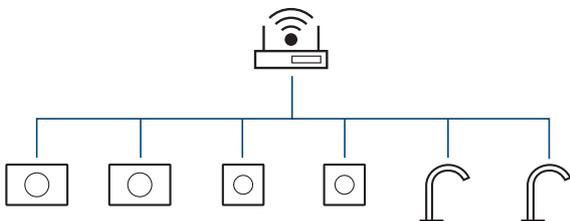

- Advantages: smaller cable quantities, easy expandability, fewer connection terminals required in installation box
- Disadvantages: lower reliability in terms of failure safety



Recommendation: Connect WC flush controls with star topology.


With the Geberit Duofix elements for WC, there is not enough space in the Power & Connect box for looping through the GEBUS cable and the mains cable.

However, a connection with series or tree topology is possible if only the GEBUS cable is looped through. The mains cable must then be looped through in an outlet mounting box behind the Geberit Duofix element.



Recommendation: Use mixed topology for urinals, urinal flush controls and washbasin taps.

Loop through the GEBUS cable in the room with the same end device types and route it in a star configuration to the Geberit Gateway.

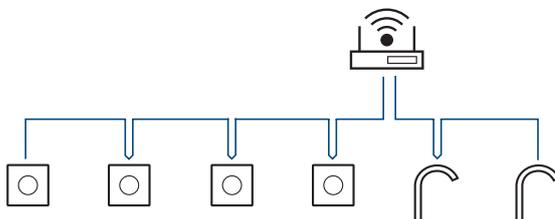

Accessories required

- Determine required accessories, such as Geberit bus converter. → See "Connection of the end devices to Geberit Gateway", page 38.

Failure safety

- Fewer end devices per Geberit Gateway increases failure safety.
- Star topologies increase failure safety.

GEBUS cables

- Observe specifications for GEBUS cables. → See "Geberit bus cable (GEBUS cable)", page 25.
- Maximum cable length between Geberit Gateway and the most distant end device (route A-B in figure on previous page): 100 metres
- Do **not** connect several Geberit Gateways to each other via GEBUS. Only one Geberit Gateway is permitted per Geberit Connect system.
- Rules for routing the GEBUS cable:
 - Do not route parallel to 230 V AC supply lines.
 - Always route in a conduit pipe.
 - Do not route in the same conduit pipe as 230 V AC supply lines.
 - Do not run 230 V AC supply lines above or below Geberit Gateway in the control cabinet.
 - Insulate open strand ends during the construction phase so that they do not touch each other.
 - Label the GEBUS cable once laid.
 - Only electrically skilled persons are allowed to route the GEBUS cable.
 - Comply with country-specific regulations for electrical installations.



To avoid incorrect wiring of the GEBUS cable, we recommend carrying out the following test immediately after connecting the GEBUS cable:


-
- 1** Switch on the power supply at the Geberit Gateway.

 - 2** Switch on the power supply to end devices that are not powered via GEBUS.


 - 3** Check the LEDs:
 - ✓ Geberit Gateway: LEDs indicate the current status.
 - ✓ End devices with LED (e.g. on the Geberit bus converter): LED lights up green.

Geberit Gateway

- Maximum 30 end devices per Geberit Gateway when connected via GEBUS
- 18 connection terminals in installation box for Geberit Gateway, including 1 for the connection to the Geberit Gateway
- Recommendations for placement of the Geberit Gateway:
 - Single family houses: 1 Geberit Gateway in the technical room
 - Building with fewer end devices: 1 Geberit Gateway per riser zone

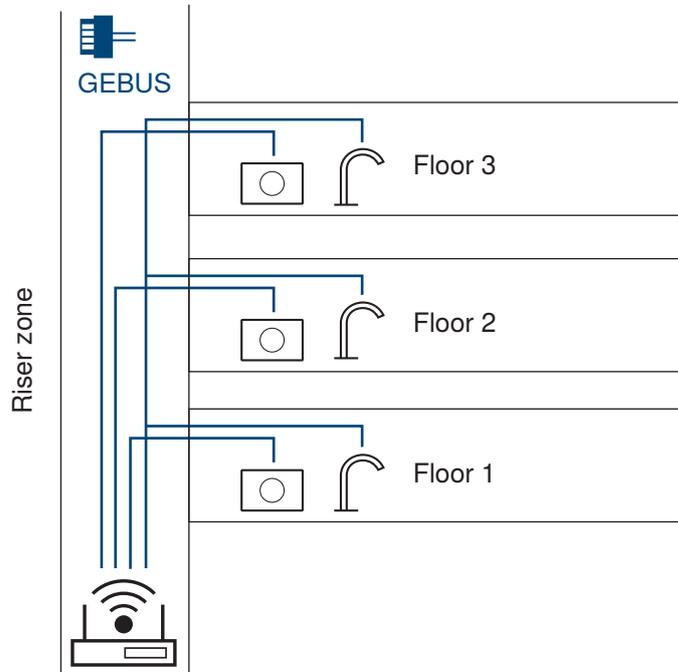


- Public sanitary facilities: 1 Geberit Gateway per sanitary facility with men’s and women’s WC and possibly other rooms

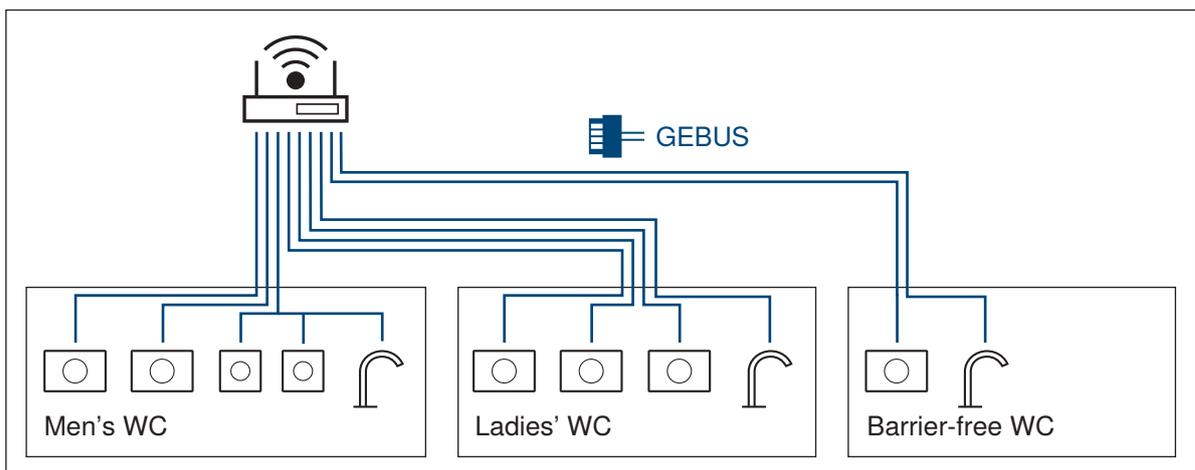

5.3 Additional planning rules for connection via Bluetooth®

- Note the range of the Bluetooth® signal: approx. 10-30 metres depending on the surroundings and building structures such as walls and ceilings
- Maximum 10 end devices per Geberit Gateway when connected via Bluetooth®
- Install the Geberit Gateway in a plastic control cabinet so that communication via Bluetooth® is not affected.
- Check the range of the Bluetooth® signal before final installation of the Geberit Gateway.
- Recommendations for placement of the Geberit Gateway:
 - Place the Geberit Gateway in the same room as the end devices
 - 1 Geberit Gateway per room

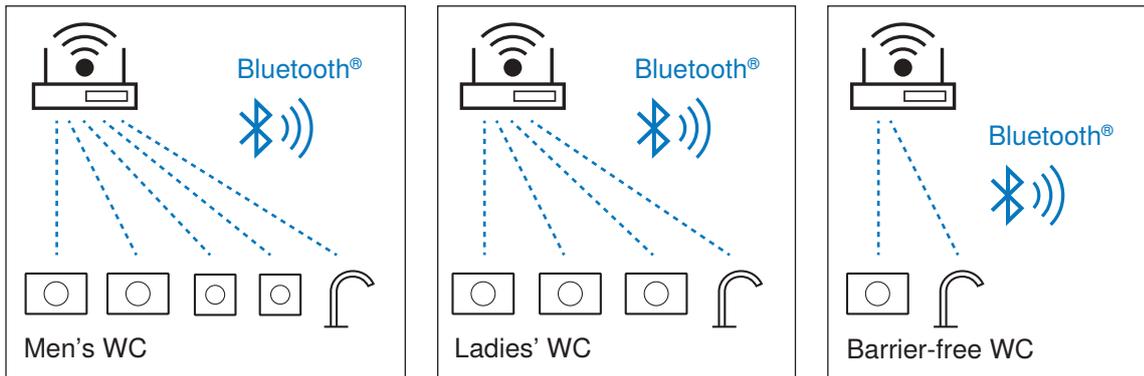

5.4 Zone division

During commissioning, each Geberit Connect end device is assigned to a zone. It is recommended that zone division be determined at the planning stage. The zone division is independent of the topology and the type of connection (GEBUS, Bluetooth®).

Application of the zones:

- Unique identification of an end device in the Geberit Control app and in the building automation system (for example for localising error messages)
- Triggering of central functions for all end devices in the same zone (for example, to activate cleaning mode)
- Display of statistical data of all end devices in the same zone (for example, water consumption per room), available from 2024 onwards

Recommendations for zone division:

- One zone per sanitary room
- One zone per flat in an apartment building
- One zone for the Geberit Gateway, if this is housed in its own room (for example in the basement or in a riser zone)

Example: Zone division in a WC suite

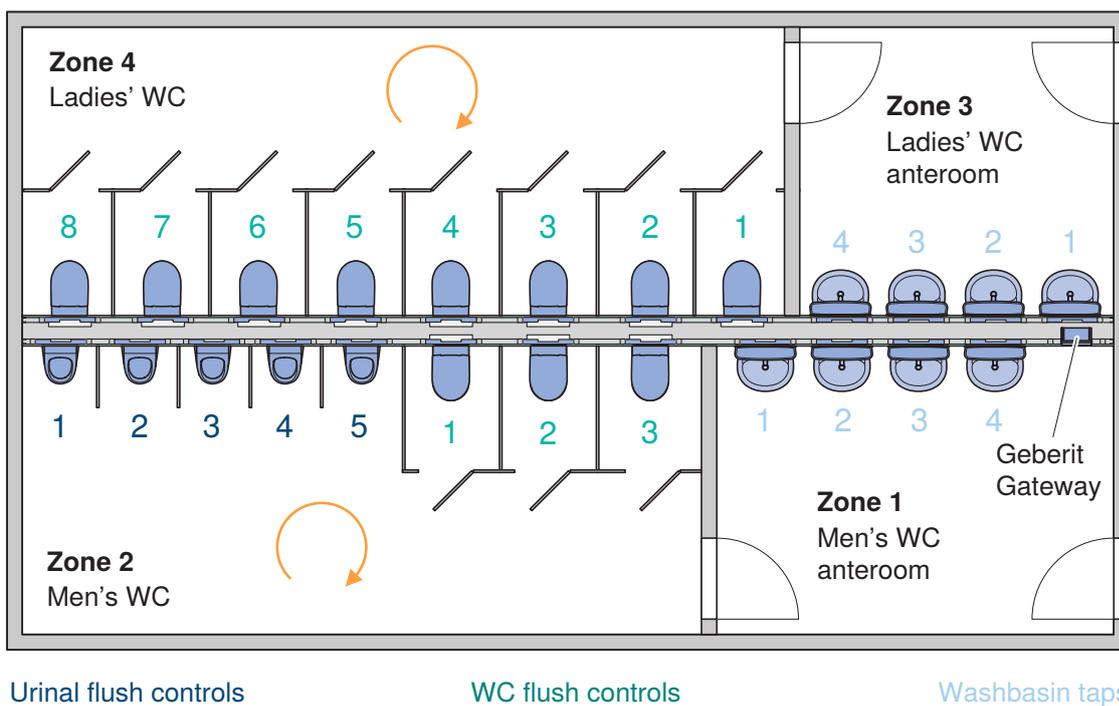


Figure 15: Recommended zone division

General recommendations:

- Set zone with Geberit Gateway as zone 1.
- Number end devices clockwise per zone, separate numbering per end device type.
- Assign meaningful names for Geberit Gateway and zones (for example "Gateway for first floor, men's WC").

Example: Visualisation of zone 2 in the example above in the Geberit Control app

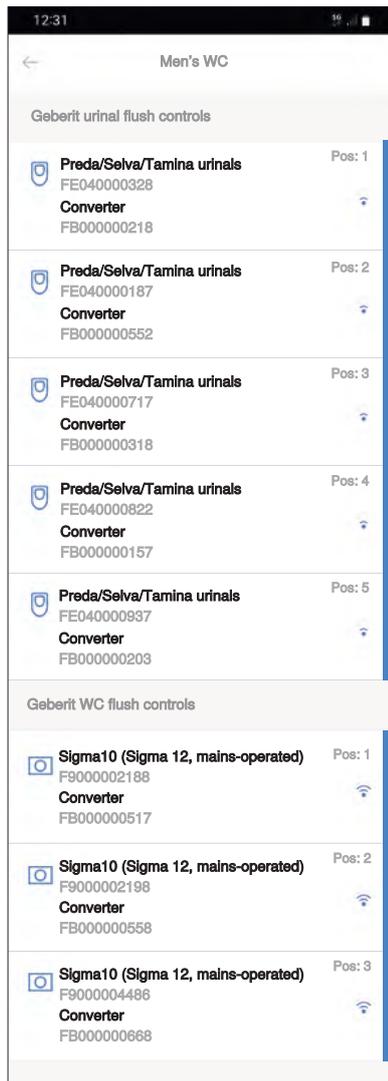


Figure 16: Visualisation of a zone in the Geberit Control app

5.5 Connection of the end devices to Geberit Gateway

5.5.1 Connection of Geberit type 185/186 washbasin taps



Connection to Geberit Gateway	GEBUS	Not possible
	Bluetooth®	From 2024
Power supply	Mains, battery or generator	
Compatible with Geberit Control app	Yes	
Accessories required	No accessories required	
Installation manual	→ See the online catalogue of the Geberit sales company: Washbasin tap: https://gbrt.io/dscFD00	
Connection principle		

5.5.2 Connection of Geberit Piave and Brenta washbasin taps



Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable via Geberit bus converter • Connection of the GEBUS cable via plug with terminals
	Bluetooth®	Yes
Power supply	24 V DC via GEBUS cable	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • Geberit bus converter for concealed urinal flush controls and washbasin taps, art. no. 116.371.00.1 <ul style="list-style-type: none"> – Geberit bus converter is used instead of the mains power supply unit or the battery compartment. – Plug for GEBUS cable included in the scope of delivery • GEBUS cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) 	
Installation manuals	→ See the online catalogue of the Geberit sales company: Washbasin taps: https://gbrt.io/dscFD0E Geberit bus converter: https://gbrt.io/dscFB00	
Connection principle		
Position of the supply lines		

Optionally, washbasin taps with battery or generator operation can also be used. The connection to the Geberit Gateway is then only possible via Bluetooth®.

5.5.3 Connection of Geberit urinal flush controls with electronic flush actuation, surface mounting, hidden



Connection to Geberit Gateway	GEBUS	Not possible
	Bluetooth®	From 2024
Power supply	Mains or battery	
Compatible with Geberit Control app	Yes	
Accessories required	No accessories required	
Installation manual	→ See the online catalogue of the Geberit sales company: Urinal flush control, battery: https://gbrt.io/dscFE02 Urinal flush control, mains: https://gbrt.io/dscFE03	
Connection principle		

5.5.4 Connection of Geberit urinal flush controls with electronic flush actuation, concealed installation, hidden



Connection to Geberit Gateway	GEBUS	<p>From 2024</p> <ul style="list-style-type: none"> • With Geberit bus cable via Geberit bus converter • Connection of the GEBUS cable via plug with terminals
	Bluetooth®	From 2024
Power supply	24 V DC via GEBUS cable	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • Geberit bus converter for concealed urinal flush controls and washbasin taps, art. no. 116.371.00.1 <ul style="list-style-type: none"> – Geberit bus converter is used instead of the mains power supply unit or the battery compartment. – Plug for GEBUS cable included in the scope of delivery • GEBUS cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) 	
Installation manual	<p>→ See the online catalogue of the Geberit sales company: Urinal flush control: https://gbrt.io/dscFE07 Geberit bus converter: https://gbrt.io/dscFB00</p>	
Connection principle		
Position of the supply lines		

5.5.5 Connection of Geberit urinal flush controls with electronic flush actuation, with type 01/10/30/50 cover plate



Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable via Geberit bus converter • Connection of the GEBUS cable via plug with terminals
	Bluetooth®	Yes
Power supply	24 V DC via GEBUS cable	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • Geberit bus converter for concealed urinal flush controls and washbasin taps, art. no. 116.371.00.1 <ul style="list-style-type: none"> – Geberit bus converter is used instead of the mains power supply unit or the battery compartment. – Plug for GEBUS cable included in the scope of delivery • GEBUS cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) 	
Installation manual	→ See the online catalogue of the Geberit sales company: Urinal flush control: https://gbrt.io/dscFE00 Geberit bus converter: https://gbrt.io/dscFB00	
Connection principle		
Position of the supply lines		

Optionally, urinal flush controls with battery operation can also be used, The connection to the Geberit Gateway is then only possible via Bluetooth®.


5.5.6 Connection of Geberit Preda, Selva and Tamina urinals, with integrated flush control




Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable via Geberit bus converter • Connection of the GEBUS cable via plug with terminals
	Bluetooth®	Yes
Power supply	24 V DC via GEBUS cable	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • Geberit bus converter for Preda, Selva and Tamina urinals, art. no. 116.370.00.1 <ul style="list-style-type: none"> – Geberit bus converter is used instead of the mains power supply unit or the battery compartment – Plug for GEBUS cable included in the scope of delivery • GEBUS cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) 	
Installation manual	→ See the online catalogue of the Geberit sales company: Urinals: https://gbrt.io/dscFE04 Geberit bus converter: https://gbrt.io/dscFB00	
Connection principle		
Position of the supply lines		

Optionally, urinals with battery or generator operation can also be used. The connection to the Geberit Gateway is then only possible via Bluetooth®.

5.5.7 Connection of Geberit WC flush controls with electronic flush actuation



Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable via Geberit bus converter with integrated power supply unit • Connection of the GEBUS cable via plug with terminals
	Bluetooth®	Yes
Power supply	230 V AC to integrated power supply unit in the Geberit bus converter	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • GEBUS cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) <p>Installation element with Power & Connect box</p> <ul style="list-style-type: none"> • Geberit bus converter with integrated power supply unit, for Power & Connect Box, art. no. 116.097.00.1 (Plug for GEBUS cable included in scope of delivery) <p>Installation element without Power & Connect Box:</p> <ul style="list-style-type: none"> • Geberit Power & Connect Box and GEBUS converter set with integrated power supply unit, art. no. 116.099.00.1 (Plug for GEBUS cable included in scope of delivery) 	
Installation manual	<p>→ See the online catalogue of the Geberit sales company:</p> <p>WC flush control with Sigma10 actuator plate: https://gbrt.io/dscF900</p> <p>WC flush control with Sigma80 actuator plate: https://gbrt.io/dscF906</p> <p>WC flush control for external push button, for Sigma 12 cm https://gbrt.io/dscF90C</p> <p>WC flush control for external push button, for Omega 12 cm https://gbrt.io/dscF904</p> <p>WC flush control for RF-controlled button: https://gbrt.io/dscF90E</p> <p>HS05 hygiene flush unit: https://gbrt.io/dscF905</p> <p>Geberit bus converter: https://gbrt.io/dscFB01</p>	
Connection principle	<p>GEBUS</p> <p>Geberit bus converter</p> <p>IDC</p>	

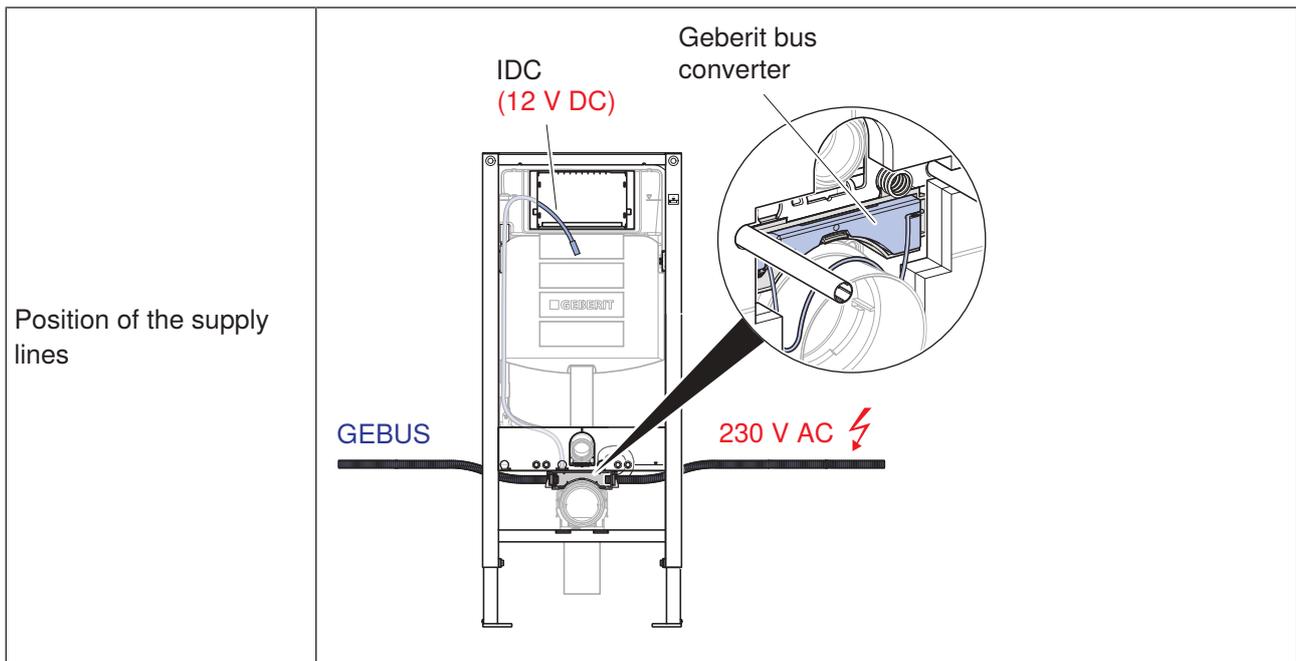

2 / 2

Optionally, WC flush controls with battery operation can also be used. The connection to the Geberit Gateway is then only possible via Bluetooth®.

5.5.8 Connection of the Geberit HS50 hygiene flush units



Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable to flush-mounting box (included in Geberit cable set for GEBUS interface) • From flush-mounting box with cable for GEBUS interface to control unit of the hygiene flush unit
	Bluetooth®	Yes
Power supply	230 V AC to external power supply unit (included in scope of delivery)	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • Geberit bus cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) • Geberit cable set for GEBUS interface, art. no. 616.238.00.1 	
Installation manual	→ See the online catalogue of the Geberit sales company: Geberit HS50 hygiene flush unit: https://gbrt.io/dscF701	
Connection principle		
Position of the supply lines		

The Geberit HS30 hygiene flush unit does not have a GEBUS connection. Connection to the Geberit Gateway is only possible via Bluetooth®.

5.5.9 Connection of the Geberit HS30 and HS50 hygiene flush units in the concealed cistern with Geberit bus converter



Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable via Geberit bus converter • Connection of the GEBUS cable via plug with terminals
	Bluetooth®	Yes
Power supply	230 V AC to integrated power supply unit in the Geberit bus converter	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • Geberit bus converter with integrated power supply unit, for Power & Connect Box, art. no. 116.097.00.1 <ul style="list-style-type: none"> – Geberit bus converter is installed in the element for wall-hung WC – Plug for GEBUS cable included in the scope of delivery • GEBUS cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) 	
Installation manual	→ See the online catalogue of the Geberit sales company: Geberit HS50 hygiene flush unit: https://gbrt.io/dscF703 Geberit HS30 hygiene flush unit: https://gbrt.io/dscF702 Geberit bus converter: https://gbrt.io/dscFB01	
Connection principle		
Position of the supply lines		

5.5.10 Connection of Geberit HS50 hygiene flush units in the concealed cistern with external power supply unit



Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable to flush-mounting box (included in the Geberit cable set for the GEBUS interface) • From flush-mounting box with cable for GEBUS interface to control unit of the hygiene flush unit
	Bluetooth®	Yes
Power supply	230 V AC to external power supply unit → see "Accessories required".	
Compatible with Geberit Control app	Yes	
Accessories required	<ul style="list-style-type: none"> • External power supply unit: <ul style="list-style-type: none"> – Variant 1: Geberit installation set with power supply unit for WC flush controls with electronic flush actuation, 12 V, art. no. 115.861.00.6 – Variant 2: 230 V/12 V/50 Hz power supply unit set with combination outlet mounting box, art. no. 115.336.00.1 • GEBUS cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) • Geberit cable set for GEBUS interface, art. no. 616.238.00.1 	
Installation manual	→ See the online catalogue of the Geberit sales company: Geberit HS50 hygiene flush unit: https://gbrt.io/dscF703	
Connection principle		
Position of the supply lines		

5.5.11 Connection of Geberit temperature and volumetric flow rate sensors for GEBUS



Available from 2024

Connection to Geberit Gateway	GEBUS	<ul style="list-style-type: none"> • With Geberit bus cable to flush-mounting box (on-site) • From flush-mounting box with sensor connection cable (length 1 m)
	Bluetooth®	Not possible
Power supply	24 V DC via GEBUS cable	
Compatible with Geberit Control app	Yes, only via GEBUS and Geberit Gateway	
Accessories required	<ul style="list-style-type: none"> • Geberit bus cable, art. no. 116.493.00.1 (100 m) or art. no. 116.493.00.5 (500 m) • Flush-mounting box and terminals (on-site) 	
Installation manual	→ See the online catalogue of the Geberit sales company: Temperature sensor: https://gbrt.io/dscF602 Temperature and volumetric flow rate sensor: https://gbrt.io/dscF601	
Connection principle		
Position of the supply lines		

5.6 Connection to building automation systems

The Geberit Gateway can be integrated into a building automation system via LAN. For the time being, the BACnet/IP network protocol is supported.

The connection to the building automation system is made via a standard LAN cable. The LAN cable is connected to the Geberit Gateway via an RJ45 plug.



The appropriate building automation technicians must be consulted for planning the cable connection to the building automation system. → See also "Wired interfaces", page 16.

ATTENTION

Data security risk

If the BACnet function is activated on the Geberit Gateway, the corresponding IP port is opened. This can be a potential data security risk.

- ▶ The Geberit Gateway must be protected by a firewall. → See "Connection to Geberit Cloud", page 52.

The IP port for BACnet is defined in the BACnet settings. → See "Configuring BACnet/IP", page 72.

Data points

The data points of all Geberit Connect end devices connected to a Geberit Gateway are made available as BACnet objects in EDE format (Engineering Data Exchange). The EDE file can be downloaded in the Geberit Control app under [BACnet]. → See "System logs", page 19.

A list of all BACnet objects can be found in the appendix. → See "BACnet objects", page 96.

An example of an EDE file can also be seen in the appendix. → See "EDE file for practical example 1", page 106.

Examples of data points:

- Request information for several grouped end devices:
 - Number of uses
 - Number of flushes (automatic or manual)
 - Number of interval flushes
 - Number of partial or full flushes (WC flush controls)
 - Calculated water consumption
- Request information for individual end devices:
 - Battery capacity
 - Water temperature (temperature sensor)
 - Volumetric flow rate (volumetric flow rate sensor)
 - Serial number
 - Status
 - Error messages
- Actuate functions for individual end devices:
 - Actuate flush
 - Actuate flushing for partial or full flush volume (WC flush controls)
 - Activate cleaning mode
 - Switch solenoid valve on/off
 - Switch Bluetooth® connection on/off

All actions (requesting information and actuating functions) must be programmed in the customer's building automation system.

Examples of actions:

- Periodic query of the number of uses to determine the cleaning intervals for the sanitary room
- Periodic query of water consumption to determine the amount of water used in the building
- Query of error messages to call on a service technician
- Actuation of interval flushes for hygiene function
- Periodic query of the water temperature to actuate flushing for hygiene function

Water consumption with hygiene function

When flushing is actuated by the building automation system, water consumption must be taken into account. To avoid excessive water consumption, the building automation system must ensure that the following conditions are met:

- For interval flushes for the hygiene function, select the flush volume so that only the volume of the pipe to be flushed is flushed.
- For temperature-dependent flushing for the hygiene function, limit the flush time.

The following must also be observed for the Geberit HS30 and HS50 hygiene flush units in the concealed cistern:



If hot water is connected to solenoid valve V2 in Geberit HS30 and HS50 hygiene flush units in the concealed cistern, solenoid valve V1 is always opened at the same time as solenoid valve V2. This happens irrespective of the activation of solenoid valve V1. This keeps the water temperature in the cistern low.

ATTENTION

Damage to the concealed cistern due to hot water

Prolonged flushing with hot water can damage the concealed cistern. The building automation system must ensure that the following conditions are met:

- ▶ Maximum flush volume per day and solenoid valve: 40 litres
- ▶ Minimum flush interval: 12 hours

Flush programmes for hygiene flushes



When controlling the Geberit HS50 or HS30 hygiene flush units through a building automation system or PLC, it is recommended to switch off the local flushing programmes in the Geberit Control app. Flushing processes that are otherwise undesired can be actuated or cancelled because the hygiene flush unit processes all flush actuations equally.

5.7 Connection to Geberit Cloud

The Geberit Cloud Services can be used for service functions, firmware updates and notifications.

To use the Geberit Cloud Services, the Geberit Gateway is connected via LAN or WLAN to a router with an internet connection. The connection to the router is established via a standard LAN cable with RJ45 plug or wirelessly via WLAN.

Geberit cloud server

The Geberit Cloud Services are operated on Microsoft Azure¹⁾ servers.

Data Protection

When using the Geberit Cloud Services, the privacy policy and the conditions of use in the Geberit Control app must be observed.

Local firewall settings

If the Geberit Gateway is operated behind a firewall, it must be ensured that the Geberit Gateway can reach the Geberit cloud server.

If a local firewall restricts outgoing connections to the Geberit cloud servers, an exception must be defined for Microsoft Azure services.

Further information: <https://learn.microsoft.com/en-us/azure/virtual-network/service-tags-overview#service-tags-on-premises>

Rule 1:

- Source:
 - Network/Device(s)
- Destination:
 - *.azure-devices.net
 - ext-fqdn-global.azure-devices-provisioning.net
 - ext-fqdn-wildcard-firmwarev1.services.geberit.com
- Ports:
 - t-443-HTTPS
 - t-8080

Rule 2:

- Source:
 - Network/Device(s)
- Destination:
 - Internet Services „Azure“

1) Microsoft Azure is a brand of the Microsoft Corporation.

5.8 Practical example 1: Connection of the end devices via Geberit Bus (GEBUS)

The example shows a WC suite for men and women in a sports stadium. All Geberit Connect end devices such as WC flush controls, urinal flush controls and washbasin taps are connected via GEBUS to the Geberit Gateway.

Geberit Connect end devices:

- 11 Geberit WC flush controls with electronic flush actuation, mains operation, Sigma10 actuator plate
- 5 Geberit urinal flush controls with electronic flush actuation, mains operation, type 10 cover plate
- 8 Geberit Piave washbasin taps, deck-mounted, mains operation, for concealed function box

The Geberit Gateway is installed in an installation box in the anteroom of the men's WC. The GEBUS cables of the WC flush controls are routed in a star configuration to the installation box with 11 corrugated pipes¹⁾. The GEBUS cables of the urinal flush controls and washbasin taps are looped through and lead to the installation box with 3 corrugated pipes.

- 1) With electrical connection boxes behind the installation elements for WC, looped-through GEBUS cabling is also possible.

The WC flush controls each require a 230 V AC electrical connection. The urinal flush controls and washbasin taps are fed via the GEBUS cable.

The end devices are divided into 4 zones, corresponding to the 4 rooms. → See "Zone division", page 36.

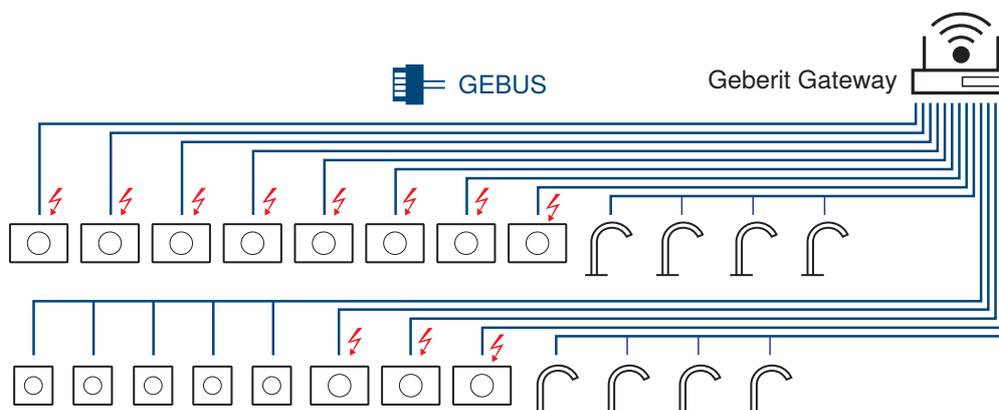
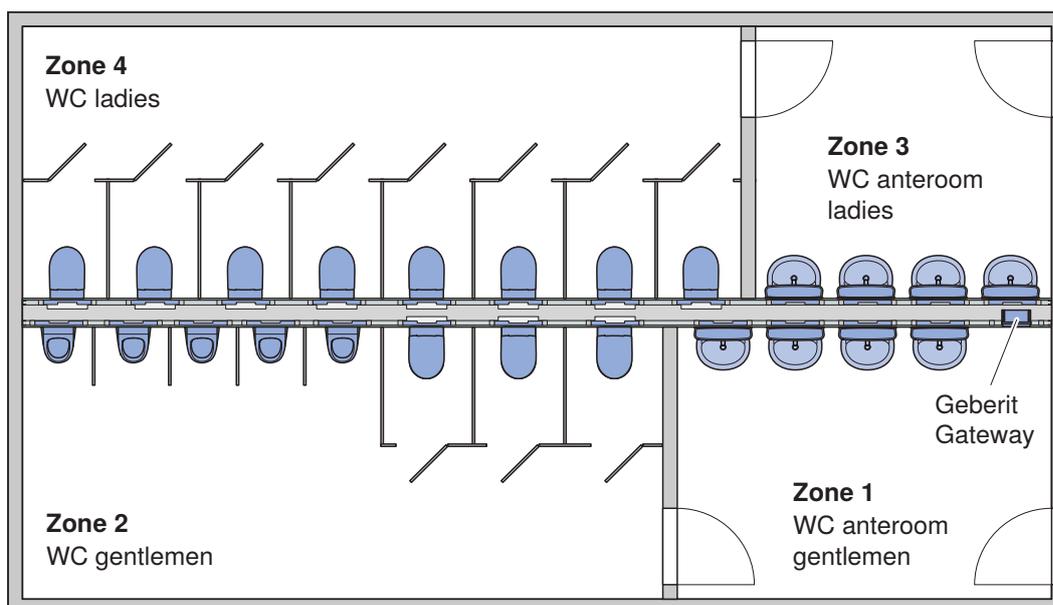


Figure 17: Practical example 1: Connection via GEBUS

5.8.1 Required components for connectivity

The following components are required for connectivity of Geberit Connect end devices. These components are required in addition to the standard installation without connectivity.

Number	Component	Article number
11	Geberit bus converter with integrated power supply unit, for Power & Connect Box, or	116.097.00.1
	Geberit set of Power & Connect box and GEBUS converter with integrated power supply unit, for element for wall-hung WC (if element for wall-hung WC does not contain Power & Connect box)	116.099.00.1
13	Geberit bus converter for concealed urinal flush controls and washbasin taps with a function box	116.371.00.1
1	Geberit Gateway	116.490.00.1
1	Geberit installation box for Gateway	116.491.00.1
1	Geberit cover plate	116.425.11.1 or 116.421.00.1
2	Geberit bus cable, length 100 m	116.493.00.1
	Electrical installation material on-site	

The following graph shows a cost comparison between the standard installation without connectivity and the installation with connectivity for this practical example. Additional connectivity with Geberit Connect is very cost-effective.

Initial situation: The building is in the installation phase.

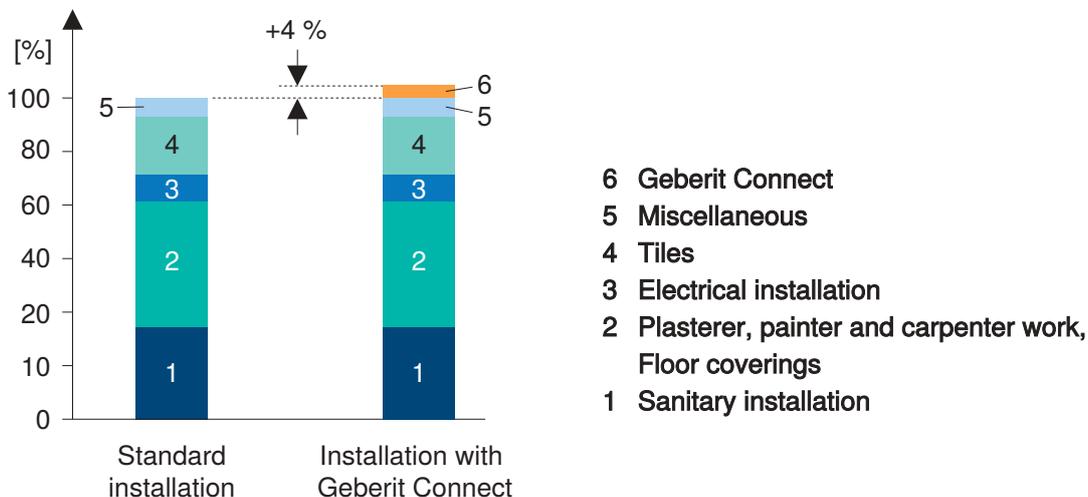


Figure 18: Practical example 1: Cost comparison with and without Geberit Connect

5.8.2 EDE file for building automation

An EDE file (Engineering Data Exchange) is required for integration into a building automation system via BACnet/IP. The EDE file contains all BACnet objects of the Geberit Gateway and the assigned end devices, grouped by zones. The EDE file is generated after commissioning and can be downloaded in CSV format via the Geberit Control app and the Geberit Gateway.

The EDE file of this practical example can be seen in the appendix. → See "EDE file for practical example 1", page 106.

5.9 Practical example 2: Connection of the end devices via Bluetooth®, battery operation

The example shows a men's WC in an office or administration building. No mains cables are laid to the individual sanitary appliances. Therefore, Geberit Connect end devices with battery operation are used. To avoid having to pull in additional cables for the GEBUS, connection to the Geberit Gateway is established via Bluetooth®.

Installed Geberit Connect end devices:

- 4 Geberit WC flush controls with electronic flush actuation, battery operation, Sigma10 actuator plate
- 4 Geberit urinal flush controls with electronic flush actuation, battery operation, type 10 cover plate
- 2 Geberit Piave washbasin taps, deck-mounted, battery operation, for concealed function box

The Geberit Gateway is installed in a plastic control cabinet in the anteroom of the men's WC. The Geberit Gateway must be located in the same room as the end devices to ensure the Bluetooth® connection to the Geberit Gateway.

The end devices are all in the same zone. → See "Zone division", page 36.

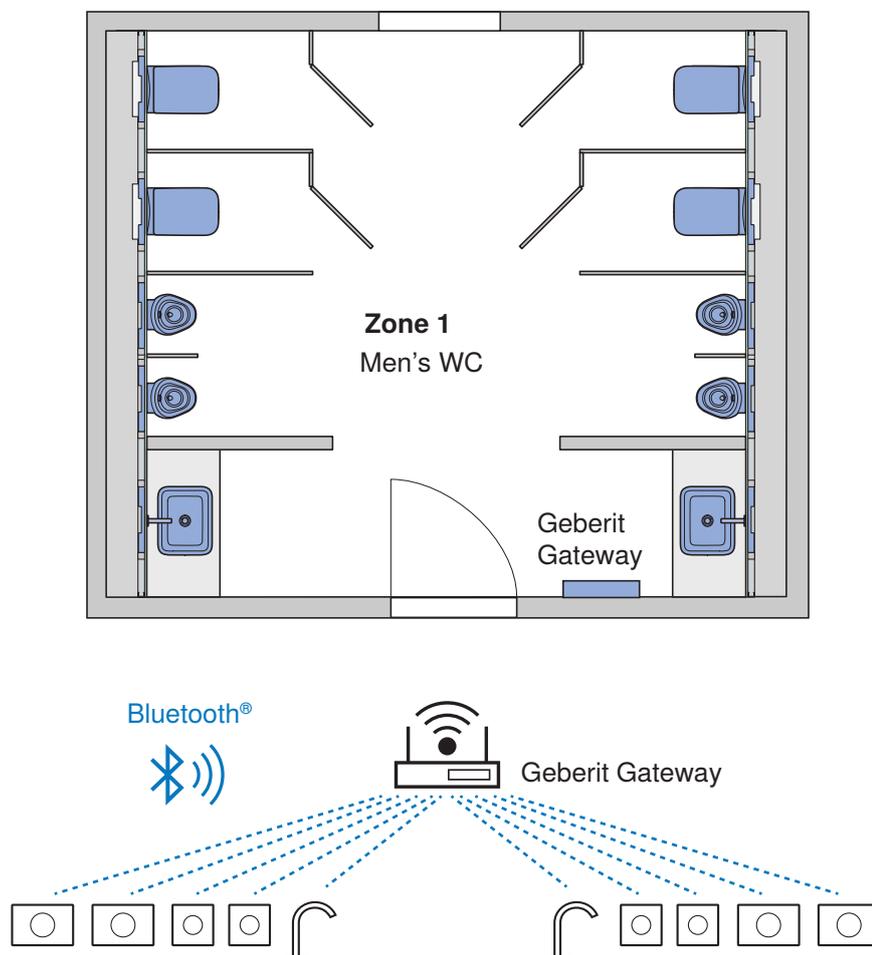


Figure 19: Practical example 2: Connection via Bluetooth®

5.9.1 Required components for connectivity

The following components are required for the subsequent connectivity of the Geberit Connect end devices:

Number	Component	Article number
1	Geberit Gateway	116.490.00.1
	Plastic control cabinet on-site	
	Electrical installation material on-site	

The following graph shows a cost comparison between the standard installation without connectivity and the installation with connectivity for this practical example. Additional connectivity with Geberit Connect is very cost-effective.

Initial situation: The existing sanitary room is being renovated and fitted with new sanitary appliances.

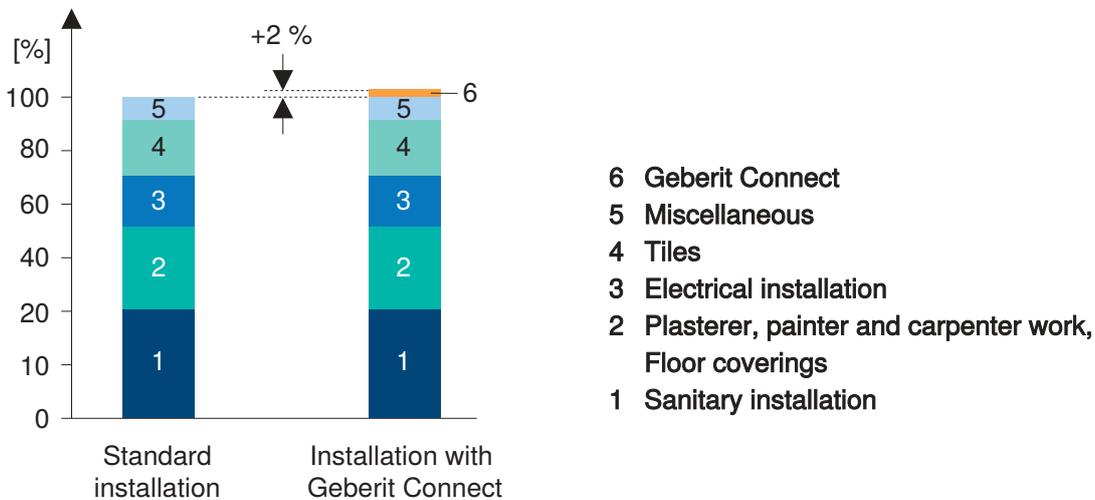


Figure 20: Practical example 2: Cost comparison with and without Geberit Connect

5.10 Practical example 3: Connection of the end devices via Bluetooth®, retrofitting

The example shows a men's WC in an office or administration building. The individual sanitary appliances were installed before 2022 and are therefore not compatible with Geberit Connect. The sanitary appliances are to be retrofitted with Geberit Connect so that they can be connected. To avoid having to pull in additional cables for the GEBUS, connection to the Geberit Gateway is established via Bluetooth®.

Installed sanitary appliances (without Geberit Connect):

- 4 Geberit WC flush controls with electronic flush actuation, mains operation, Sigma10 actuator plate
- 4 Geberit urinal flush controls with electronic flush actuation, mains operation, type 10 cover plate
- 2 Geberit Piave washbasin taps, deck-mounted, mains operation, for concealed function box

For retrofitting with Geberit Connect, only the control unit of each sanitary appliance needs to be replaced. Suitable spare parts are available for this purpose. → See table "Required components for retrofitting", page 58.

The Geberit Gateway is installed in a plastic control cabinet in the anteroom of the men's WC. The Geberit Gateway must be located in the same room as the end devices to ensure the Bluetooth® connection to the Geberit Gateway.

The end devices are all in the same zone. → See "Zone division", page 36.

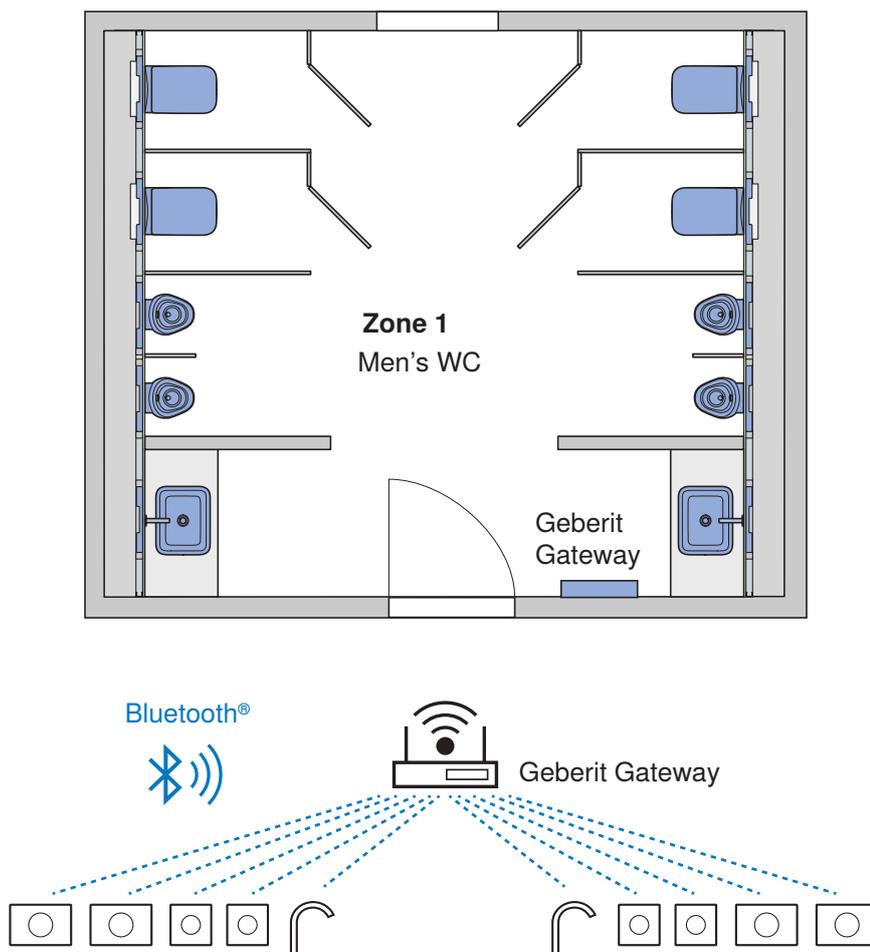


Figure 21: Practical example 3: Connection via Bluetooth®

5.10.1 Required components for retrofitting

The following components are required for retrofitting to Geberit Connect end devices:

Number	Component	Article number
4	Geberit electronics module for WC flush control, automatic, 3-4.1 V	241.476.00.1
4	Geberit sensor electronics for urinal flush controls	241.941.00.1
2	Geberit flush controls for Piave and Brenta washbasin taps	243.689.00.1
1	Geberit Gateway	116.490.00.1
	Plastic control cabinet on-site	
	Electrical installation material on-site	

5.10.2 General procedure for retrofitting with Geberit Connect

The following procedure is recommended for retrofitting existing sanitary appliances with Geberit Connect:

- 1 Check existing sanitary appliances for compatibility with Geberit Connect. The Geberit Connect logo is visible on the specification plate of compatible sanitary appliances.



- 2 If the sanitary appliances are not compatible, replace the flush control and other components if necessary. → See "Required components for retrofitting", page 58 table.

✓ The sanitary appliances have now been converted to Geberit Connect end devices.





- 3 Commission Geberit Connect end devices and check function.

- 4 Install Geberit Gateway in a plastic control cabinet and place the control cabinet provisionally. Establish temporary power supply.
If the Bluetooth® connection is insufficient and not all end devices can be assigned, the control cabinet can simply be relocated.

- 5 Assign Geberit Connect end devices to the Geberit Gateway. → See "Assigning end devices connected via Bluetooth", page 68.

- 6 Permanently mount the control cabinet with Geberit Gateway.


Required components for retrofitting sanitary appliances with Geberit Connect

Sanitary appliances without Geberit Connect logo on the specification plate		Required components for retrofitting	
Geberit WC flush controls with electronic flush actuation, with Sigma10 actuator plate		Geberit electronic module for WC flush control, automatic, 3-4.1 V, art. no. 241.476.00.1	
Geberit WC flush controls with electronic flush actuation, with Sigma80 actuator plate		<ul style="list-style-type: none"> Geberit WC flush control with electronic flush actuation, mains operation, with Sigma80 actuator plate, art. no. 116.090.xx.6 Geberit installation set with power supply unit, for WC flush controls with electronic flush actuation, 12 V, art. no. 115.861.00.6 Geberit type 212 flush valve, complete, art. no. 244.820.00.1 	
Geberit WC flush controls with electronic flush actuation, for external push button or IR button		Geberit lifting device and control unit, for push button, 3-4.1 V, art. no. 245.545.00.6	
Geberit WC flush controls with electronic flush actuation, for RF-controlled buttons		Geberit lifting device and control unit, for RF-controlled buttons, 3-4.1 V, art. no. 245.549.00.6	
Geberit Preda, Selva and Tamina urinals with integrated flush control		Geberit control electronics for integrated urinal flush control, art. no. 243.324.00.1	
Geberit urinal flush control with electronic flush actuation, concealed installation		Geberit sensor electronics for urinal flush control, art. no. 241.941.00.1	
Geberit Piave and Brenta washbasin taps		Geberit control for Piave and Brenta washbasin taps art. no. 243.689.00.1	
Geberit type 185/186 washbasin taps		Geberit electronic module for type 185/186 washbasin taps, art. no. 242.251.00.1	

6 Commissioning

6.1 Commissioning procedure

A Geberit Connect system can be commissioned in the following steps. The individual steps are described in detail in the next chapter. If there are several Geberit Gateways in the building, commission each Geberit Gateway separately.

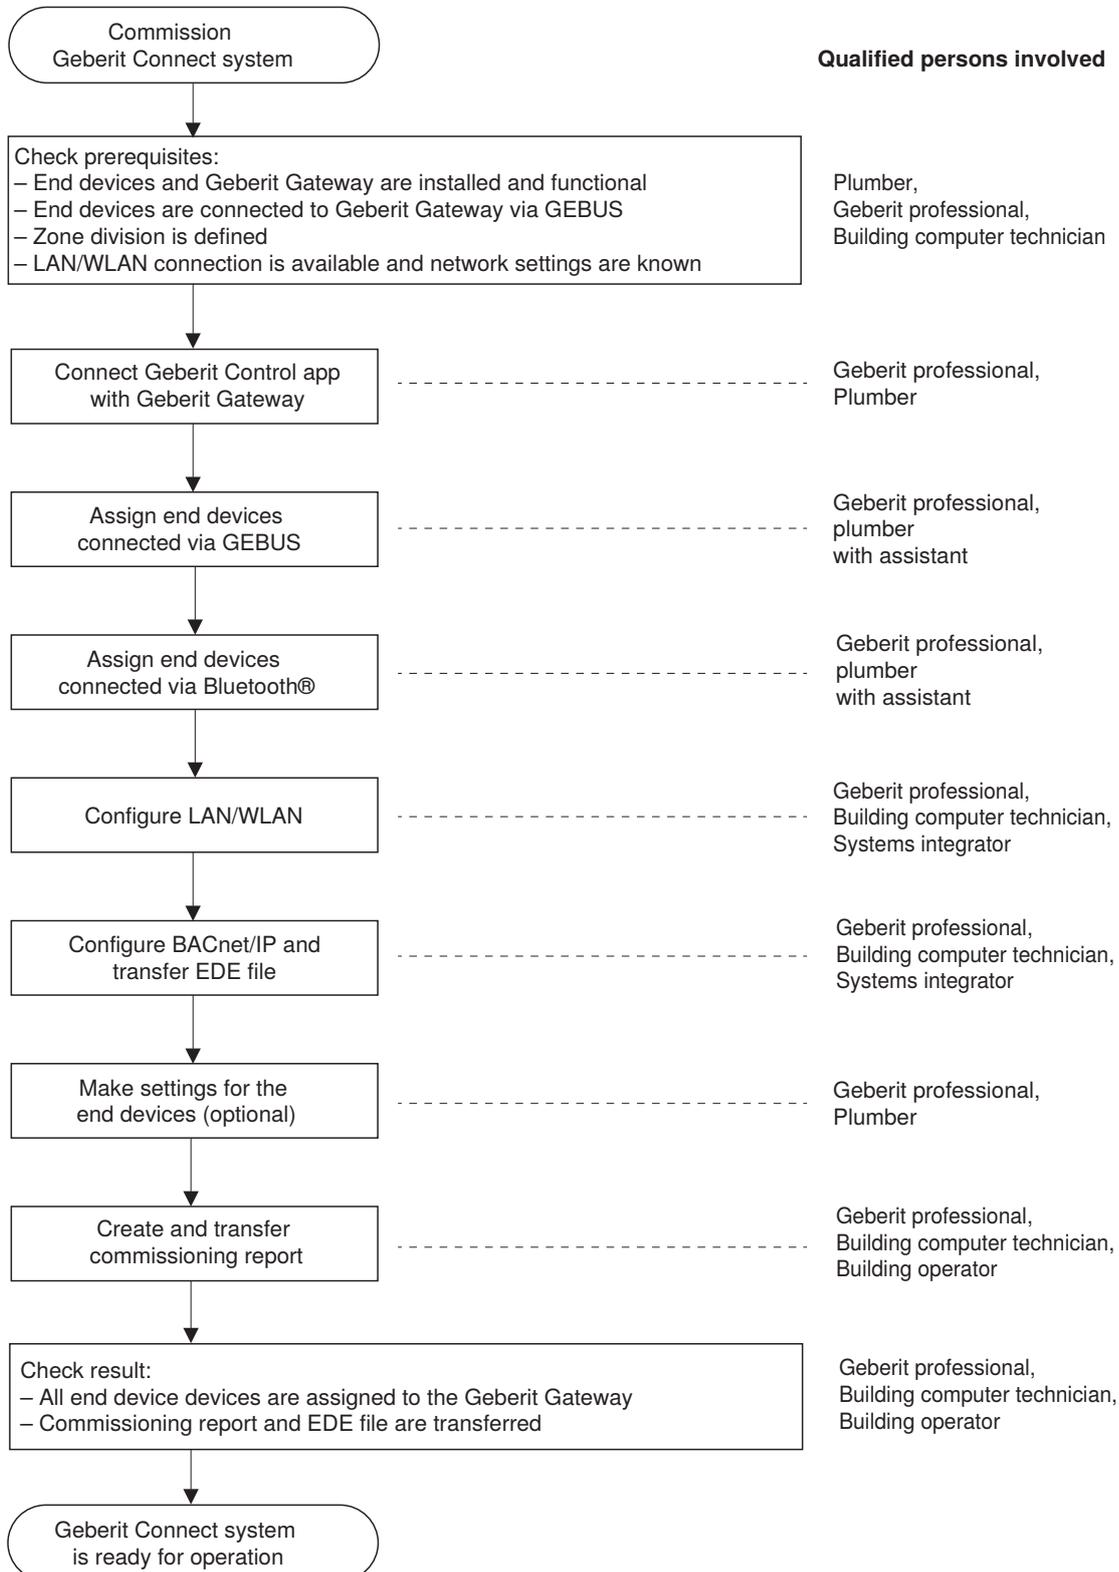

6.2 Checking requirements



The commissioning of a Geberit Connect system may only be carried out by qualified persons. → See "Qualified persons involved", page 8.

The following prerequisites must be met:

- Geberit Connect end devices are installed and functional.
- Geberit Gateway is installed and ready for operation.
- Geberit Connect end devices and Geberit Gateway are connected with the GEBUS cable (when connected via GEBUS).
- Zone division is available. → See "Zone division", page 36.
- LAN/WLAN connection is available and network settings are known (when connected to building automation system or Geberit Cloud).
- BACnet/IP parameters are known (when connected to building automation system).
- Power supply is switched on.

When the power supply is applied, the Geberit Gateway and the Geberit Connect end devices start up as follows:

Geberit Gateway	Electrical connection LED	All other LEDs	
Start-up process (1-2 minutes)			Bootloader OK
			Operating system OK
			Cloud connection OK
			Applications OK
Geberit Gateway is ready for operation		Current status → see "LED display", page 17.	

Geberit bus converter, Geberit HS50 hygiene flush unit	LED
End device is automatically addressed at GEBUS.	
End device is addressed at GEBUS.	
Voltage on the GEBUS too low (only Geberit bus converter) ▶ Check wiring.	

Geberit temperature and volumetric flow rate sensors (available from 2024)	LED
End device is automatically addressed at GEBUS.	
End device is addressed at GEBUS.	

When all LEDs of the end devices with LEDs (e.g. on the Geberit bus converter) light up green, the Geberit Connect system is ready for commissioning.

If the LEDs of the end devices do not light up green, check the wiring of the GEBUS cable.

6.3 Connecting Geberit Control app to Geberit Gateway




Status

In the lists under [New End Devices] and [My End Devices], in the Connectivity Manager and in the zone visualisation, the status of each end device is displayed as follows:

	Use	Indicates that usage has been detected on the end device.
	Signal strength	Indicates the strength of the Bluetooth® signal.
	Warning	Indicates that there is a warning on the end device. → See "Troubleshooting", page 89.
	Malfunction or error	Indicates that there is a fault or error on the end device. → See "Troubleshooting", page 89.

Example:

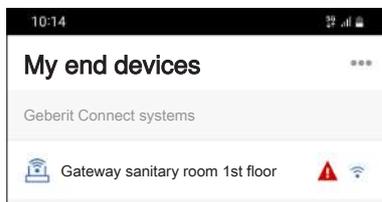


Connect Geberit Control app with Geberit Gateway:

- 1 Approach Geberit Gateway.
- 2 Open the Geberit Control app.
- 3 Log in with Geberit ID.
- 4 Select the Geberit Gateway under [New end devices] and start pairing. Follow the instructions in the Geberit Control app.
Pairing can be achieved either by pressing the pairing button or by entering the pairing secret. → See "Structure", page 15.
 - ✓ Pairing is started.
 - ✓ LED on the Geberit Gateway: 
- 5 Assign password¹⁾.

- 6** Assign name for Geberit Gateway or for Geberit Connect system and connect.
 ✓ Pairing is completed.

- ✓ LED on the Geberit Gateway: ✖

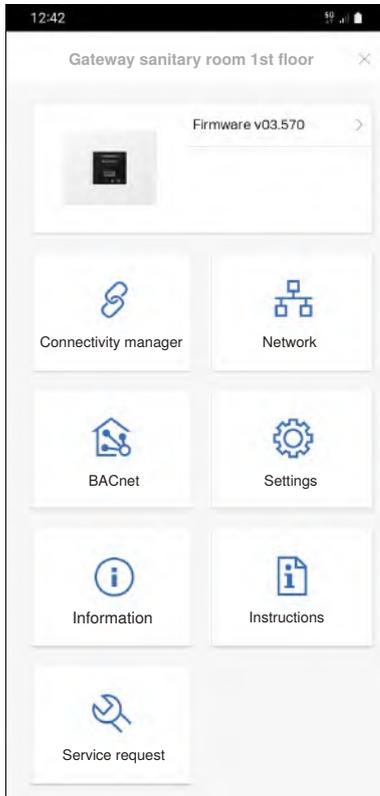

- 7** Activate Cloud Services under [Settings] Geberit Cloud Services. The Geberit Cloud Services can be used for service functions, firmware updates and notifications.

- 8** If a new firmware version is available, perform a firmware update. → See "Updating firmware", page 87.
 A new firmware version is indicated with an orange warning sign.



- 1) Password: It is recommended to write down the password of the Geberit Gateway. If the password has been forgotten, the pairing secret of the Geberit Gateway must be entered to reset the password. The password of the Geberit Gateway also protects all assigned end devices from unauthorised access. To access an end device, a connection to the Geberit Gateway must first be established.

6.4 Assigning end devices connected via GEBUS

2 people are required for this activity. The first person must always be near the Geberit Gateway so that the Bluetooth® connection to the Geberit Control app is guaranteed. The second person goes from end device to end device to actuate uses.


It is recommended to use hand-held radios or similar for communication between the two people. That way, the smartphone with the Geberit Control app can be used exclusively for commissioning.

While the end devices are being assigned, they must not be used by other people. It is recommended to close the sanitary rooms for use.



If end devices are connected in a Geberit Connect system via GEBUS and via Bluetooth®, always assign the end devices with GEBUS connection first.


- 1 1st person: Select Geberit Connect system or Geberit Gateway under [My End Devices].
- 2 Select [Centralised Operation].
✓ Connection to the gateway is established.
- 3 Activate [Notifications] if desired.
- 4 Select Geberit Gateway.
✓ The home page of the Geberit Gateway is displayed:

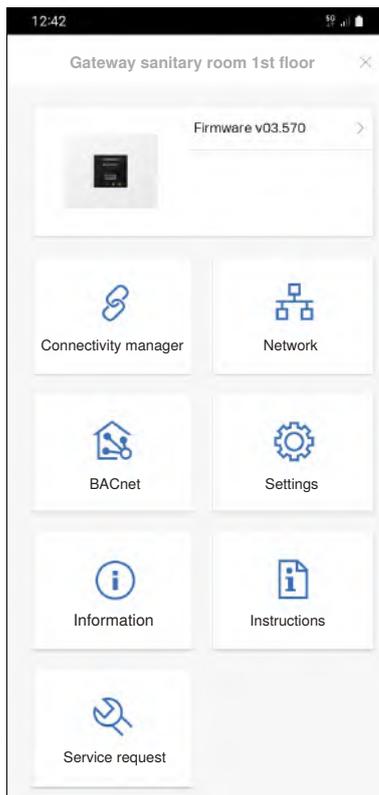

- 5 Open [connectivity manager].
✓ A list of all end devices detected on the GEBUS is displayed.
- 6 Check whether all end devices are listed.
- 7 2nd person: Approach first end device.




It is recommended to assign the end devices within a sanitary room in a clockwise direction. The order of assignment results in the order of the end devices in the corresponding zone.

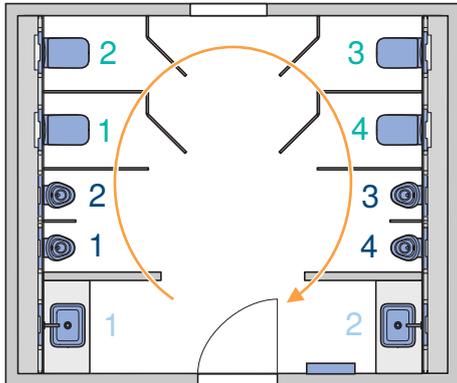

8

Actuate use at the end device so that the end device can be identified in the list. Depending on the end device, use is actuated differently. → See “Actuate use” below.

- ✓ Use of the end device is indicated by a green circle symbol.

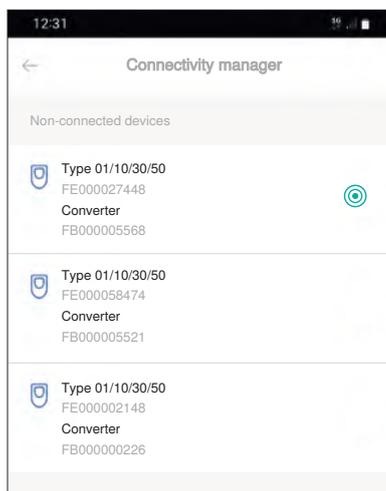

If the usage is not displayed in the Geberit Control app, the end device can also be identified via the serial number on the specification plate.

9

Select the corresponding end device from the list.

10

Create new zone or select and confirm existing zone.

It is recommended to create a separate zone for each sanitary room.

- ✓ End device is assigned to the corresponding zone in the Geberit Gateway.




When assigning the end device, a check is performed as to whether a new firmware version is available. If yes, the firmware update is started, which may take a few minutes.

11G Repeat steps 7-10 for all end devices.

Result

- ✓ The list in the [connectivity manager] no longer contains any un-connected end devices.

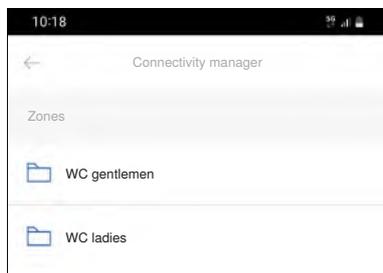

- ✓ LED on the Geberit Gateway: 

After the end devices have been assigned, they are connected with the Geberit Gateway.

Actuate use

- Piave and Brenta washbasin taps: Hold your hand in front of the IR sensor.
- Concealed urinal flush control: Empty water into urinal.
- Urinal flush controls with type 01/10/30/50 cover plate: Hold your hand in front of the IR sensor.
- Preda, Selva and Tamina urinals: Hold your hand in front of the IR sensor.
- WC flush controls with Sigma10 or Sigma80 actuator plate or with IR button: Hold your hand in front of the IR sensor.
- HS05 hygiene flush units: Switch the mains voltage off and on again.
- HS50 hygiene flush units: Press the <Test> button.
- HS30/HS50 hygiene flush units in the concealed cistern: Press the <Test> button or trigger a manual flush.

Adjust zones

The zones can be adjusted as follows:



Via [Adjust Pos.]:

- Sequence of end devices within a zone

Via the 3-point menu ...:

- Zone designation
- Assignment of the end devices to a zone

If a zone no longer contains any end devices, it is automatically deleted.

6.5 Assigning end devices connected via Bluetooth

While the end devices are being assigned, they must not be used by other people. It is recommended to close the sanitary rooms for use.




If end devices are connected in a Geberit Connect system via GEBUS and via Bluetooth®, always assign the end devices with GEBUS connection first.

1 Select Geberit Connect system or Geberit Gateway under [My End Devices].

2 Select [Centralised Operation].
✓ Connection to the gateway is established.

3 Activate [Notifications] if desired.

4 Select Geberit Gateway.
✓ The home page of the Geberit Gateway is displayed:

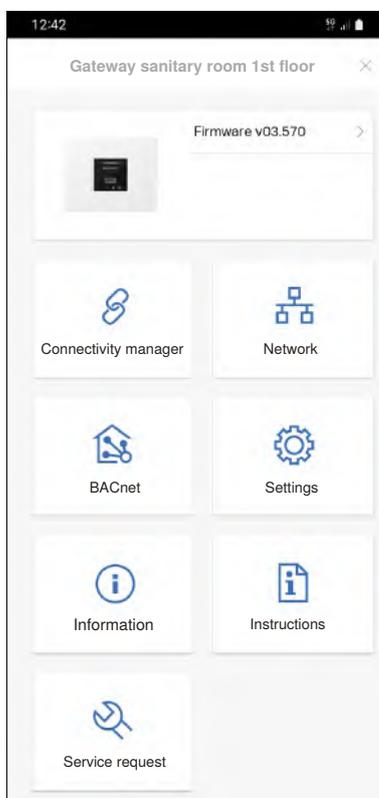

5 Open [connectivity manager].


6 Open [radio connection].
✓ A list of all end devices connected via Bluetooth® is displayed.

7 Check whether all end devices connected via Bluetooth® are listed.

8 Approach first end device.



It is recommended to assign the end devices within a sanitary room in a clockwise direction. The order of assignment results in the order of the end devices in the corresponding zone.

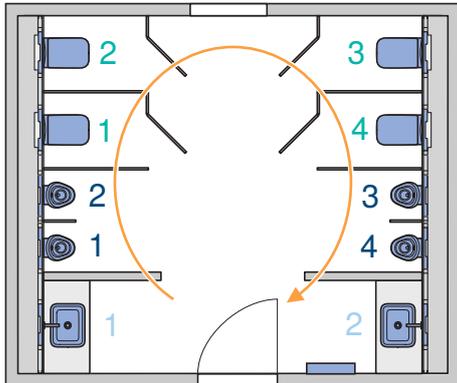

9

Select the end device in the list.

If necessary, identify the end device using the serial number on the specification plate.

10

Pair with the end device according to the instructions in the Geberit Control app.

Depending on the end device, use must be triggered via the IR sensor or a button must be pressed.



If the end device has already been assigned to a Geberit Gateway, it is password-protected. The pairing secret must therefore be entered for a new assignment.

11

Create new zone or select and confirm existing zone.

It is recommended to create a separate zone for each sanitary room. All end devices connected via Bluetooth® should be in the same sanitary room.

✓ End device is assigned to the corresponding zone in the Geberit Gateway.



When assigning the end device, a check is performed as to whether a new firmware version is available. If yes, the firmware update is started, which may take a few minutes.

12G Repeat steps 8-11 for all end devices.

Result

✓ The list under [Radio Connection] no longer contains any un-connected end devices.

After the end devices have been assigned, they are connected with the Geberit Gateway.

Adjust zones

The zones can be adjusted as follows:



Via [Adjust Pos.]:

- Sequence of end devices within a zone

Via the 3-point menu ...:

- Zone designation
- Assignment of the end devices to a zone

If a zone no longer contains any end devices, it is automatically deleted.

6.6 Configure LAN/WLAN

The network settings must be known. These must be agreed with the building automation engineer, building computer technician or systems integrator.


The IP addresses can either be obtained automatically via a DHCP server or entered manually. In addition, a local NTP server (Network Time Protocol) can be defined, for example for isolated BACnet installations. Such BACnet installations are used, for example, in LANs that are used exclusively for building automation.

WLAN connections can only be established with networks of the security type "WPA2 Personal". In addition, the name of the WLAN network (SSID) and the password must be known.

1 Select Geberit Connect system or Geberit Gateway under [My End Devices].

2 Select [Centralised Operation].
 ✓ Connection to the gateway is established.

3 Select Geberit Gateway.
 ✓ The home page of the Geberit Gateway is displayed:

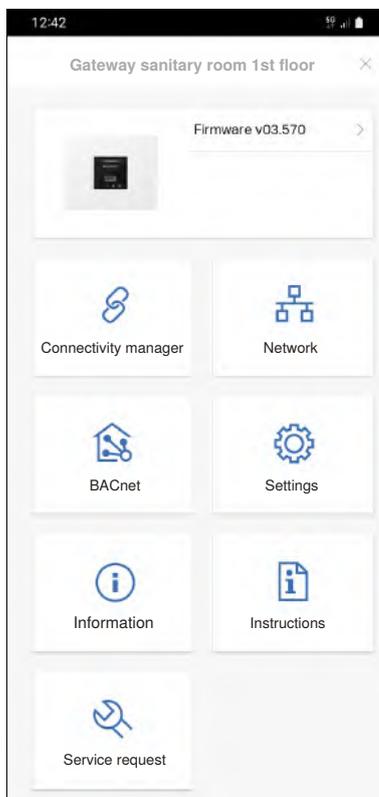

4 Open [network].

5 Adapt settings for LAN or WLAN.



If the wired network connection is not required, set [IP Assignment] to [Off].

6.7 Configuring BACnet/IP


The BACnet/IP parameters must be known. These must be agreed with the building automation engineer, building computer technician or systems integrator.

An EDE file is automatically created for integration into a building automation system.

1 Select Geberit Connect system or Geberit Gateway under [My End Devices].

2 Select [Centralised Operation].
✓ Connection to the gateway is established.

3 Select Geberit Gateway.
✓ The home page of the Geberit Gateway is displayed:

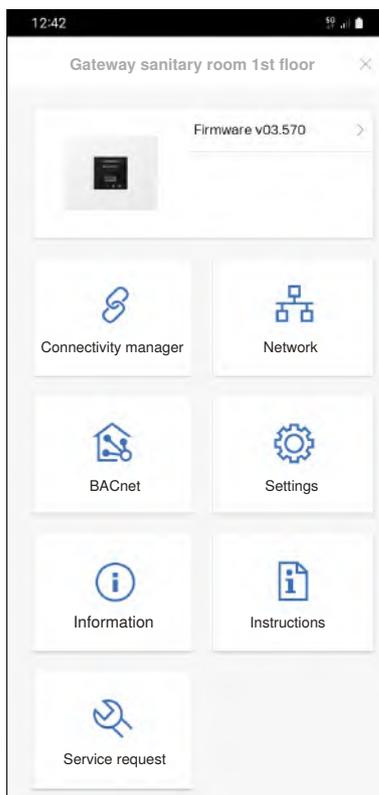

4 Open [BACnet].

5 Adjust configuration.

6 Select and export the [EDE file].

7 Share EDE file with the building computer technician, building automation technician or systems integrator.

ATTENTION

Data security risk

If the BACnet function is activated on the Geberit Gateway, the IP port that is defined under [BACnet] is opened. This can be a potential data security risk.

- ▶ The Geberit Gateway must be protected by a firewall.

6.8 Making settings for Geberit Connect end devices

Custom settings can be made for each end device if required:

- Assign names
- Activate functions such as interval flush
- Set parameters such as flushing time or detection time

Activating functions such as interval flush or setting flush times must be done for each end device separately.

You can choose between centralised and local operation to access an end device. With centralised operation, all assigned end devices can be accessed via the Geberit Gateway. Local operation involves accessing the end device directly. → See also "Operating and configuring end devices", page 77.

Centralised operation is selected in the following instructions.

Prerequisite

- The Geberit Gateway is within range of the smartphone.

1 Select Geberit Connect system or Geberit Gateway under [My End Devices].

2 Select [Centralised Operation].
✓ Connection to the gateway is established.

3 Select the zone with the desired end device.
✓ A list with the end devices in the corresponding zone is displayed.



4 Select end device.¹⁾
✓ Connection is established with end device.

5 Under [Settings], change the name and make the desired settings.

6 Carry out a function test (e.g. actuate flush via IR sensor).

7G Repeat steps 4-6 for all end devices.

- 1) A use can be actuated to identify the end device in the list. A green circle symbol is displayed on the end device.

6.9 Creating and transferring the commissioning report

All settings during commissioning and zone configuration are saved in a commissioning report. This report is handed over to the building operator after commissioning.


The Geberit Gateway also provides other reports. → See "System logs", page 19.

The commissioning report is created as follows:

1 Select Geberit Connect system or Geberit Gateway under [My End Devices].

2 Select [Centralised Operation].
✓ Connection to the gateway is established.

3 Select Geberit Gateway.
✓ The home page of the Geberit Gateway is displayed:

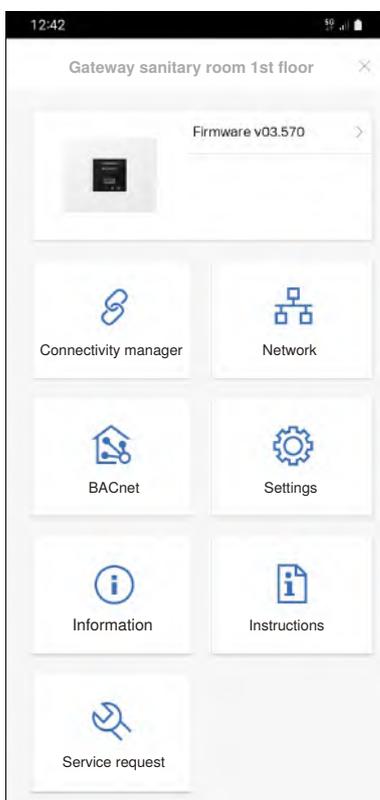

4 Open [Information].


5 Select and export the [commissioning report].

6 Share the commissioning report with the relevant persons.

6.10 Finalising commissioning

Check the commissioning result:

- All end devices are assigned to the Geberit Gateway. Only zones are listed under [My End Devices] in the Geberit Connect system. No un-connected end devices are visible.

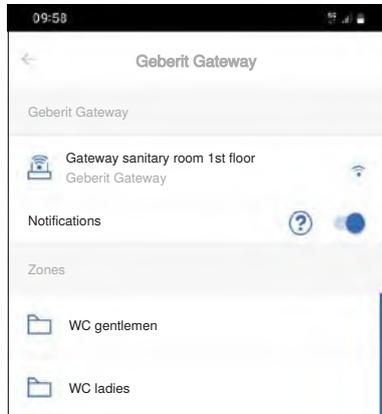

- All active LEDs on the Geberit Gateway light up green.
- The LEDs on all end devices with LEDs (e.g. on the Geberit bus converter) light up green.
- Commissioning report has been transferred to the building operator.
- The EDE file is transferred to the building automation technician.
- All authorised people have access to the Geberit Control app or have a Geberit ID.
- All authorised people have access to the Geberit Gateway and the assigned end devices.
- All end devices are configured.

If errors occur, the status of the Geberit Gateway can be determined from the LEDs. → See "LED display", page 17.

7 Use

7.1 Operating and configuring end devices

An end device in a Geberit Connect system can be accessed using the Geberit Control app. You can choose between centralised and local operation.

7.1.1 Centralised operation

With centralised operation, all end devices are accessed from the Geberit Gateway. The Geberit Control app connects itself to the Geberit Gateway.


Application:

- To commission a Geberit Connect system
- For centralised operation of the end devices from one location
- To manage the zones

Access:


1 Approach Geberit Gateway.

2 Select Geberit Connect system or Geberit Gateway under [My End Devices].

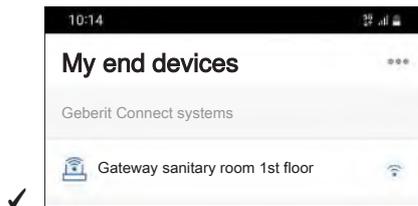

3 Select [Centralised Operation].

- ✓ Bluetooth® connection to the Geberit Gateway is established.
- ✓ All zones in the Geberit Connect system are displayed. → See also "Functions per zone", page 81.

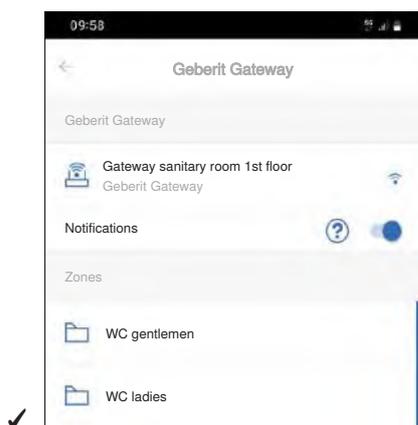


4 Select the zone with the desired end device.

5

Select the desired end device.

- ✓ Connection to the end device is established (via Geberit Gateway and GEBUS or Bluetooth® to the end device).

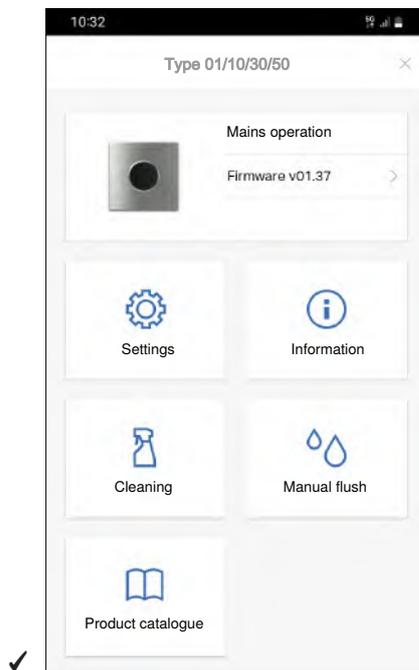

Connection to the end device:

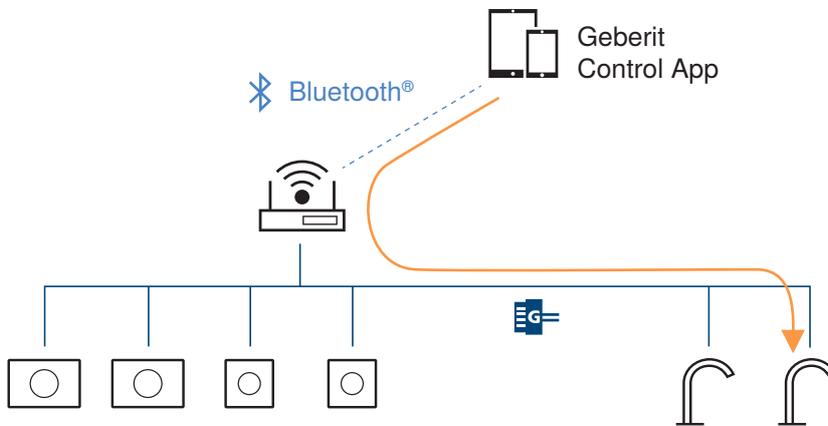


Figure 22: Example: Centralised operation of a washbasin tap

The following functions are available per end device:

- Activate cleaning mode
- Actuate flush
- Change settings
- Activate or deactivate functions
- Read out statistics

Certain functions, such as activating cleaning mode, can be carried out simultaneously for all end devices in a zone. → See also "Functions per zone", page 81.

7.1.2 Local operation

For local operation, the Geberit Control app is used to access an end device directly.


Application:

- For operating an end device regardless of the location of the Geberit Gateway
- For executing functions directly on the end device

Access:


1 Approach the required end device.

2 Select Geberit Connect system or Geberit Gateway under [My End Devices].

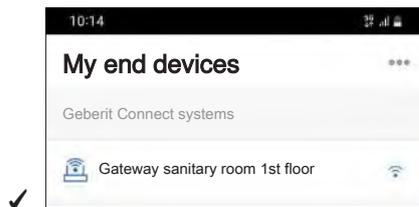


3 Select [Local Operation].

- ✓ All zones in the Geberit Connect system are displayed. → See also "Functions per zone", page 81.

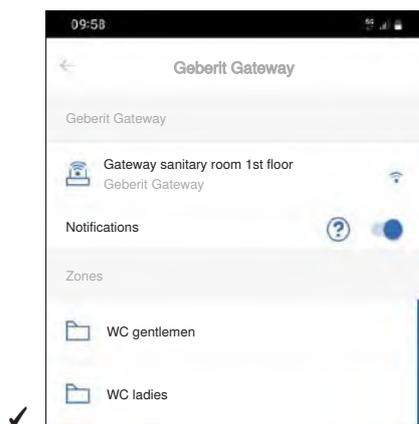

4 Select the zone with the desired end device.

- 5** Select the desired end device (note the signal strength).
 ✓ Bluetooth® connection is established with the end device.

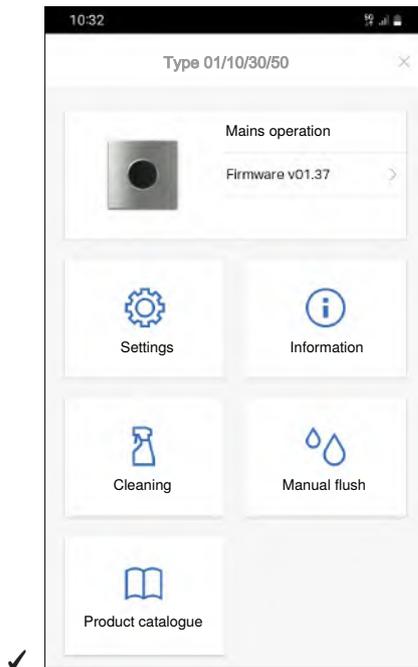

Connection to the end device:

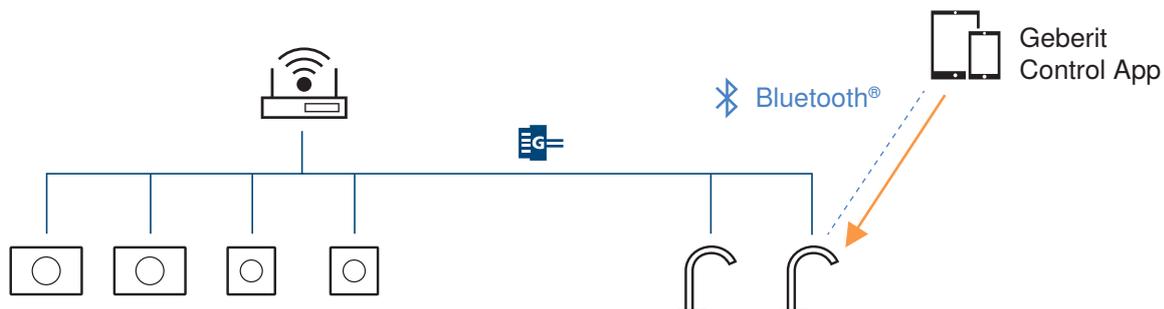


Figure 23: Example: Local operation of a washbasin tap

The following functions are available per end device:


- Activate cleaning mode
- Actuate flush
- Change settings
- Activate or deactivate functions
- Read out statistics

Certain functions, such as activating cleaning mode, can be carried out simultaneously for all end devices in a zone. → See also "Functions per zone", page 81.


7.1.3 Functions per zone

Certain functions, such as activating cleaning mode, can be carried out simultaneously for all end devices in a zone. If such a function is available, the zone on the right contains a blue bar.

The same functions are also available for the end devices after opening the zone.

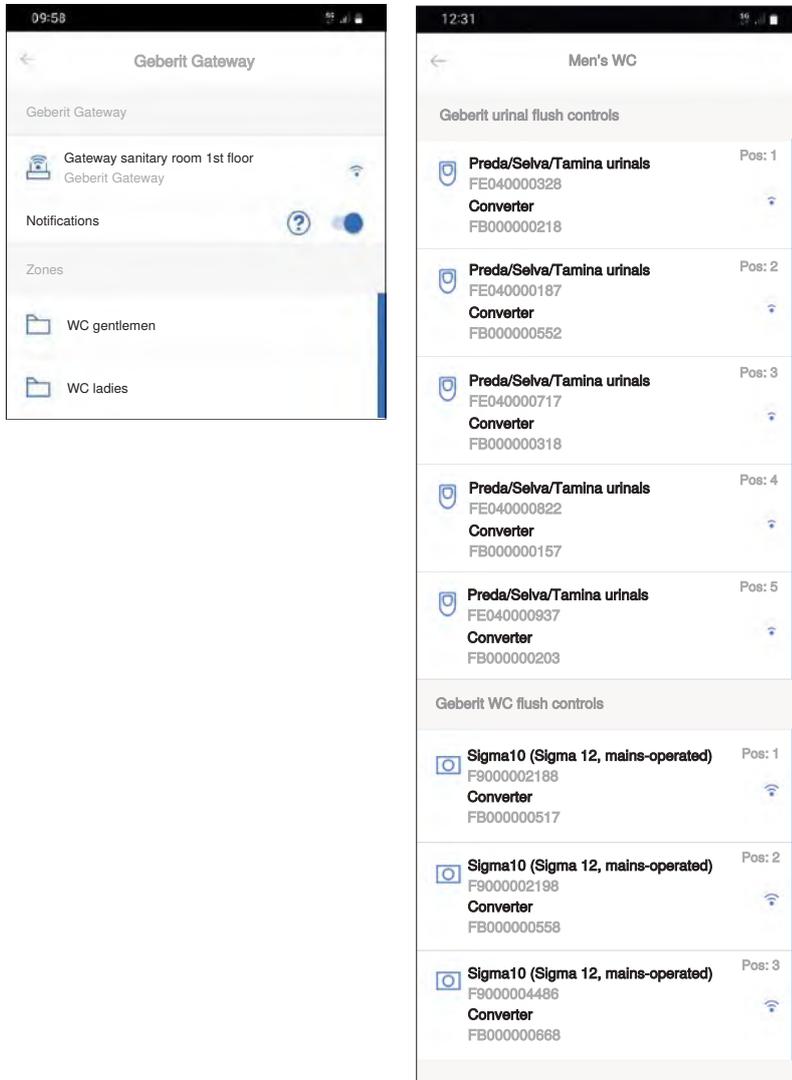

By sliding the zone to the left, the functions, such as activating cleaning mode, appear.

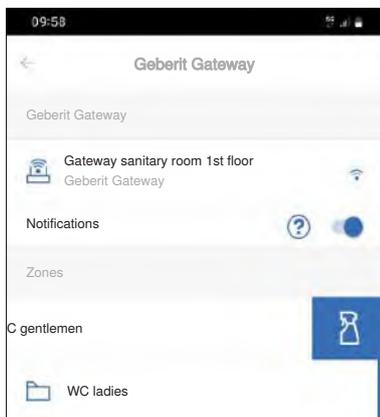

7.2 Managing zones and end devices

In a Geberit Connect system, end devices can also be added or removed or the zones customised during operation:

7.2.1 Adding end devices

To add a new end device, follow the same procedure as for commissioning:

- End devices connected via GEBUS: → See "Assigning end devices connected via GEBUS", page 64.
- End devices connected via Bluetooth®: → See "Assigning end devices connected via Bluetooth", page 68.

7.2.2 Managing zones and removing end devices


1 Approach Geberit Gateway.

2 Select Geberit Connect system or Geberit Gateway under [My End Devices].



3 Select [Centralised Operation].


- ✓ Bluetooth® connection to the Geberit Gateway is established.

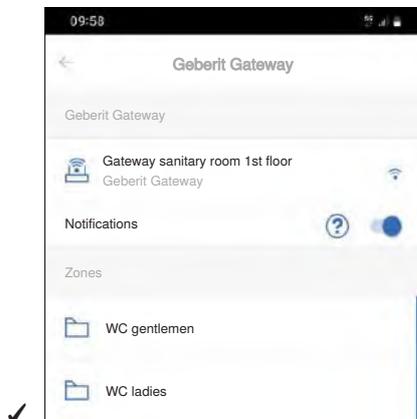

4 Select Geberit Gateway.

5 Open [connectivity manager].

6 Select the desired zone.

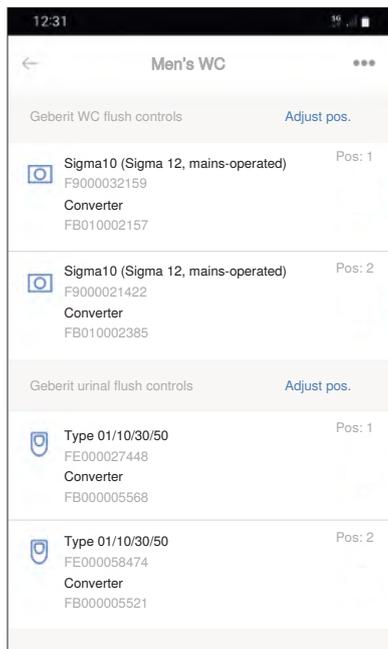

Manage zones

7 Use [Adjust Pos.] to adjust the position of an end device within a zone.

8 Via the 3-point menu ... Adapt the designation of the zone or the assignment of the end devices to a zone.

Remove end device

9 Via the 3-point menu ... Select end device and [Remove]. ✓ End device is no longer assigned to the Geberit Gateway.

10 Demount the end device.

7.3 Replacing end device

If a Geberit Connect end device needs to be replaced, the following procedure applies:

End device with connection via GEBUS (directly or via GEBUS converter)

- 1 Ensure that the Connect LED on the Geberit Gateway lights up green.
 - 2 Remove the defective end device or defective GEBUS converter.
 - 3 Mount and connect a new end device or new GEBUS converter.
 - 4 Wait at least 1 minute.
 - ✓ When the GEBUS cable is connected, the new end device is automatically assigned to the Geberit Gateway.
 - ✓ The settings are applied.
 - 5 Ensure that the Geberit Connect LED on the Geberit Gateway lights up green again.
-  If an end device cannot be automatically assigned, the Geberit Connect LED on the Geberit Gateway lights up red.
- 1 Manually assign the end device in the [connectivity manager] of the Geberit Control app. → See "Assigning end devices connected via GEBUS", page 64.

Notes:

- Do not interrupt the power supply to the Geberit Gateway.
- Replace only one end device or one GEBUS converter at a time.
- Geberit Connect end devices with GEBUS converters:

For end devices with GEBUS converters, the control unit and the GEBUS converter are linked together. Replacing GEBUS converters between end devices may result in the end devices being assigned to the wrong zone afterwards. It is recommended not to replace GEBUS converters between the end devices.
- Geberit HS30 and HS50 hygiene flush units (in concealed cistern):

The settings are **not** applied when a hygiene flush unit is replaced. All settings, including flush programmes, can be reset using the Geberit Control app.

End device with connection via Bluetooth®

- 2 Remove the defective end device or defective GEBUS converter.
- 3 Install new end device or new GEBUS converter.
- 4 Select Geberit Connect system or Geberit Gateway under [My End Devices].
- 5 Select [Centralised Operation].
 - ✓ Connection to the Geberit Gateway is established.
- 6 Select Geberit Gateway.
- 7 Open [connectivity manager].
- 8 Open zone with faulty end device.

-
- 9** Select the faulty end device via the 3-point menu and [Remove].
✓ Faulty end device is no longer assigned to the Geberit Gateway.
-
- 10** Assign new end device to the Geberit Gateway. → See "Assigning end devices connected via Bluetooth", page 68.
-
- 11** Configure new end device. The settings are **not** applied.


7.4 Displaying and evaluating statistics

Various logs from the Geberit Gateway and the assigned Geberit Connect end devices can be retrieved via the Geberit Control app. The logs can be exported and shared for further evaluation.

The following logs are available:

- Flushing and usage log (statistics)
- Event log
- Commissioning report
- Sensor log for GEBUS sensors (available from 2024)

The logs can be found under [Information].

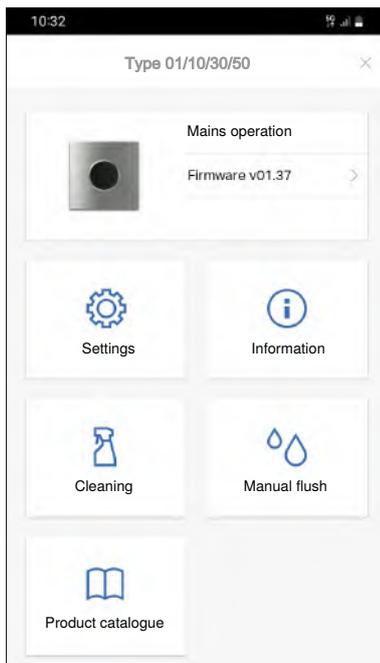

→ See also "System logs", page 19.

7.5 Updating firmware

If a firmware update is available for a Geberit Connect end device or the Geberit Gateway, this is displayed in the Geberit Control app by an orange warning sign.

Firmware for the Geberit Gateway is updated either through Geberit Cloud Services or using a USB flash drive.


The firmware file of the Geberit Gateway also contains firmware updates for end devices. After the firmware update of the Geberit Gateway, firmware updates are also automatically carried out on the assigned end devices, if necessary. For individual end devices, the firmware update can also be carried out directly in the Geberit Control app.

7.5.1 Firmware update with USB stick

Prerequisite

- A standard USB flash drive with FAT32 file system is available.

- 1** Call the relevant Geberit sales company. The contact details can be found in the Geberit Control app under [Service and Contact].
- 2** Enter the serial number of the Geberit Gateway.
- 3** Firmware file will be delivered by the Geberit sales company.
- 4** Copy the firmware file (*.GSI) to the root directory of the USB flash drive. Only 1 firmware file is allowed to be located in the root directory.
- 5** Insert the USB flash drive into the front side of the Geberit Gateway.
- 6** Connect the Geberit Control app to Geberit Gateway.
 - ✓ The new firmware version is displayed with a warning sign.

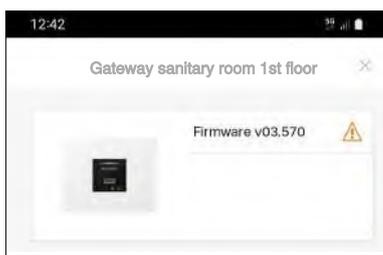

- 7** Open [firmware] and start firmware update.
 - ✓ The progress of the firmware update is indicated by the LEDs on the Geberit Gateway. → See "LED sequence during firmware update of the Geberit Gateway", page 88.
 - ✓ The connection to the Geberit Control app is interrupted during the firmware update.

Only unplug the USB flash drive once the white electrical connection LED on the Geberit Gateway is no longer flashing.

If problems occur during the firmware update, disconnect the power supply to the Geberit Gateway for approx. 10 seconds.

7.5.2 Firmware update with Geberit cloud services


Prerequisite

- The Geberit Gateway is connected to the Internet via a router (LED ).
- The Geberit Cloud Services are activated (LED .

1

Connect the Geberit Control app to Geberit Gateway.

- ✓ The new firmware version is displayed with a warning sign.

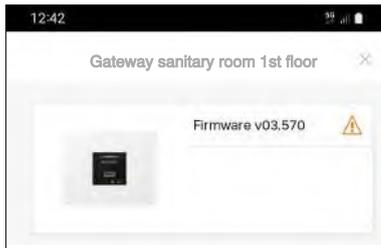

2

Open [firmware] and start firmware update.

- ✓ The firmware file is downloaded and the firmware update starts.
- ✓ The progress of the firmware update is indicated by the LEDs on the Geberit Gateway. → See "LED sequence during firmware update of the Geberit Gateway", page 88.
- ✓ The connection to the Geberit Control app is interrupted during the firmware update.


7.5.3 LED sequence during firmware update of the Geberit Gateway

Phase	Electrical connection LED	All other LEDs	
Firmware update active			Applications are being terminated
			Firmware file is being checked
			Firmware file is being installed
			Installation is completed
Geberit Gateway ready for operation		Current status → see "LED display", page 17.	
Firmware update failed			Firmware file check failed


7.6 Troubleshooting

If faults occur in the Geberit Connect system, it is recommended that you carry out the following steps as malfunction diagnosis.

- 1 Test the function of the end devices. If necessary, rectify the fault using the maintenance manual for the end device.
- 2 Check whether warnings or faults are displayed in the Geberit Control app.
 - ✓ In the Geberit Control app, faults are displayed with warning signs (orange = warning, red = fault or error). Tapping the warning sign takes you to the corresponding warning or malfunction message. Expanding the message displays instructions on how to rectify it.

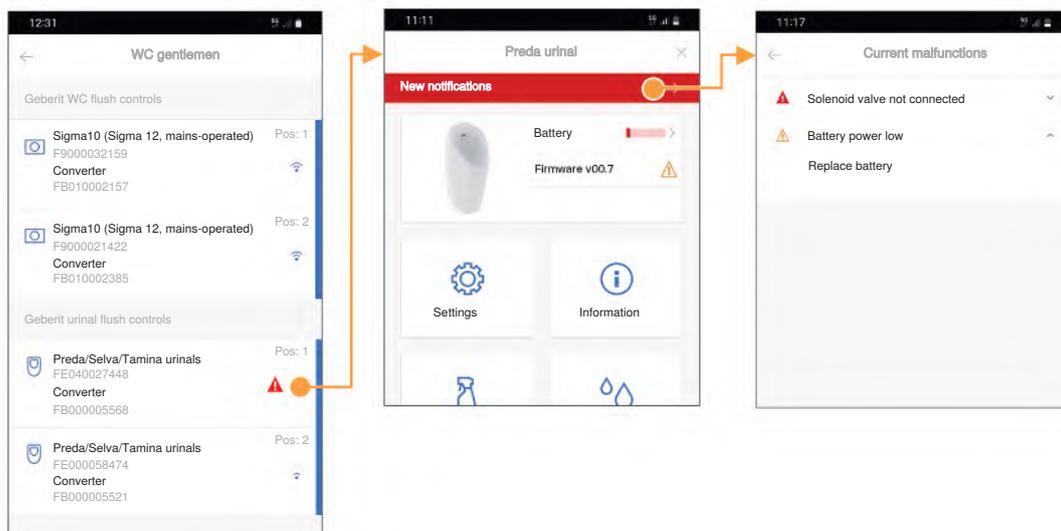

- ✓ If the notification function is activated in the Geberit Control app, faults and warnings are also reported by email.

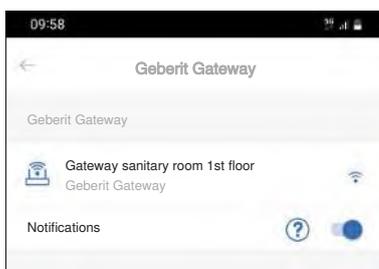

- 3 Check the LED display on the Geberit Gateway → see "LED display", page 17.
- 4 Check LED display on end devices or Geberit bus converters → see "LED display", page 23.
- 5 In the Geberit Control app, check whether newer firmware versions are available.
- 6 Malfunction diagnosis according to table "Troubleshooting", page 91.
- 7 If the malfunction diagnosis in the Geberit Control app is unsuccessful, send a [service request] or contact a Geberit qualified person.

A service request generates an email to the customer service department of the respective Geberit sales company with the following content:

- Sender
- Data of the end device
- Error description
- Appendix with event log and commissioning report

The error description must be entered manually, the remaining elements are generated automatically.

Possible malfunctions and tips on how to rectify them:

Malfunction	Cause	Remedy
End device does not flush.	Power supply missing	<ul style="list-style-type: none"> ▶ Check LED on Geberit bus converter → see "LED display", page 23 (for end devices with Geberit bus converter). ▶ Check power supply. ▶ Check GEBUS cable (for power supply via GEBUS).
	Pipe pressure too low	▶ Test pipe pressure (0.5–10 bar).
	End device is in cleaning mode	▶ End cleaning mode using the Geberit Control app.
	End device defective (flush control, solenoid valve, IR sensor)	<ul style="list-style-type: none"> ▶ In the Geberit Control app, check whether warnings or faults are displayed. ▶ Repair the end device → see the maintenance instructions of the end device. ▶ Replace end device → see "Replacing end device", page 84.
End device flushes continuously.	End device defective (flush control, solenoid valve, IR sensor)	<ul style="list-style-type: none"> ▶ In the Geberit Control app, check whether warnings or faults are displayed. ▶ Repair the end device → see the maintenance instructions of the end device. ▶ Replace end device → see "Replacing end device", page 84.
	Interval flush programme is running	▶ Check settings or flush settings.
End device flushes at the wrong time.	User detection faulty (IR sensor dirty, detection range incorrectly set)	▶ Check end device → see maintenance instructions of the end device.
	Flush settings incorrect	▶ Check [Settings] of the end device in the Geberit Control app.
End device is not accessible via Bluetooth® in the Geberit Control app.	End device is assigned to a Geberit Gateway	▶ Connect the Geberit Control app to Geberit Gateway and select the end device.
	End device is not compatible with Geberit Connect	<ul style="list-style-type: none"> ▶ Check the specification plate. Geberit Connect sign must be present. ▶ Replace end device or converter.
End device is not accessible in the connectivity manager of the Geberit Control app.	Communication via GEBUS incorrect	<ul style="list-style-type: none"> ▶ Check LED on Geberit bus converter → see "LED display", page 23 (for end devices with Geberit bus converter). ▶ Check GEBUS cable.
	No connection between end device and Geberit bus converter	▶ Check the cable between the end device and the Geberit bus converter.
Geberit Gateway is not accessible via Bluetooth®.	Distance to Geberit Gateway too great	▶ Move closer to Geberit Gateway.
	Software error	<ul style="list-style-type: none"> ▶ Check LED display at Geberit Gateway → see "LED display", page 17. ▶ Restart the Geberit Gateway under [Settings] in the Geberit Control app.
	Geberit Gateway defective	▶ Contact a Geberit professional.

Malfunction	Cause	Remedy
Geberit Gateway is not accessible via LAN/WLAN or BACnet.	Cable connection faulty	<ul style="list-style-type: none"> ▶ Check LED display at Geberit Gateway → see "LED display", page 17. ▶ Check LAN cable. ▶ Check the LEDs on the LAN cable female socket at the bottom of the Geberit Gateway (LEDs flash during data traffic)
	Configuration faulty	▶ Check Geberit Control app network and BACnet settings.
	Software error	▶ Restart the Geberit Gateway under [Settings] in the Geberit Control app.
	No internet connection to Geberit Cloud Services	<ul style="list-style-type: none"> ▶ Check LED display at Geberit Gateway → see "LED display", page 17. ▶ Check router. ▶ Check network settings for LAN/WLAN with the Geberit Control app.
	Geberit Gateway defective	▶ Contact a Geberit professional.

2 / 2

Recommended procedure for testing the GEBUS cable:

- Disconnect the GEBUS plug from the Geberit Gateway.
- Check all 4 cores of the GEBUS cable against one another for short circuits at the plug.
- Check whether voltage is present at the plug. There must be no voltage present. If it is, there might be another Geberit Gateway connected to the GEBUS.
- Row or tree topology:
 - Disconnect all stacks and reconnect stacks individually.
 - Check which end devices are recognisable in the Connectivity Manager.

7.7 Deactivating the Bluetooth® connection

In buildings with increased safety requirements, such as military facilities, power stations or banks, the building operator may request that the Bluetooth® connection be deactivated. This ensures that the end device cannot be manipulated and no data can be read out.

To deactivate and reactivate the Bluetooth® connection of Geberit Connect end devices permanently, a Geberit sales company must be consulted.

8 Disposal

8.1 Constituents

This product meets the requirements of Directive 2011/65/EU (RoHS) (restriction of the use of certain hazardous substances in electrical and electronic equipment).

8.2 Disposal of waste electrical and electronic equipment



The symbol of the crossed-out wheeled bin means that waste electrical and electronic equipment (WEEE) must be disposed of separately and not with other non-recyclable waste. End users are legally obliged to return old equipment to public waste disposal authorities, distributors, or Geberit for proper disposal. Many distributors of electrical and electronic equipment are obliged to take back WEEE free of charge. Contact the responsible sales or service company to return the WEEE to Geberit.

Used batteries and accumulators that are not enclosed within the old equipment, as well as lamps that can be removed from the old equipment in a non-destructive manner, must be separated from the old equipment before being handed over to a disposal point.

If personal data is stored on the old equipment, end users themselves are responsible for deleting it before handing it over to a disposal point.

9 Appendix

9.1 List of abbreviations

Abbreviation	Description
BACnet	Network protocol for interoperable and cross-trade communication in building automation, which is standardised as ISO 16484-5.
BACnet/IP	BACnet, which is based on the Internet Protocol
BLE	Bluetooth® Low Energy Technology of the Bluetooth® Special Interest Group, which is characterised by low energy consumption
DHCP	Dynamic Host Configuration Protocol Protocol for integrating clients into a network without manual configuration of the network interface
EDE	Engineering Data Exchange Listing of BACnet objects in a file
BA	Building automation
GEBUS	Geberit bus Geberit specific bus with physical interface RS485, supply voltage 24 V DC and automatic addressing of the end devices
IDC	Inter Device Connection Geberit specific interface with I ² C communication and supply voltage of 12 V DC
LAN	Local Area Network Computer network that covers a building or a group of buildings in its extension.
PLC	Programmable logic controller
USB	Universal Serial Bus Serial data transmission system for connecting a computer to external devices
WLAN	Wireless Local Area Network Wireless computer network for interconnecting electronic devices within a restricted area (e.g. a building or a floor).

9.2 Geberit Gateway BACnet certificate

BACnet CONFORMANCE CERTIFICATE



No. BTL-30984

WSPCert attests the conformance of the following BACnet implementation to the BACnet standard ISO 16484-5 protocol revision 1.19. The attested conformance refers to the BACnet Interoperability Building Blocks (BiBBs) listed on the BTL Listing bearing the above-mentioned BTL-number.

The BACnet implementation has fulfilled the requirements according to the test standard ISO 16484-6, the BTL Test Plan 20.0 and the BTL Testing Policies, see Test Report number 22.1300.001.008 of iHomeLab.

Product name (B-GW)
Geberit Gateway
Model(s) F500
Firmware version
Firmware Revision 0.9
Application Software 00.414
Vendor
Geberit International AG
Schachenstrasse 77
8645 Jona, Switzerland

This certificate is valid until **31-Mar-2028**.

17-Feb-2023

Date of Initial Certification

Dipl.-Ing. G. Weinmann
Head of Certification Body

Issued on behalf of BACnet International
2900 Delk Road, Suite 700, PMB 321
Marietta, GA 30067, USA

Certification by WSPCert Dr.-Ing. Frank Bitter
Kapuzinerweg 7, 70374 Stuttgart, Germany



9.3 BACnet objects

The BACnet objects offered depend on the range of functions of the respective end devices. The objects are created dynamically when an end device is assigned to the Geberit Gateway.

Object instance

For each BACnet object, the Object Instance is created dynamically in accordance with the following rules.

The Object Instance for end devices is composed of the following values:

- Zone
 - Maximum 20 zones
 - 01: Zone 1
 - 02: Zone 2
 - ...
 - 19: Zone 19
- End device type
 - Maximum 15 end devices
 - 00: Collective group (all end devices in the same zone)
 - 01: WC
 - 02: Urinal
 - 03: Washbasin tap
 - 04: Sensor
 - 05: Hygiene flush unit
 - 06-14: RFU¹⁾
- End device position
 - Maximum 31 end device positions
 - 00: Collective group (all end devices of the same type in the same zone)
 - 01: Position 1
 - 02: Position 2
 - ...
 - 30: Position 30
- Object number
 - Maximum 400 objects per end device
 - 000-099: Information (read, static)
 - 100-199: Status (read, dynamic)
 - 200-299: Control (read and write)
 - 300-399: RFU¹⁾

Object Instance for Geberit Gateway:

- Object Instance
 - Area: 0 000 000-0 000 399
 - (Zone for Geberit Gateway = 0)
 - (End device type = 0)
 - (End device position = 0)
 - (Object number = 000-399)

1) RFU: reserved for future use (reserved for future use)

The Object Instance is calculated from these values as follows (→ see also example under “Collective groups”):

- Object Instance =
Object number + (end device position • 400) + (end device type • 400 • 31) + (zone • 400 • 31 • 15)

The individual values are extracted from the Object Instance as follows:

- Object number = Object Instance mod 400
- End device position = |(Object Instance mod (400 • 31)): 400|
- End device type = |(Object Instance mod (400 • 31 • 15)): (400 • 31)|
- Zone = |Object Instance: (400 • 31 • 15)|

Collective groups

Some BACnet objects can also be used for collective groups, such as water consumption. This way, the water consumption for an entire zone, only for the urinals in a zone or only for a single urinal can be queried. The following BACnet objects of the “Structured View” type are available to represent the different collection groups:

- Collective group for each zone and for the Geberit Gateway
- Collective group for each type of end device per zone (urinal, WC, washbasin tap, etc.)
- For each individual end device

Example of a structure with collective groups (simplified, only with “WaterUsage” object):

Description	Z	T	P	N	Object Instance
	o	y	o	o	
	n	p	s		
	e	e			
> Gateway	00	00	00	000	000000
- Gateway.DeviceSerial	00	00	00	001	000001
..					
> Zone.1.AllDevices	01	00	00	000	186000
- Zone.1.AllDevices.WaterUsage	01	00	00	170	186170
..					
> Zone.1.AllToilets	01	01	00	000	198400
- Zone.1.AllToilets.WaterUsage	01	01	00	170	198570
..					
> Zone.1.Toilet.1	01	01	01	000	198800
- Zone.1.Toilet.1.DeviceSerial	01	01	01	001	198801
- Zone.1.Toilet.1.WaterUsage	01	01	01	170	198970
..					
> Zone.1.Toilet.2	01	01	02	000	199200
- Zone.1.Toilet.2.WaterUsage	01	01	02	170	199370
..					
> Zone.1.Toilet.3	01	01	03	000	199600
- Zone.1.Toilet.3.WaterUsage	01	01	03	170	199770
..					
> Zone.1.AllUrinals	01	02	00	000	210800
- Zone.1.AllUrinals.WaterUsage	01	02	00	170	210970
..					
> Zone.1.Urinal.1	01	02	01	000	211200
- Zone.1.Urinal.1.WaterUsage	01	02	01	170	211370
..					
> Zone.1.AllWashbasins	01	03	00	000	223200
- Zone.1.AllWashbasins.WaterUsage	01	03	00	170	223370
..					
> Zone.1.Washbasin.1	01	03	01	000	223600
- Zone.1.Washbasin.1.WaterUsage	01	03	01	170	223770
..					
> Zone.2.AllDevices	02	00	00	000	372000
- Zone.2.AllDevices.WaterUsage	02	00	00	170	372170
..					
> Zone.2.AllToilets	02	01	00	000	384400
- Zone.2.AllToilets.WaterUsage	02	01	00	170	384570
..					
> Zone.2.Toilet.1	02	01	01	000	384800
- Zone.2.Toilet.1.DeviceSerial	02	01	01	001	384801
- Zone.2.Toilet.1.WaterUsage	02	01	01	170	384970
..					

Figure 24: Example for collective groups

→ See also "EDE file for practical example 1", page 106.

BACnet objects only for Geberit Gateway

Object Name	Description	Object Type	Object Instance	R/W
DeviceObject	Various pieces of information about the Geberit Gateway. Device instance is defined in the Geberit app. Factory setting: Serial number	Device	Device instance defined in Geberit app	R
BACstac-NPO-1	Network Port Object (NPO) according to BACnet specification. The LAN interface is described by an NPO. The password for the commands corresponds to the password of the Geberit Gateway.	Network Port	1 or 4194303 for active NPO	R/W
Gateway	Collective group for Geberit Gateway	Structured View	0000000	R

BACnet objects for Geberit Gateway and end devices

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
Zone n [Group] [Device]	Collective group for end devices	Structured View	000	R	✓	-	✓	✓	✓	✓	✓
Information											
Device Serial	Serial number of the end device or the Geberit Gateway. Example: FC03-1234567-0E7CDEF8	Character String Value	001	R	-	✓	✓	✓	✓	✓	✓
ZoneName	Designation of the zone to which the end device or the Geberit Gateway is assigned.	Character String Value	002	R	-	✓	✓	✓	✓	✓	✓
Status											
Connection Status	Status of connectivity with the end device. Also affects the “Out_Of_Service Property” of the affected end device objects. Processing: If the end device or at least 1 end device in a collective group is not accessible, trigger an alarm and start diagnostics on site with Geberit Control app.	Multi-state Value • Normal • Unreachable COV	101	R	✓	-	✓	✓	✓	✓	✓

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
Generic Info	Geberit Gateway displays information. Corresponds to the status display in the Geberit Control app. Processing: If information is displayed on the Geberit Gateway, trigger an alarm and read out the information on site with the Geberit Control app.	Binary Value COV	102	R	✓	✓	-	-	-	-	-
Generic Warning	End device or Geberit Gateway displays a warning. Corresponds to the status display in the Geberit Control app. Processing: If a warning is displayed on the end device or at least 1 end device in a collective group, trigger the alarm and read out the warning on site with Geberit Control app.	Binary Value COV	103	R	✓	✓	✓	✓	✓	✓	✓
Generic Error	End device or Geberit Gateway displays a fault or error. Corresponds to the status display in the Geberit Control app. Processing: If a fault is indicated on the end device or at least 1 end device in a collective group, trigger the alarm and read out the fault on site with the Geberit Control app.	Binary Value COV	104	R	✓	✓	✓	✓	✓	✓	✓
Generic Fatal Error	End device indicates a fatal fault or fatal error. Corresponds to the status display in the Geberit Control app. Processing: If a fatal fault is indicated on the end device or at least 1 end device in a collective group, trigger the alarm and read out the fault on site with Geberit Control app.	Binary Value COV	105	R	✓	-	-	-	-	-	✓

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
LowBattery	Battery of the end device almost empty. If the battery is completely empty and the end device fails, the "ConnectionStatus" is set to "Unreachable". For end devices with mains operation or power supply via GEBUS, "False" is always displayed.	Binary Value COV	106	R	✓	-	✓	✓	✓	-	-
Usage Active	End device is being used. Corresponds to the status display in the Geberit Control app. Set when the end device is in use, e.g. hand in front of the IR sensor. Set on the Geberit Gateway when the pairing button is pressed. Application: for usage display or utilisation analysis.	Binary Value COV	107	R	✓	✓	✓	✓	✓	✓	✓
ValveOpen	Solenoid valve of the end device open. Solenoid valve V1 open during hygiene flushes.	Binary Value COV	108	R	✓	-	✓	✓	✓	-	✓
Valve2 Open	Solenoid valve V2 of a hygiene flush unit is open.	Binary Value COV	109	R	✓	-	-	-	-	-	✓
Level Sensor	Backpressure sensor of a hygiene flush unit reports backpressure.	Binary Value COV	110	R	✓	-	-	-	-	-	✓
Usage Count	Number of uses of the end device. Cumulative value since installation or after resetting to factory settings. All uses actuated by people are recorded, e.g. by the IR sensor.	Positive Integer Value [No Unit] COV (Increment: 1)	140	R	✓	-	✓	✓	✓	-	-
FlushCount	Number of flushes of the end device. Cumulative value since installation or after resetting to factory settings. All solenoid valve openings and lifter actuations are recorded. Application: for determining maintenance or cleaning intervals.	Positive Integer Value [No Unit] COV (Increment: 1)	141	R	✓	-	✓	✓	✓	-	✓

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
Flush2 Count	Number of flushes of a hygiene flush unit with solenoid valve V2. Cumulative value since installation or after resetting to factory settings. All solenoid valve openings are detected. Application: for determining maintenance or cleaning intervals.	Positive Integer Value [No Unit] COV (Increment: 1)	142	R	✓	-	-	-	-	-	✓
Automatic FlushCount	Number of automatic flushes of a WC. Cumulative value since installation or after resetting to factory settings. All automatic lifter actuations are recorded.	Positive Integer Value [No Unit] COV (Increment: 1)	143	R	✓	-	-	✓	-	-	-
Manual FlushCount	Number of manual flushes of a WC. Cumulative value since installation or after resetting to factory settings. All manual lifter actuations are recorded.	Positive Integer Value [No Unit] COV (Increment: 1)	144	R	✓	-	-	✓	-	-	-
Full FlushCount	Number of full flushes of a WC. Cumulative value since installation or after resetting to factory settings. All lifter actuations of the full flush are recorded.	Positive Integer Value [No Unit] COV (Increment: 1)	145	R	✓	-	-	✓	-	-	-
Partial FlushCount	Number of partial flushes of a WC. Cumulative value since installation or after resetting to factory settings. All lifter actuations of the partial flush are recorded.	Positive Integer Value [No Unit] COV (Increment: 1)	146	R	✓	-	-	✓	-	-	-
Hygiene FlushCount	Number of flushes of an end device actuated by device-internal flushing programmes. Cumulative value since installation or after resetting to factory settings. All interval, time and temperature flushes are recorded. Application: for monitoring drinking water hygiene.	Positive Integer Value [No Unit] COV (Increment: 1)	147	R	✓	-	✓	✓	✓	-	✓

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
Hygiene Flush Count2	Number of flushes of a hygiene flush unit with solenoid valve V2, actuated by internal flush programmes. Cumulative value since installation or after resetting to factory settings. All interval, time and temperature flushes are recorded. Application: for monitoring drinking water hygiene.	Positive Integer Value [No Unit] COV (Increment: 1)	148	R	✓	-	-	-	-	-	✓
Water Usage	Water consumption of the end device. Cumulative value since installation or after resetting to factory settings. For stack V1 hygiene flush units. Application for collective groups: for recording water consumption per zone or room. Application for end devices: for monitoring drinking water hygiene.	Positive Integer Value [l] (litres) COV (Increment: 1 l)	170	R	✓	-	✓	✓	✓	-	✓
Water Usage2	Water consumption of stack V2 of a hygiene flush unit. Cumulative value since installation or after resetting to factory settings. Application: for monitoring drinking water hygiene.	Positive Integer Value [l] (Liters) COV (Increment: 1 l)	171	R	✓	-	-	-	-	-	✓
Water Temperature	Current water temperature. For stack V1 hygiene flush units.	Positive Integer Value [°C] COV (Increment: 1 °C)	172	R	-	-	-	-	-	✓	✓
Water Temperature2	Current water temperature of stack V2 of a hygiene flush unit.	Positive Integer Value [°C] COV (Increment: 1 °C)	173	R	-	-	-	-	-	-	✓
WaterFlow	Current flow rate. For stack V1 hygiene flush units.	Positive Integer Value [ml/s] COV (Increment: 1 ml/s)	174	R	-	-	-	-	-	✓	✓

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
Water Flow2	Current flow rate of stack V2 of a hygiene flush unit.	Positive Integer Value [ml/s] COV Increment: 1 ml/s)	175	R	-	-	-	-	-	-	✓
Control											
Locate	Locates an end device or a Geberit Gateway. On = LED on the end device flashes red/green (Bluetooth® LED at Geberit Gateway).	Multi-state Value • Unknown • On • Off	201	W	-	✓	✓	✓	✓	✓	✓
Disable Radio	End device: Deactivates the Bluetooth® interface. If the Bluetooth® interface is deactivated, the end device can only be accessed via GEBUS. Not possible for end devices that are assigned via Bluetooth® to the Geberit Gateway. Geberit Gateway: Deactivates all radio interfaces. If the radio interfaces are deactivated, the Geberit Gateway can only be accessed via LAN.	Multi-state Value • False • True • Indeterminate (only for collective groups) COV	202	R/W	✓	✓	✓	✓	✓	-	✓

6 / 8

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
Drain Volume	<p>Opens the solenoid valve of the end device until the specified water volume is reached.</p> <p>For stack V1 hygiene flush units. Minimum and maximum water volumes are defined per end device.</p> <p>The solenoid valve can be closed prematurely by sending a new command with the water volume = 0 l.</p> <p>If the command cannot be executed, an entry is created in the event log in the end device.</p> <p>Read the value: 1 = Valve open 0 = Valve closed</p> <p>For hygiene flushes, it is recommended to switch the local flush programmes off in the Geberit Control app. Flushing processes that are otherwise undesired can be actuated because the hygiene flush unit processes all flush actuations equally.</p> <p>Application: for drinking water hygiene.</p>	Positive Integer Value [l] (Liters)	203	R/W	-	-	✓	✓	✓	-	✓
Drain Volume2	<p>Opens solenoid valve V2 of a hygiene flush unit until the specified water volume is reached.</p> <p>Further details as above.</p>	Positive Integer Value [l] (Liters)	204	R/W	-	-	-	-	-	-	✓
Flush	<p>Actuates a flushing process on the end device.</p> <p>For WCs, a full flush is actuated; for urinals, a flush with the FlushTime.</p>	Binary Value	205	W	-	-	-	✓	✓	-	-
FlushTime	<p>Determines the flush time for urinal flushes.</p> <p>If, in the case of collective groups, the values of the individual end devices are different, 4294967295 ($2^{32}-1$) is output.</p>	Positive Integer Value [s] (Seconds)	206	R/W	✓	-	-	-	✓	-	-

7 / 8

Object Name	Description	Object Type [Unit]	Object Number	R/W	Group	GW	WT	WC	UR	SE	HS
Cleaning	Activates and deactivates cleaning mode. Cleaning mode switches off again automatically. Application: Use the key switch to activate the cleaning mode for all end devices in the room.	Multi-state Value • Inactive • Active • Indeterminate (only for collective groups) COV	207	R/W	✓	–	✓	✓	✓	–	–

8 / 8

R	Read
W	Write
R/W	Read/Write
COV	Value is sent automatically in case of changes (change of value)
Group ✓	Object can be used in collective groups
GW ✓	Object applies to Geberit Gateway
WT ✓	Object applies to washbasin taps
WC ✓	Object applies to WC flush controls
UR ✓	Object applies to urinals and urinal flush controls
SE ✓	Object applies to GEBUS sensors
HS ✓	Object applies to hygiene flushes and hygiene flushes in concealed cisterns

9.4 EDE file for practical example 1

PROJECT_NAME: Sample EDE file for reference installation.
 VERSION_OF_REFERENCEFILE: 27
 TIMESTAMP_OF_LAST_CHANGE: 30.03.2023 12:47
 AUTHOR_OF_LAST_CHANGE: John Smith
 VERSION_OF_LAYOUT: 2.3

#mandatory	mandator	mandatory	mandatory	mandatory	optional
# keyname	device obj- instance	object-name	object-type	object-instance	description
	1234	WC Vorraum Herren	8	1234	BACnet Interface of Geberit products to be connected to a Building Management System
	1234	Gateway	29	0	Gateway
	1234	Gateway.DeviceSerial	40	1	Serial number of the gateway
	1234	BACstac-NPO-1	56	1	
	1234	Gateway.ZoneName	40	2	Name of the zone/room the gateway is assigned to
	1234	Gateway.GenericInfo	5	102	The gateway has an info
	1234	Gateway.GenericWarning	5	103	The gateway has a warning
	1234	Gateway.GenericError	5	104	The gateway has an error
	1234	Gateway.UsageActive	5	107	Pairing button on gateway is currently pressed
	1234	Gateway.Locate	19	201	Used to locate the gateway (writable)
	1234	Gateway.DisableRadio	19	202	Used to switch on and off the radio interfaces in gateway (writable)
	1234	Zone.1.AllDevices	29	186000	Collection group for all devices
	1234	Zone.1.AllDevices.ZoneName	40	186002	Name of the zone/room the device is assigned to
	1234	Zone.1.AllDevices.ConnectionStatus	19	186101	State of the connection between gateway and device (Collection group)
	1234	Zone.1.AllDevices.GenericWarning	5	186103	The device has a warning (Collection group)
	1234	Zone.1.AllDevices.GenericError	5	186104	The device has an error (Collection group)
	1234	Zone.1.AllDevices.LowBattery	5	186106	Battery in the device is low (Collection group)
	1234	Zone.1.AllDevices.UsageActive	5	186107	Device is currently in use (Collection group)
	1234	Zone.1.AllDevices.ValveOpen	5	186108	Valve in the device is currently opened (Collection group)
	1234	Zone.1.AllDevices.UsageCount	48	186140	Counts the usages of the device (Collection group)
	1234	Zone.1.AllDevices.FlushCount	48	186141	Counts the flushes of the device (Collection group)
	1234	Zone.1.AllDevices.HygieneFlushCount	48	186147	Counts the flushes based on local hygiene programs of the device (Collection group)
	1234	Zone.1.AllDevices.WaterUsage	48	186170	Indicates the water usage of the device (Collection group)
	1234	Zone.1.AllDevices.Cleaning	19	186207	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
	1234	Zone.1.AllWashbasins	29	223200	Collection group for all washbasins
	1234	Zone.1.AllWashbasins.ZoneName	40	223202	Name of the zone/room the device is assigned to
	1234	Zone.1.AllWashbasins.ConnectionStatus	19	223301	State of the connection between gateway and device (Collection group)
	1234	Zone.1.AllWashbasins.GenericWarning	5	223303	The device has a warning (Collection group)
	1234	Zone.1.AllWashbasins.GenericError	5	223304	The device has an error (Collection group)
	1234	Zone.1.AllWashbasins.LowBattery	5	223306	Battery in the device is low (Collection group)
	1234	Zone.1.AllWashbasins.UsageActive	5	223307	Device is currently in use (Collection group)
	1234	Zone.1.AllWashbasins.ValveOpen	5	223308	Valve in the device is currently opened (Collection group)
	1234	Zone.1.AllWashbasins.UsageCount	48	223340	Counts the usages of the device (Collection group)
	1234	Zone.1.AllWashbasins.FlushCount	48	223341	Counts the flushes of the device (Collection group)
	1234	Zone.1.AllWashbasins.HygieneFlushCount	48	223347	Counts the flushes based on local hygiene programs of the device (Collection group)
	1234	Zone.1.AllWashbasins.WaterUsage	48	223370	Indicates the water usage of the device (Collection group)
	1234	Zone.1.AllWashbasins.Cleaning	19	223407	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
	1234	Zone.1.Washbasin.1	29	223600	Lavatory Tap IFP
	1234	Zone.1.Washbasin.1.DeviceSerial	40	223601	Serial number of the device
	1234	Zone.1.Washbasin.1.ZoneName	40	223602	Name of the zone/room the device is assigned to
	1234	Zone.1.Washbasin.1.ConnectionStatus	19	223701	State of the connection between gateway and device
	1234	Zone.1.Washbasin.1.GenericWarning	5	223703	The device has a warning
	1234	Zone.1.Washbasin.1.GenericError	5	223704	The device has an error
	1234	Zone.1.Washbasin.1.LowBattery	5	223706	Battery in the device is low
	1234	Zone.1.Washbasin.1.UsageActive	5	223707	Device is currently in use
	1234	Zone.1.Washbasin.1.ValveOpen	5	223708	Valve in the device is currently opened
	1234	Zone.1.Washbasin.1.UsageCount	48	223740	Counts the usages of the device
	1234	Zone.1.Washbasin.1.FlushCount	48	223741	Counts the flushes of the device
	1234	Zone.1.Washbasin.1.HygieneFlushCount	48	223747	Counts the flushes based on local hygiene programs of the device
	1234	Zone.1.Washbasin.1.WaterUsage	48	223770	Indicates the water usage of the device
	1234	Zone.1.Washbasin.1.Locate	19	223801	Used to locate the device (writable)
	1234	Zone.1.Washbasin.1.DrainVolume	48	223803	Used to open the valve of the device for a requested amount of water (writable)
	1234	Zone.1.Washbasin.1.Cleaning	19	223807	Used to switch on and off the cleaning mode of the device (writable)
	1234	Zone.1.Washbasin.2	29	224000	Lavatory Tap IFP
	1234	Zone.1.Washbasin.2.DeviceSerial	40	224001	Serial number of the device
	1234	Zone.1.Washbasin.2.ZoneName	40	224002	Name of the zone/room the device is assigned to
	1234	Zone.1.Washbasin.2.ConnectionStatus	19	224101	State of the connection between gateway and device
	1234	Zone.1.Washbasin.2.GenericWarning	5	224103	The device has a warning
	1234	Zone.1.Washbasin.2.GenericError	5	224104	The device has an error
	1234	Zone.1.Washbasin.2.LowBattery	5	224106	Battery in the device is low
	1234	Zone.1.Washbasin.2.UsageActive	5	224107	Device is currently in use
	1234	Zone.1.Washbasin.2.ValveOpen	5	224108	Valve in the device is currently opened
	1234	Zone.1.Washbasin.2.UsageCount	48	224140	Counts the usages of the device
	1234	Zone.1.Washbasin.2.FlushCount	48	224141	Counts the flushes of the device
	1234	Zone.1.Washbasin.2.HygieneFlushCount	48	224147	Counts the flushes based on local hygiene programs of the device
	1234	Zone.1.Washbasin.2.WaterUsage	48	224170	Indicates the water usage of the device
	1234	Zone.1.Washbasin.2.Locate	19	224201	Used to locate the device (writable)
	1234	Zone.1.Washbasin.2.DrainVolume	48	224203	Used to open the valve of the device for a requested amount of water (writable)
	1234	Zone.1.Washbasin.2.Cleaning	19	224207	Used to switch on and off the cleaning mode of the device (writable)
	1234	Zone.1.Washbasin.3	29	224400	Lavatory Tap IFP
	1234	Zone.1.Washbasin.3.DeviceSerial	40	224401	Serial number of the device
	1234	Zone.1.Washbasin.3.ZoneName	40	224402	Name of the zone/room the device is assigned to
	1234	Zone.1.Washbasin.3.ConnectionStatus	19	224501	State of the connection between gateway and device
	1234	Zone.1.Washbasin.3.GenericWarning	5	224503	The device has a warning
	1234	Zone.1.Washbasin.3.GenericError	5	224504	The device has an error
	1234	Zone.1.Washbasin.3.LowBattery	5	224506	Battery in the device is low
	1234	Zone.1.Washbasin.3.UsageActive	5	224507	Device is currently in use
	1234	Zone.1.Washbasin.3.ValveOpen	5	224508	Valve in the device is currently opened
	1234	Zone.1.Washbasin.3.UsageCount	48	224540	Counts the usages of the device
	1234	Zone.1.Washbasin.3.FlushCount	48	224541	Counts the flushes of the device
	1234	Zone.1.Washbasin.3.HygieneFlushCount	48	224547	Counts the flushes based on local hygiene programs of the device
	1234	Zone.1.Washbasin.3.WaterUsage	48	224570	Indicates the water usage of the device
	1234	Zone.1.Washbasin.3.Locate	19	224601	Used to locate the device (writable)
	1234	Zone.1.Washbasin.3.DrainVolume	48	224603	Used to open the valve of the device for a requested amount of water (writable)
	1234	Zone.1.Washbasin.3.Cleaning	19	224607	Used to switch on and off the cleaning mode of the device (writable)
	1234	Zone.1.Washbasin.4	29	224800	Lavatory Tap IFP
	1234	Zone.1.Washbasin.4.DeviceSerial	40	224801	Serial number of the device
	1234	Zone.1.Washbasin.4.ZoneName	40	224802	Name of the zone/room the device is assigned to
	1234	Zone.1.Washbasin.4.ConnectionStatus	19	224901	State of the connection between gateway and device
	1234	Zone.1.Washbasin.4.GenericWarning	5	224903	The device has a warning
	1234	Zone.1.Washbasin.4.GenericError	5	224904	The device has an error
	1234	Zone.1.Washbasin.4.LowBattery	5	224906	Battery in the device is low
	1234	Zone.1.Washbasin.4.UsageActive	5	224907	Device is currently in use
	1234	Zone.1.Washbasin.4.ValveOpen	5	224908	Valve in the device is currently opened
	1234	Zone.1.Washbasin.4.UsageCount	48	224940	Counts the usages of the device

PositiveIntegerValue:224941	1234	Zone.1.Washbasin.4.FlushCount	48	224941	Counts the flushes of the device
PositiveIntegerValue:224947	1234	Zone.1.Washbasin.4.HygieneFlushCount	48	224947	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:224970	1234	Zone.1.Washbasin.4.WaterUsage	48	224970	Indicates the water usage of the device
MultiStateValue:225001	1234	Zone.1.Washbasin.4.Locate	19	225001	Used to locate the device (writable)
PositiveIntegerValue:225003	1234	Zone.1.Washbasin.4.DrainVolume	48	225003	Used to open the valve of the device for a requested amount of water (writable)
MultiStateValue:225007	1234	Zone.1.Washbasin.4.Cleaning	19	225007	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:372000	1234	Zone.2.AllDevices	29	372000	Collection group for all devices
CharStringValue:372002	1234	Zone.2.AllDevices.ZoneName	40	372002	Name of the zone/room the device is assigned to
MultiStateValue:372101	1234	Zone.2.AllDevices.ConnectionStatus	19	372101	State of the connection between gateway and device (Collection group)
BinaryValue:372103	1234	Zone.2.AllDevices.GenericWarning	5	372103	The device has a warning (Collection group)
BinaryValue:372104	1234	Zone.2.AllDevices.GenericError	5	372104	The device has an error (Collection group)
BinaryValue:372106	1234	Zone.2.AllDevices.LowBattery	5	372106	Battery in the device is low (Collection group)
BinaryValue:372107	1234	Zone.2.AllDevices.UsageActive	5	372107	Device is currently in use (Collection group)
BinaryValue:372108	1234	Zone.2.AllDevices.ValveOpen	5	372108	Valve in the device is currently opened (Collection group)
PositiveIntegerValue:372140	1234	Zone.2.AllDevices.UsageCount	48	372140	Counts the usages of the device (Collection group)
PositiveIntegerValue:372141	1234	Zone.2.AllDevices.FlushCount	48	372141	Counts the flushes of the device (Collection group)
PositiveIntegerValue:372143	1234	Zone.2.AllDevices.AutomaticFlushCount	48	372143	Counts the automatic flushes of the device (Collection group)
PositiveIntegerValue:372144	1234	Zone.2.AllDevices.ManualFlushCount	48	372144	Counts the manual flushes of the device (Collection group)
PositiveIntegerValue:372145	1234	Zone.2.AllDevices.FullFlushCount	48	372145	Counts the full flushes of the device (Collection group)
PositiveIntegerValue:372146	1234	Zone.2.AllDevices.PartialFlushCount	48	372146	Counts the partial flushes of the device (Collection group)
PositiveIntegerValue:372147	1234	Zone.2.AllDevices.HygieneFlushCount	48	372147	Counts the flushes based on local hygiene programs of the device (Collection group)
PositiveIntegerValue:372170	1234	Zone.2.AllDevices.WaterUsage	48	372170	Indicates the water usage of the device (Collection group)
PositiveIntegerValue:372206	1234	Zone.2.AllDevices.FlushTime	48	372206	Used to adjust the flush time for an urinal (writable) (Collection group)
MultiStateValue:372207	1234	Zone.2.AllDevices.Cleaning	19	372207	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
StructuredView:384400	1234	Zone.2.AllToilets	29	384400	Collection group for all toilets
CharStringValue:384402	1234	Zone.2.AllToilets.ZoneName	40	384402	Name of the zone/room the device is assigned to
MultiStateValue:384501	1234	Zone.2.AllToilets.ConnectionStatus	19	384501	State of the connection between gateway and device (Collection group)
BinaryValue:384503	1234	Zone.2.AllToilets.GenericWarning	5	384503	The device has a warning (Collection group)
BinaryValue:384504	1234	Zone.2.AllToilets.GenericError	5	384504	The device has an error (Collection group)
BinaryValue:384506	1234	Zone.2.AllToilets.LowBattery	5	384506	Battery in the device is low (Collection group)
BinaryValue:384507	1234	Zone.2.AllToilets.UsageActive	5	384507	Device is currently in use (Collection group)
BinaryValue:384508	1234	Zone.2.AllToilets.ValveOpen	5	384508	Valve in the device is currently opened (Collection group)
PositiveIntegerValue:384540	1234	Zone.2.AllToilets.UsageCount	48	384540	Counts the usages of the device (Collection group)
PositiveIntegerValue:384541	1234	Zone.2.AllToilets.FlushCount	48	384541	Counts the flushes of the device (Collection group)
PositiveIntegerValue:384543	1234	Zone.2.AllToilets.AutomaticFlushCount	48	384543	Counts the automatic flushes of the device (Collection group)
PositiveIntegerValue:384544	1234	Zone.2.AllToilets.ManualFlushCount	48	384544	Counts the manual flushes of the device (Collection group)
PositiveIntegerValue:384545	1234	Zone.2.AllToilets.FullFlushCount	48	384545	Counts the full flushes of the device (Collection group)
PositiveIntegerValue:384546	1234	Zone.2.AllToilets.PartialFlushCount	48	384546	Counts the partial flushes of the device (Collection group)
PositiveIntegerValue:384547	1234	Zone.2.AllToilets.HygieneFlushCount	48	384547	Counts the flushes based on local hygiene programs of the device (Collection group)
PositiveIntegerValue:384570	1234	Zone.2.AllToilets.WaterUsage	48	384570	Indicates the water usage of the device (Collection group)
MultiStateValue:384607	1234	Zone.2.AllToilets.Cleaning	19	384607	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
StructuredView:384800	1234	Zone.2.Toilet.1	29	384800	WFlush Automatic Mains
CharStringValue:384801	1234	Zone.2.Toilet.1.DeviceSerial	40	384801	Serial number of the device
CharStringValue:384802	1234	Zone.2.Toilet.1.ZoneName	40	384802	Name of the zone/room the device is assigned to
MultiStateValue:384901	1234	Zone.2.Toilet.1.ConnectionStatus	19	384901	State of the connection between gateway and device
BinaryValue:384903	1234	Zone.2.Toilet.1.GenericWarning	5	384903	The device has a warning
BinaryValue:384904	1234	Zone.2.Toilet.1.GenericError	5	384904	The device has an error
BinaryValue:384906	1234	Zone.2.Toilet.1.LowBattery	5	384906	Battery in the device is low
BinaryValue:384907	1234	Zone.2.Toilet.1.UsageActive	5	384907	Device is currently in use
BinaryValue:384908	1234	Zone.2.Toilet.1.ValveOpen	5	384908	Valve in the device is currently opened
PositiveIntegerValue:384940	1234	Zone.2.Toilet.1.UsageCount	48	384940	Counts the usages of the device
PositiveIntegerValue:384941	1234	Zone.2.Toilet.1.FlushCount	48	384941	Counts the flushes of the device
PositiveIntegerValue:384943	1234	Zone.2.Toilet.1.AutomaticFlushCount	48	384943	Counts the automatic flushes of the device
PositiveIntegerValue:384944	1234	Zone.2.Toilet.1.ManualFlushCount	48	384944	Counts the manual flushes of the device
PositiveIntegerValue:384945	1234	Zone.2.Toilet.1.FullFlushCount	48	384945	Counts the full flushes of the device
PositiveIntegerValue:384946	1234	Zone.2.Toilet.1.PartialFlushCount	48	384946	Counts the partial flushes of the device
PositiveIntegerValue:384947	1234	Zone.2.Toilet.1.HygieneFlushCount	48	384947	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:384970	1234	Zone.2.Toilet.1.WaterUsage	48	384970	Indicates the water usage of the device
MultiStateValue:385001	1234	Zone.2.Toilet.1.Locate	19	385001	Used to locate the device (writable)
PositiveIntegerValue:385003	1234	Zone.2.Toilet.1.DrainVolume	48	385003	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:385005	1234	Zone.2.Toilet.1.Flush	5	385005	Used to trigger a single flush at the device (writable)
MultiStateValue:385007	1234	Zone.2.Toilet.1.Cleaning	19	385007	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:385200	1234	Zone.2.Toilet.2	29	385200	WFlush Automatic Mains
CharStringValue:385201	1234	Zone.2.Toilet.2.DeviceSerial	40	385201	Serial number of the device
CharStringValue:385202	1234	Zone.2.Toilet.2.ZoneName	40	385202	Name of the zone/room the device is assigned to
MultiStateValue:385301	1234	Zone.2.Toilet.2.ConnectionStatus	19	385301	State of the connection between gateway and device
BinaryValue:385303	1234	Zone.2.Toilet.2.GenericWarning	5	385303	The device has a warning
BinaryValue:385304	1234	Zone.2.Toilet.2.GenericError	5	385304	The device has an error
BinaryValue:385306	1234	Zone.2.Toilet.2.LowBattery	5	385306	Battery in the device is low
BinaryValue:385307	1234	Zone.2.Toilet.2.UsageActive	5	385307	Device is currently in use
BinaryValue:385308	1234	Zone.2.Toilet.2.ValveOpen	5	385308	Valve in the device is currently opened
PositiveIntegerValue:385340	1234	Zone.2.Toilet.2.UsageCount	48	385340	Counts the usages of the device
PositiveIntegerValue:385341	1234	Zone.2.Toilet.2.FlushCount	48	385341	Counts the flushes of the device
PositiveIntegerValue:385343	1234	Zone.2.Toilet.2.AutomaticFlushCount	48	385343	Counts the automatic flushes of the device
PositiveIntegerValue:385344	1234	Zone.2.Toilet.2.ManualFlushCount	48	385344	Counts the manual flushes of the device
PositiveIntegerValue:385345	1234	Zone.2.Toilet.2.FullFlushCount	48	385345	Counts the full flushes of the device
PositiveIntegerValue:385346	1234	Zone.2.Toilet.2.PartialFlushCount	48	385346	Counts the partial flushes of the device
PositiveIntegerValue:385347	1234	Zone.2.Toilet.2.HygieneFlushCount	48	385347	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:385370	1234	Zone.2.Toilet.2.WaterUsage	48	385370	Indicates the water usage of the device
MultiStateValue:385401	1234	Zone.2.Toilet.2.Locate	19	385401	Used to locate the device (writable)
PositiveIntegerValue:385403	1234	Zone.2.Toilet.2.DrainVolume	48	385403	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:385405	1234	Zone.2.Toilet.2.Flush	5	385405	Used to trigger a single flush at the device (writable)
MultiStateValue:385407	1234	Zone.2.Toilet.2.Cleaning	19	385407	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:385600	1234	Zone.2.Toilet.3	29	385600	WFlush Automatic Mains
CharStringValue:385601	1234	Zone.2.Toilet.3.DeviceSerial	40	385601	Serial number of the device
CharStringValue:385602	1234	Zone.2.Toilet.3.ZoneName	40	385602	Name of the zone/room the device is assigned to
MultiStateValue:385701	1234	Zone.2.Toilet.3.ConnectionStatus	19	385701	State of the connection between gateway and device
BinaryValue:385703	1234	Zone.2.Toilet.3.GenericWarning	5	385703	The device has a warning
BinaryValue:385704	1234	Zone.2.Toilet.3.GenericError	5	385704	The device has an error
BinaryValue:385706	1234	Zone.2.Toilet.3.LowBattery	5	385706	Battery in the device is low
BinaryValue:385707	1234	Zone.2.Toilet.3.UsageActive	5	385707	Device is currently in use
BinaryValue:385708	1234	Zone.2.Toilet.3.ValveOpen	5	385708	Valve in the device is currently opened
PositiveIntegerValue:385740	1234	Zone.2.Toilet.3.UsageCount	48	385740	Counts the usages of the device
PositiveIntegerValue:385741	1234	Zone.2.Toilet.3.FlushCount	48	385741	Counts the flushes of the device
PositiveIntegerValue:385743	1234	Zone.2.Toilet.3.AutomaticFlushCount	48	385743	Counts the automatic flushes of the device
PositiveIntegerValue:385744	1234	Zone.2.Toilet.3.ManualFlushCount	48	385744	Counts the manual flushes of the device
PositiveIntegerValue:385745	1234	Zone.2.Toilet.3.FullFlushCount	48	385745	Counts the full flushes of the device
PositiveIntegerValue:385746	1234	Zone.2.Toilet.3.PartialFlushCount	48	385746	Counts the partial flushes of the device
PositiveIntegerValue:385747	1234	Zone.2.Toilet.3.HygieneFlushCount	48	385747	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:385770	1234	Zone.2.Toilet.3.WaterUsage	48	385770	Indicates the water usage of the device
MultiStateValue:385801	1234	Zone.2.Toilet.3.Locate	19	385801	Used to locate the device (writable)
PositiveIntegerValue:385803	1234	Zone.2.Toilet.3.DrainVolume	48	385803	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:385805	1234	Zone.2.Toilet.3.Flush	5	385805	Used to trigger a single flush at the device (writable)
MultiStateValue:385807	1234	Zone.2.Toilet.3.Cleaning	19	385807	Used to switch on and off the cleaning mode of the device (writable)

StructuredView:396800	1234	Zone.2.AllUrinals	29	396800	Collection group for all urinals
CharStringValue:396802	1234	Zone.2.AllUrinals.ZoneName	40	396802	Name of the zone/room the device is assigned to
MultiStateValue:396901	1234	Zone.2.AllUrinals.ConnectionStatus	19	396901	State of the connection between gateway and device (Collection group)
BinaryValue:396903	1234	Zone.2.AllUrinals.GenericWarning	5	396903	The device has a warning (Collection group)
BinaryValue:396904	1234	Zone.2.AllUrinals.GenericError	5	396904	The device has an error (Collection group)
BinaryValue:396906	1234	Zone.2.AllUrinals.LowBattery	5	396906	Battery in the device is low (Collection group)
BinaryValue:396907	1234	Zone.2.AllUrinals.UsageActive	5	396907	Device is currently in use (Collection group)
BinaryValue:396908	1234	Zone.2.AllUrinals.ValveOpen	5	396908	Valve in the device is currently opened (Collection group)
PositiveIntegerValue:396940	1234	Zone.2.AllUrinals.UsageCount	48	396940	Counts the usages of the device (Collection group)
PositiveIntegerValue:396941	1234	Zone.2.AllUrinals.FlushCount	48	396941	Counts the flushes of the device (Collection group)
PositiveIntegerValue:396947	1234	Zone.2.AllUrinals.HygieneFlushCount	48	396947	Counts the flushes based on local hygiene programs of the device (Collection group)
PositiveIntegerValue:396970	1234	Zone.2.AllUrinals.WaterUsage	48	396970	Indicates the water usage of the device (Collection group)
PositiveIntegerValue:397006	1234	Zone.2.AllUrinals.FlushTime	48	397006	Used to adjust the flush time for an urinal (writable) (Collection group)
MultiStateValue:397007	1234	Zone.2.AllUrinals.Cleaning	19	397007	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
StructuredView:397200	1234	Zone.2.Urinal.1	29	397200	Urinal IR Control
CharStringValue:397201	1234	Zone.2.Urinal.1.DeviceSerial	40	397201	Serial number of the device
CharStringValue:397202	1234	Zone.2.Urinal.1.ZoneName	40	397202	Name of the zone/room the device is assigned to
MultiStateValue:397301	1234	Zone.2.Urinal.1.ConnectionStatus	19	397301	State of the connection between gateway and device
BinaryValue:397303	1234	Zone.2.Urinal.1.GenericWarning	5	397303	The device has a warning
BinaryValue:397304	1234	Zone.2.Urinal.1.GenericError	5	397304	The device has an error
BinaryValue:397306	1234	Zone.2.Urinal.1.LowBattery	5	397306	Battery in the device is low
BinaryValue:397307	1234	Zone.2.Urinal.1.UsageActive	5	397307	Device is currently in use
BinaryValue:397308	1234	Zone.2.Urinal.1.ValveOpen	5	397308	Valve in the device is currently opened
PositiveIntegerValue:397340	1234	Zone.2.Urinal.1.UsageCount	48	397340	Counts the usages of the device
PositiveIntegerValue:397341	1234	Zone.2.Urinal.1.FlushCount	48	397341	Counts the flushes of the device
PositiveIntegerValue:397347	1234	Zone.2.Urinal.1.HygieneFlushCount	48	397347	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:397370	1234	Zone.2.Urinal.1.WaterUsage	48	397370	Indicates the water usage of the device
MultiStateValue:397401	1234	Zone.2.Urinal.1.Locate	19	397401	Used to locate the device (writable)
PositiveIntegerValue:397403	1234	Zone.2.Urinal.1.DrainVolume	48	397403	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:397405	1234	Zone.2.Urinal.1.Flush	5	397405	Used to trigger a single flush at the device (writable)
PositiveIntegerValue:397406	1234	Zone.2.Urinal.1.FlushTime	48	397406	Used to adjust the flush time for an urinal (writable)
MultiStateValue:397407	1234	Zone.2.Urinal.1.Cleaning	19	397407	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:397600	1234	Zone.2.Urinal.2	29	397600	Urinal IR Control
CharStringValue:397601	1234	Zone.2.Urinal.2.DeviceSerial	40	397601	Serial number of the device
CharStringValue:397602	1234	Zone.2.Urinal.2.ZoneName	40	397602	Name of the zone/room the device is assigned to
MultiStateValue:397701	1234	Zone.2.Urinal.2.ConnectionStatus	19	397701	State of the connection between gateway and device
BinaryValue:397703	1234	Zone.2.Urinal.2.GenericWarning	5	397703	The device has a warning
BinaryValue:397704	1234	Zone.2.Urinal.2.GenericError	5	397704	The device has an error
BinaryValue:397706	1234	Zone.2.Urinal.2.LowBattery	5	397706	Battery in the device is low
BinaryValue:397707	1234	Zone.2.Urinal.2.UsageActive	5	397707	Device is currently in use
BinaryValue:397708	1234	Zone.2.Urinal.2.ValveOpen	5	397708	Valve in the device is currently opened
PositiveIntegerValue:397740	1234	Zone.2.Urinal.2.UsageCount	48	397740	Counts the usages of the device
PositiveIntegerValue:397741	1234	Zone.2.Urinal.2.FlushCount	48	397741	Counts the flushes of the device
PositiveIntegerValue:397747	1234	Zone.2.Urinal.2.HygieneFlushCount	48	397747	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:397770	1234	Zone.2.Urinal.2.WaterUsage	48	397770	Indicates the water usage of the device
MultiStateValue:397801	1234	Zone.2.Urinal.2.Locate	19	397801	Used to locate the device (writable)
PositiveIntegerValue:397803	1234	Zone.2.Urinal.2.DrainVolume	48	397803	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:397805	1234	Zone.2.Urinal.2.Flush	5	397805	Used to trigger a single flush at the device (writable)
PositiveIntegerValue:397806	1234	Zone.2.Urinal.2.FlushTime	48	397806	Used to adjust the flush time for an urinal (writable)
MultiStateValue:397807	1234	Zone.2.Urinal.2.Cleaning	19	397807	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:398000	1234	Zone.2.Urinal.3	29	398000	Urinal IR Control
CharStringValue:398001	1234	Zone.2.Urinal.3.DeviceSerial	40	398001	Serial number of the device
CharStringValue:398002	1234	Zone.2.Urinal.3.ZoneName	40	398002	Name of the zone/room the device is assigned to
MultiStateValue:398101	1234	Zone.2.Urinal.3.ConnectionStatus	19	398101	State of the connection between gateway and device
BinaryValue:398103	1234	Zone.2.Urinal.3.GenericWarning	5	398103	The device has a warning
BinaryValue:398104	1234	Zone.2.Urinal.3.GenericError	5	398104	The device has an error
BinaryValue:398106	1234	Zone.2.Urinal.3.LowBattery	5	398106	Battery in the device is low
BinaryValue:398107	1234	Zone.2.Urinal.3.UsageActive	5	398107	Device is currently in use
BinaryValue:398108	1234	Zone.2.Urinal.3.ValveOpen	5	398108	Valve in the device is currently opened
PositiveIntegerValue:398140	1234	Zone.2.Urinal.3.UsageCount	48	398140	Counts the usages of the device
PositiveIntegerValue:398147	1234	Zone.2.Urinal.3.FlushCount	48	398147	Counts the flushes of the device
PositiveIntegerValue:398147	1234	Zone.2.Urinal.3.HygieneFlushCount	48	398147	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:398170	1234	Zone.2.Urinal.3.WaterUsage	48	398170	Indicates the water usage of the device
MultiStateValue:398201	1234	Zone.2.Urinal.3.Locate	19	398201	Used to locate the device (writable)
PositiveIntegerValue:398203	1234	Zone.2.Urinal.3.DrainVolume	48	398203	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:398205	1234	Zone.2.Urinal.3.Flush	5	398205	Used to trigger a single flush at the device (writable)
PositiveIntegerValue:398206	1234	Zone.2.Urinal.3.FlushTime	48	398206	Used to adjust the flush time for an urinal (writable)
MultiStateValue:398207	1234	Zone.2.Urinal.3.Cleaning	19	398207	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:398400	1234	Zone.2.Urinal.4	29	398400	Urinal IR Control
CharStringValue:398401	1234	Zone.2.Urinal.4.DeviceSerial	40	398401	Serial number of the device
CharStringValue:398402	1234	Zone.2.Urinal.4.ZoneName	40	398402	Name of the zone/room the device is assigned to
MultiStateValue:398501	1234	Zone.2.Urinal.4.ConnectionStatus	19	398501	State of the connection between gateway and device
BinaryValue:398503	1234	Zone.2.Urinal.4.GenericWarning	5	398503	The device has a warning
BinaryValue:398504	1234	Zone.2.Urinal.4.GenericError	5	398504	The device has an error
BinaryValue:398506	1234	Zone.2.Urinal.4.LowBattery	5	398506	Battery in the device is low
BinaryValue:398507	1234	Zone.2.Urinal.4.UsageActive	5	398507	Device is currently in use
BinaryValue:398508	1234	Zone.2.Urinal.4.ValveOpen	5	398508	Valve in the device is currently opened
PositiveIntegerValue:398540	1234	Zone.2.Urinal.4.UsageCount	48	398540	Counts the usages of the device
PositiveIntegerValue:398541	1234	Zone.2.Urinal.4.FlushCount	48	398541	Counts the flushes of the device
PositiveIntegerValue:398547	1234	Zone.2.Urinal.4.HygieneFlushCount	48	398547	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:398570	1234	Zone.2.Urinal.4.WaterUsage	48	398570	Indicates the water usage of the device
MultiStateValue:398601	1234	Zone.2.Urinal.4.Locate	19	398601	Used to locate the device (writable)
PositiveIntegerValue:398603	1234	Zone.2.Urinal.4.DrainVolume	48	398603	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:398605	1234	Zone.2.Urinal.4.Flush	5	398605	Used to trigger a single flush at the device (writable)
PositiveIntegerValue:398606	1234	Zone.2.Urinal.4.FlushTime	48	398606	Used to adjust the flush time for an urinal (writable)
MultiStateValue:398607	1234	Zone.2.Urinal.4.Cleaning	19	398607	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:398800	1234	Zone.2.Urinal.5	29	398800	Urinal IR Control
CharStringValue:398801	1234	Zone.2.Urinal.5.DeviceSerial	40	398801	Serial number of the device
CharStringValue:398802	1234	Zone.2.Urinal.5.ZoneName	40	398802	Name of the zone/room the device is assigned to
MultiStateValue:398901	1234	Zone.2.Urinal.5.ConnectionStatus	19	398901	State of the connection between gateway and device
BinaryValue:398903	1234	Zone.2.Urinal.5.GenericWarning	5	398903	The device has a warning
BinaryValue:398904	1234	Zone.2.Urinal.5.GenericError	5	398904	The device has an error
BinaryValue:398906	1234	Zone.2.Urinal.5.LowBattery	5	398906	Battery in the device is low
BinaryValue:398907	1234	Zone.2.Urinal.5.UsageActive	5	398907	Device is currently in use
BinaryValue:398908	1234	Zone.2.Urinal.5.ValveOpen	5	398908	Valve in the device is currently opened
PositiveIntegerValue:398940	1234	Zone.2.Urinal.5.UsageCount	48	398940	Counts the usages of the device
PositiveIntegerValue:398941	1234	Zone.2.Urinal.5.FlushCount	48	398941	Counts the flushes of the device
PositiveIntegerValue:398947	1234	Zone.2.Urinal.5.HygieneFlushCount	48	398947	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:398970	1234	Zone.2.Urinal.5.WaterUsage	48	398970	Indicates the water usage of the device
MultiStateValue:399001	1234	Zone.2.Urinal.5.Locate	19	399001	Used to locate the device (writable)
PositiveIntegerValue:399003	1234	Zone.2.Urinal.5.DrainVolume	48	399003	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:399005	1234	Zone.2.Urinal.5.Flush	5	399005	Used to trigger a single flush at the device (writable)
PositiveIntegerValue:399006	1234	Zone.2.Urinal.5.FlushTime	48	399006	Used to adjust the flush time for an urinal (writable)
MultiStateValue:399007	1234	Zone.2.Urinal.5.Cleaning	19	399007	Used to switch on and off the cleaning mode of the device (writable)

StructuredView:558000	1234	Zone.3.AllDevices	29	558000	Collection group for all devices
CharStringValue:558002	1234	Zone.3.AllDevices.ZoneName	40	558002	Name of the zone/room the device is assigned to
MultiStateValue:558101	1234	Zone.3.AllDevices.ConnectionStatus	19	558101	State of the connection between gateway and device (Collection group)
BinaryValue:558103	1234	Zone.3.AllDevices.GenericWarning	5	558103	The device has a warning (Collection group)
BinaryValue:558104	1234	Zone.3.AllDevices.GenericError	5	558104	The device has an error (Collection group)
BinaryValue:558106	1234	Zone.3.AllDevices.LowBattery	5	558106	Battery in the device is low (Collection group)
BinaryValue:558107	1234	Zone.3.AllDevices.UsageActive	5	558107	Device is currently in use (Collection group)
BinaryValue:558108	1234	Zone.3.AllDevices.ValveOpen	5	558108	Valve in the device is currently opened (Collection group)
PositiveIntegerValue:558140	1234	Zone.3.AllDevices.UsageCount	48	558140	Counts the usages of the device (Collection group)
PositiveIntegerValue:558141	1234	Zone.3.AllDevices.FlushCount	48	558141	Counts the flushes of the device (Collection group)
PositiveIntegerValue:558147	1234	Zone.3.AllDevices.HygieneFlushCount	48	558147	Counts the flushes based on local hygiene programs of the device (Collection group)
PositiveIntegerValue:558170	1234	Zone.3.AllDevices.WaterUsage	48	558170	Indicates the water usage of the device (Collection group)
MultiStateValue:558207	1234	Zone.3.AllDevices.Cleaning	19	558207	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
StructuredView:595200	1234	Zone.3.AllWashbasins	29	595200	Collection group for all washbasins
CharStringValue:595202	1234	Zone.3.AllWashbasins.ZoneName	40	595202	Name of the zone/room the device is assigned to
MultiStateValue:595301	1234	Zone.3.AllWashbasins.ConnectionStatus	19	595301	State of the connection between gateway and device (Collection group)
BinaryValue:595303	1234	Zone.3.AllWashbasins.GenericWarning	5	595303	The device has a warning (Collection group)
BinaryValue:595304	1234	Zone.3.AllWashbasins.GenericError	5	595304	The device has an error (Collection group)
BinaryValue:595306	1234	Zone.3.AllWashbasins.LowBattery	5	595306	Battery in the device is low (Collection group)
BinaryValue:595307	1234	Zone.3.AllWashbasins.UsageActive	5	595307	Device is currently in use (Collection group)
BinaryValue:595308	1234	Zone.3.AllWashbasins.ValveOpen	5	595308	Valve in the device is currently opened (Collection group)
PositiveIntegerValue:595340	1234	Zone.3.AllWashbasins.UsageCount	48	595340	Counts the usages of the device (Collection group)
PositiveIntegerValue:595341	1234	Zone.3.AllWashbasins.FlushCount	48	595341	Counts the flushes of the device (Collection group)
PositiveIntegerValue:595347	1234	Zone.3.AllWashbasins.HygieneFlushCount	48	595347	Counts the flushes based on local hygiene programs of the device (Collection group)
PositiveIntegerValue:595370	1234	Zone.3.AllWashbasins.WaterUsage	48	595370	Indicates the water usage of the device (Collection group)
MultiStateValue:595407	1234	Zone.3.AllWashbasins.Cleaning	19	595407	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
StructuredView:595600	1234	Zone.3.Washbasin.1	29	595600	Lavatory Tap IFP
CharStringValue:595601	1234	Zone.3.Washbasin.1.DeviceSerial	40	595601	Serial number of the device
CharStringValue:595602	1234	Zone.3.Washbasin.1.ZoneName	40	595602	Name of the zone/room the device is assigned to
MultiStateValue:595701	1234	Zone.3.Washbasin.1.ConnectionStatus	19	595701	State of the connection between gateway and device
BinaryValue:595703	1234	Zone.3.Washbasin.1.GenericWarning	5	595703	The device has a warning
BinaryValue:595704	1234	Zone.3.Washbasin.1.GenericError	5	595704	The device has an error
BinaryValue:595706	1234	Zone.3.Washbasin.1.LowBattery	5	595706	Battery in the device is low
BinaryValue:595707	1234	Zone.3.Washbasin.1.UsageActive	5	595707	Device is currently in use
BinaryValue:595708	1234	Zone.3.Washbasin.1.ValveOpen	5	595708	Valve in the device is currently opened
PositiveIntegerValue:595740	1234	Zone.3.Washbasin.1.UsageCount	48	595740	Counts the usages of the device
PositiveIntegerValue:595741	1234	Zone.3.Washbasin.1.FlushCount	48	595741	Counts the flushes of the device
PositiveIntegerValue:595747	1234	Zone.3.Washbasin.1.HygieneFlushCount	48	595747	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:595770	1234	Zone.3.Washbasin.1.WaterUsage	48	595770	Indicates the water usage of the device
MultiStateValue:595801	1234	Zone.3.Washbasin.1.Locate	19	595801	Used to locate the device (writable)
PositiveIntegerValue:595803	1234	Zone.3.Washbasin.1.DrainVolume	48	595803	Used to open the valve of the device for a requested amount of water (writable)
MultiStateValue:595807	1234	Zone.3.Washbasin.1.Cleaning	19	595807	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:596000	1234	Zone.3.Washbasin.2	29	596000	Lavatory Tap IFP
CharStringValue:596001	1234	Zone.3.Washbasin.2.DeviceSerial	40	596001	Serial number of the device
CharStringValue:596002	1234	Zone.3.Washbasin.2.ZoneName	40	596002	Name of the zone/room the device is assigned to
MultiStateValue:596101	1234	Zone.3.Washbasin.2.ConnectionStatus	19	596101	State of the connection between gateway and device
BinaryValue:596103	1234	Zone.3.Washbasin.2.GenericWarning	5	596103	The device has a warning
BinaryValue:596104	1234	Zone.3.Washbasin.2.GenericError	5	596104	The device has an error
BinaryValue:596106	1234	Zone.3.Washbasin.2.LowBattery	5	596106	Battery in the device is low
BinaryValue:596107	1234	Zone.3.Washbasin.2.UsageActive	5	596107	Device is currently in use
BinaryValue:596108	1234	Zone.3.Washbasin.2.ValveOpen	5	596108	Valve in the device is currently opened
PositiveIntegerValue:596140	1234	Zone.3.Washbasin.2.UsageCount	48	596140	Counts the usages of the device
PositiveIntegerValue:596141	1234	Zone.3.Washbasin.2.FlushCount	48	596141	Counts the flushes of the device
PositiveIntegerValue:596147	1234	Zone.3.Washbasin.2.HygieneFlushCount	48	596147	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:596170	1234	Zone.3.Washbasin.2.WaterUsage	48	596170	Indicates the water usage of the device
MultiStateValue:596201	1234	Zone.3.Washbasin.2.Locate	19	596201	Used to locate the device (writable)
PositiveIntegerValue:596203	1234	Zone.3.Washbasin.2.DrainVolume	48	596203	Used to open the valve of the device for a requested amount of water (writable)
MultiStateValue:596207	1234	Zone.3.Washbasin.2.Cleaning	19	596207	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:596400	1234	Zone.3.Washbasin.3	29	596400	Lavatory Tap IFP
CharStringValue:596401	1234	Zone.3.Washbasin.3.DeviceSerial	40	596401	Serial number of the device
CharStringValue:596402	1234	Zone.3.Washbasin.3.ZoneName	40	596402	Name of the zone/room the device is assigned to
MultiStateValue:596501	1234	Zone.3.Washbasin.3.ConnectionStatus	19	596501	State of the connection between gateway and device
BinaryValue:596503	1234	Zone.3.Washbasin.3.GenericWarning	5	596503	The device has a warning
BinaryValue:596504	1234	Zone.3.Washbasin.3.GenericError	5	596504	The device has an error
BinaryValue:596506	1234	Zone.3.Washbasin.3.LowBattery	5	596506	Battery in the device is low
BinaryValue:596507	1234	Zone.3.Washbasin.3.UsageActive	5	596507	Device is currently in use
BinaryValue:596508	1234	Zone.3.Washbasin.3.ValveOpen	5	596508	Valve in the device is currently opened
PositiveIntegerValue:596540	1234	Zone.3.Washbasin.3.UsageCount	48	596540	Counts the usages of the device
PositiveIntegerValue:596541	1234	Zone.3.Washbasin.3.FlushCount	48	596541	Counts the flushes of the device
PositiveIntegerValue:596547	1234	Zone.3.Washbasin.3.HygieneFlushCount	48	596547	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:596570	1234	Zone.3.Washbasin.3.WaterUsage	48	596570	Indicates the water usage of the device
MultiStateValue:596601	1234	Zone.3.Washbasin.3.Locate	19	596601	Used to locate the device (writable)
PositiveIntegerValue:596603	1234	Zone.3.Washbasin.3.DrainVolume	48	596603	Used to open the valve of the device for a requested amount of water (writable)
MultiStateValue:596607	1234	Zone.3.Washbasin.3.Cleaning	19	596607	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:596800	1234	Zone.3.Washbasin.4	29	596800	Lavatory Tap IFP
CharStringValue:596801	1234	Zone.3.Washbasin.4.DeviceSerial	40	596801	Serial number of the device
CharStringValue:596802	1234	Zone.3.Washbasin.4.ZoneName	40	596802	Name of the zone/room the device is assigned to
MultiStateValue:596901	1234	Zone.3.Washbasin.4.ConnectionStatus	19	596901	State of the connection between gateway and device
BinaryValue:596903	1234	Zone.3.Washbasin.4.GenericWarning	5	596903	The device has a warning
BinaryValue:596904	1234	Zone.3.Washbasin.4.GenericError	5	596904	The device has an error
BinaryValue:596906	1234	Zone.3.Washbasin.4.LowBattery	5	596906	Battery in the device is low
BinaryValue:596907	1234	Zone.3.Washbasin.4.UsageActive	5	596907	Device is currently in use
BinaryValue:596908	1234	Zone.3.Washbasin.4.ValveOpen	5	596908	Valve in the device is currently opened
PositiveIntegerValue:596940	1234	Zone.3.Washbasin.4.UsageCount	48	596940	Counts the usages of the device
PositiveIntegerValue:596941	1234	Zone.3.Washbasin.4.FlushCount	48	596941	Counts the flushes of the device
PositiveIntegerValue:596947	1234	Zone.3.Washbasin.4.HygieneFlushCount	48	596947	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:596970	1234	Zone.3.Washbasin.4.WaterUsage	48	596970	Indicates the water usage of the device
MultiStateValue:597001	1234	Zone.3.Washbasin.4.Locate	19	597001	Used to locate the device (writable)
PositiveIntegerValue:597003	1234	Zone.3.Washbasin.4.DrainVolume	48	597003	Used to open the valve of the device for a requested amount of water (writable)
MultiStateValue:597007	1234	Zone.3.Washbasin.4.Cleaning	19	597007	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:744000	1234	Zone.4.AllDevices	29	744000	Collection group for all devices
CharStringValue:744002	1234	Zone.4.AllDevices.ZoneName	40	744002	Name of the zone/room the device is assigned to
MultiStateValue:744101	1234	Zone.4.AllDevices.ConnectionStatus	19	744101	State of the connection between gateway and device (Collection group)
BinaryValue:744103	1234	Zone.4.AllDevices.GenericWarning	5	744103	The device has a warning (Collection group)
BinaryValue:744104	1234	Zone.4.AllDevices.GenericError	5	744104	The device has an error (Collection group)
BinaryValue:744106	1234	Zone.4.AllDevices.LowBattery	5	744106	Battery in the device is low (Collection group)
BinaryValue:744107	1234	Zone.4.AllDevices.UsageActive	5	744107	Device is currently in use (Collection group)
BinaryValue:744108	1234	Zone.4.AllDevices.ValveOpen	5	744108	Valve in the device is currently opened (Collection group)
PositiveIntegerValue:744140	1234	Zone.4.AllDevices.UsageCount	48	744140	Counts the usages of the device (Collection group)
PositiveIntegerValue:744141	1234	Zone.4.AllDevices.FlushCount	48	744141	Counts the flushes of the device (Collection group)
PositiveIntegerValue:744143	1234	Zone.4.AllDevices.AutomaticFlushCount	48	744143	Counts the automatic flushes of the device (Collection group)
PositiveIntegerValue:744144	1234	Zone.4.AllDevices.ManualFlushCount	48	744144	Counts the manual flushes of the device (Collection group)
PositiveIntegerValue:744145	1234	Zone.4.AllDevices.FullFlushCount	48	744145	Counts the full flushes of the device (Collection group)
PositiveIntegerValue:744146	1234	Zone.4.AllDevices.PartialFlushCount	48	744146	Counts the partial flushes of the device (Collection group)

PositiveIntegerValue:744147	1234	Zone.4.AllDevices.HygieneFlushCount	48	744147	Counts the flushes based on local hygiene programs of the device (Collection group)
PositiveIntegerValue:744170	1234	Zone.4.AllDevices.WaterUsage	48	744170	Indicates the water usage of the device (Collection group)
MultiStateValue:744207	1234	Zone.4.AllDevices.Cleaning	19	744207	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
StructuredView:756400	1234	Zone.4.AllToilets	29	756400	Collection group for all toilets
CharStringValue:756402	1234	Zone.4.AllToilets.ZoneName	40	756402	Name of the zone/room the device is assigned to
MultiStateValue:756501	1234	Zone.4.AllToilets.ConnectionStatus	19	756501	State of the connection between gateway and device (Collection group)
BinaryValue:756503	1234	Zone.4.AllToilets.GenericWarning	5	756503	The device has a warning (Collection group)
BinaryValue:756504	1234	Zone.4.AllToilets.GenericError	5	756504	The device has an error (Collection group)
BinaryValue:756506	1234	Zone.4.AllToilets.LowBattery	5	756506	Battery in the device is low (Collection group)
BinaryValue:756507	1234	Zone.4.AllToilets.UsageActive	5	756507	Device is currently in use (Collection group)
BinaryValue:756508	1234	Zone.4.AllToilets.ValveOpen	5	756508	Valve in the device is currently opened (Collection group)
PositiveIntegerValue:756540	1234	Zone.4.AllToilets.UsageCount	48	756540	Counts the usages of the device (Collection group)
PositiveIntegerValue:756541	1234	Zone.4.AllToilets.FlushCount	48	756541	Counts the flushes of the device (Collection group)
PositiveIntegerValue:756543	1234	Zone.4.AllToilets.AutomaticFlushCount	48	756543	Counts the automatic flushes of the device (Collection group)
PositiveIntegerValue:756544	1234	Zone.4.AllToilets.ManualFlushCount	48	756544	Counts the manual flushes of the device (Collection group)
PositiveIntegerValue:756545	1234	Zone.4.AllToilets.FullFlushCount	48	756545	Counts the full flushes of the device (Collection group)
PositiveIntegerValue:756546	1234	Zone.4.AllToilets.PartialFlushCount	48	756546	Counts the partial flushes of the device (Collection group)
PositiveIntegerValue:756547	1234	Zone.4.AllToilets.HygieneFlushCount	48	756547	Counts the flushes based on local hygiene programs of the device (Collection group)
PositiveIntegerValue:756570	1234	Zone.4.AllToilets.WaterUsage	48	756570	Indicates the water usage of the device (Collection group)
MultiStateValue:756607	1234	Zone.4.AllToilets.Cleaning	19	756607	Used to switch on and off the cleaning mode of the device (writable) (Collection group)
StructuredView:756800	1234	Zone.4.Toilet.1	29	756800	WFlush Automatic Mains
CharStringValue:756801	1234	Zone.4.Toilet.1.DeviceSerial	40	756801	Serial number of the device
CharStringValue:756802	1234	Zone.4.Toilet.1.ZoneName	40	756802	Name of the zone/room the device is assigned to
MultiStateValue:756901	1234	Zone.4.Toilet.1.ConnectionStatus	19	756901	State of the connection between gateway and device
BinaryValue:756903	1234	Zone.4.Toilet.1.GenericWarning	5	756903	The device has a warning
BinaryValue:756904	1234	Zone.4.Toilet.1.GenericError	5	756904	The device has an error
BinaryValue:756906	1234	Zone.4.Toilet.1.LowBattery	5	756906	Battery in the device is low
BinaryValue:756907	1234	Zone.4.Toilet.1.UsageActive	5	756907	Device is currently in use
BinaryValue:756908	1234	Zone.4.Toilet.1.ValveOpen	5	756908	Valve in the device is currently opened
PositiveIntegerValue:756940	1234	Zone.4.Toilet.1.UsageCount	48	756940	Counts the usages of the device
PositiveIntegerValue:756941	1234	Zone.4.Toilet.1.FlushCount	48	756941	Counts the flushes of the device
PositiveIntegerValue:756943	1234	Zone.4.Toilet.1.AutomaticFlushCount	48	756943	Counts the automatic flushes of the device
PositiveIntegerValue:756944	1234	Zone.4.Toilet.1.ManualFlushCount	48	756944	Counts the manual flushes of the device
PositiveIntegerValue:756945	1234	Zone.4.Toilet.1.FullFlushCount	48	756945	Counts the full flushes of the device
PositiveIntegerValue:756946	1234	Zone.4.Toilet.1.PartialFlushCount	48	756946	Counts the partial flushes of the device
PositiveIntegerValue:756947	1234	Zone.4.Toilet.1.HygieneFlushCount	48	756947	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:756970	1234	Zone.4.Toilet.1.WaterUsage	48	756970	Indicates the water usage of the device
MultiStateValue:757001	1234	Zone.4.Toilet.1.Locate	19	757001	Used to locate the device (writable)
PositiveIntegerValue:757003	1234	Zone.4.Toilet.1.DrainVolume	48	757003	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:757005	1234	Zone.4.Toilet.1.Flush	5	757005	Used to trigger a single flush at the device (writable)
MultiStateValue:757007	1234	Zone.4.Toilet.1.Cleaning	19	757007	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:757200	1234	Zone.4.Toilet.2	29	757200	WFlush Automatic Mains
CharStringValue:757201	1234	Zone.4.Toilet.2.DeviceSerial	40	757201	Serial number of the device
CharStringValue:757202	1234	Zone.4.Toilet.2.ZoneName	40	757202	Name of the zone/room the device is assigned to
MultiStateValue:757301	1234	Zone.4.Toilet.2.ConnectionStatus	19	757301	State of the connection between gateway and device
BinaryValue:757303	1234	Zone.4.Toilet.2.GenericWarning	5	757303	The device has a warning
BinaryValue:757304	1234	Zone.4.Toilet.2.GenericError	5	757304	The device has an error
BinaryValue:757306	1234	Zone.4.Toilet.2.LowBattery	5	757306	Battery in the device is low
BinaryValue:757307	1234	Zone.4.Toilet.2.UsageActive	5	757307	Device is currently in use
BinaryValue:757308	1234	Zone.4.Toilet.2.ValveOpen	5	757308	Valve in the device is currently opened
PositiveIntegerValue:757340	1234	Zone.4.Toilet.2.UsageCount	48	757340	Counts the usages of the device
PositiveIntegerValue:757341	1234	Zone.4.Toilet.2.FlushCount	48	757341	Counts the flushes of the device
PositiveIntegerValue:757343	1234	Zone.4.Toilet.2.AutomaticFlushCount	48	757343	Counts the automatic flushes of the device
PositiveIntegerValue:757344	1234	Zone.4.Toilet.2.ManualFlushCount	48	757344	Counts the manual flushes of the device
PositiveIntegerValue:757345	1234	Zone.4.Toilet.2.FullFlushCount	48	757345	Counts the full flushes of the device
PositiveIntegerValue:757346	1234	Zone.4.Toilet.2.PartialFlushCount	48	757346	Counts the partial flushes of the device
PositiveIntegerValue:757347	1234	Zone.4.Toilet.2.HygieneFlushCount	48	757347	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:757370	1234	Zone.4.Toilet.2.WaterUsage	48	757370	Indicates the water usage of the device
MultiStateValue:757401	1234	Zone.4.Toilet.2.Locate	19	757401	Used to locate the device (writable)
PositiveIntegerValue:757403	1234	Zone.4.Toilet.2.DrainVolume	48	757403	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:757405	1234	Zone.4.Toilet.2.Flush	5	757405	Used to trigger a single flush at the device (writable)
MultiStateValue:757407	1234	Zone.4.Toilet.2.Cleaning	19	757407	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:757600	1234	Zone.4.Toilet.3	29	757600	WFlush Automatic Mains
CharStringValue:757601	1234	Zone.4.Toilet.3.DeviceSerial	40	757601	Serial number of the device
CharStringValue:757602	1234	Zone.4.Toilet.3.ZoneName	40	757602	Name of the zone/room the device is assigned to
MultiStateValue:757701	1234	Zone.4.Toilet.3.ConnectionStatus	19	757701	State of the connection between gateway and device
BinaryValue:757703	1234	Zone.4.Toilet.3.GenericWarning	5	757703	The device has a warning
BinaryValue:757704	1234	Zone.4.Toilet.3.GenericError	5	757704	The device has an error
BinaryValue:757706	1234	Zone.4.Toilet.3.LowBattery	5	757706	Battery in the device is low
BinaryValue:757707	1234	Zone.4.Toilet.3.UsageActive	5	757707	Device is currently in use
BinaryValue:757708	1234	Zone.4.Toilet.3.ValveOpen	5	757708	Valve in the device is currently opened
PositiveIntegerValue:757740	1234	Zone.4.Toilet.3.UsageCount	48	757740	Counts the usages of the device
PositiveIntegerValue:757741	1234	Zone.4.Toilet.3.FlushCount	48	757741	Counts the flushes of the device
PositiveIntegerValue:757743	1234	Zone.4.Toilet.3.AutomaticFlushCount	48	757743	Counts the automatic flushes of the device
PositiveIntegerValue:757744	1234	Zone.4.Toilet.3.ManualFlushCount	48	757744	Counts the manual flushes of the device
PositiveIntegerValue:757745	1234	Zone.4.Toilet.3.FullFlushCount	48	757745	Counts the full flushes of the device
PositiveIntegerValue:757746	1234	Zone.4.Toilet.3.PartialFlushCount	48	757746	Counts the partial flushes of the device
PositiveIntegerValue:757747	1234	Zone.4.Toilet.3.HygieneFlushCount	48	757747	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:757770	1234	Zone.4.Toilet.3.WaterUsage	48	757770	Indicates the water usage of the device
MultiStateValue:757801	1234	Zone.4.Toilet.3.Locate	19	757801	Used to locate the device (writable)
PositiveIntegerValue:757803	1234	Zone.4.Toilet.3.DrainVolume	48	757803	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:757805	1234	Zone.4.Toilet.3.Flush	5	757805	Used to trigger a single flush at the device (writable)
MultiStateValue:757807	1234	Zone.4.Toilet.3.Cleaning	19	757807	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:758000	1234	Zone.4.Toilet.4	29	758000	WFlush Automatic Mains
CharStringValue:758001	1234	Zone.4.Toilet.4.DeviceSerial	40	758001	Serial number of the device
CharStringValue:758002	1234	Zone.4.Toilet.4.ZoneName	40	758002	Name of the zone/room the device is assigned to
MultiStateValue:758101	1234	Zone.4.Toilet.4.ConnectionStatus	19	758101	State of the connection between gateway and device
BinaryValue:758103	1234	Zone.4.Toilet.4.GenericWarning	5	758103	The device has a warning
BinaryValue:758104	1234	Zone.4.Toilet.4.GenericError	5	758104	The device has an error
BinaryValue:758106	1234	Zone.4.Toilet.4.LowBattery	5	758106	Battery in the device is low
BinaryValue:758107	1234	Zone.4.Toilet.4.UsageActive	5	758107	Device is currently in use
BinaryValue:758108	1234	Zone.4.Toilet.4.ValveOpen	5	758108	Valve in the device is currently opened
PositiveIntegerValue:758140	1234	Zone.4.Toilet.4.UsageCount	48	758140	Counts the usages of the device
PositiveIntegerValue:758141	1234	Zone.4.Toilet.4.FlushCount	48	758141	Counts the flushes of the device
PositiveIntegerValue:758143	1234	Zone.4.Toilet.4.AutomaticFlushCount	48	758143	Counts the automatic flushes of the device
PositiveIntegerValue:758144	1234	Zone.4.Toilet.4.ManualFlushCount	48	758144	Counts the manual flushes of the device
PositiveIntegerValue:758145	1234	Zone.4.Toilet.4.FullFlushCount	48	758145	Counts the full flushes of the device
PositiveIntegerValue:758146	1234	Zone.4.Toilet.4.PartialFlushCount	48	758146	Counts the partial flushes of the device
PositiveIntegerValue:758147	1234	Zone.4.Toilet.4.HygieneFlushCount	48	758147	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:758170	1234	Zone.4.Toilet.4.WaterUsage	48	758170	Indicates the water usage of the device
MultiStateValue:758201	1234	Zone.4.Toilet.4.Locate	19	758201	Used to locate the device (writable)
PositiveIntegerValue:758203	1234	Zone.4.Toilet.4.DrainVolume	48	758203	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:758205	1234	Zone.4.Toilet.4.Flush	5	758205	Used to trigger a single flush at the device (writable)
MultiStateValue:758207	1234	Zone.4.Toilet.4.Cleaning	19	758207	Used to switch on and off the cleaning mode of the device (writable)

StructuredView:758400	1234	Zone.4.Toilet.5	29	758400	WcFlush Automatic Mains
CharStringValue:758401	1234	Zone.4.Toilet.5.DeviceSerial	40	758401	Serial number of the device
CharStringValue:758402	1234	Zone.4.Toilet.5.ZoneName	40	758402	Name of the zone/room the device is assigned to
MultiStateValue:758501	1234	Zone.4.Toilet.5.ConnectionStatus	19	758501	State of the connection between gateway and device
BinaryValue:758503	1234	Zone.4.Toilet.5.GenericWarning	5	758503	The device has a warning
BinaryValue:758504	1234	Zone.4.Toilet.5.GenericError	5	758504	The device has an error
BinaryValue:758506	1234	Zone.4.Toilet.5.LowBattery	5	758506	Battery in the device is low
BinaryValue:758507	1234	Zone.4.Toilet.5.UsageActive	5	758507	Device is currently in use
BinaryValue:758508	1234	Zone.4.Toilet.5.ValveOpen	5	758508	Valve in the device is currently opened
PositiveIntegerValue:758540	1234	Zone.4.Toilet.5.UsageCount	48	758540	Counts the usages of the device
PositiveIntegerValue:758541	1234	Zone.4.Toilet.5.FlushCount	48	758541	Counts the flushes of the device
PositiveIntegerValue:758543	1234	Zone.4.Toilet.5.AutomaticFlushCount	48	758543	Counts the automatic flushes of the device
PositiveIntegerValue:758544	1234	Zone.4.Toilet.5.ManualFlushCount	48	758544	Counts the manual flushes of the device
PositiveIntegerValue:758545	1234	Zone.4.Toilet.5.FullFlushCount	48	758545	Counts the full flushes of the device
PositiveIntegerValue:758546	1234	Zone.4.Toilet.5.PartialFlushCount	48	758546	Counts the partial flushes of the device
PositiveIntegerValue:758547	1234	Zone.4.Toilet.5.HygieneFlushCount	48	758547	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:758570	1234	Zone.4.Toilet.5.WaterUsage	48	758570	Indicates the water usage of the device
MultiStateValue:758601	1234	Zone.4.Toilet.5.Locate	19	758601	Used to locate the device (writable)
PositiveIntegerValue:758603	1234	Zone.4.Toilet.5.DrainVolume	48	758603	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:758605	1234	Zone.4.Toilet.5.Flush	5	758605	Used to trigger a single flush at the device (writable)
MultiStateValue:758607	1234	Zone.4.Toilet.5.Cleaning	19	758607	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:758800	1234	Zone.4.Toilet.6	29	758800	WcFlush Automatic Mains
CharStringValue:758801	1234	Zone.4.Toilet.6.DeviceSerial	40	758801	Serial number of the device
CharStringValue:758802	1234	Zone.4.Toilet.6.ZoneName	40	758802	Name of the zone/room the device is assigned to
MultiStateValue:758901	1234	Zone.4.Toilet.6.ConnectionStatus	19	758901	State of the connection between gateway and device
BinaryValue:758903	1234	Zone.4.Toilet.6.GenericWarning	5	758903	The device has a warning
BinaryValue:758904	1234	Zone.4.Toilet.6.GenericError	5	758904	The device has an error
BinaryValue:758906	1234	Zone.4.Toilet.6.LowBattery	5	758906	Battery in the device is low
BinaryValue:758907	1234	Zone.4.Toilet.6.UsageActive	5	758907	Device is currently in use
BinaryValue:758908	1234	Zone.4.Toilet.6.ValveOpen	5	758908	Valve in the device is currently opened
PositiveIntegerValue:758940	1234	Zone.4.Toilet.6.UsageCount	48	758940	Counts the usages of the device
PositiveIntegerValue:758941	1234	Zone.4.Toilet.6.FlushCount	48	758941	Counts the flushes of the device
PositiveIntegerValue:758943	1234	Zone.4.Toilet.6.AutomaticFlushCount	48	758943	Counts the automatic flushes of the device
PositiveIntegerValue:758944	1234	Zone.4.Toilet.6.ManualFlushCount	48	758944	Counts the manual flushes of the device
PositiveIntegerValue:758945	1234	Zone.4.Toilet.6.FullFlushCount	48	758945	Counts the full flushes of the device
PositiveIntegerValue:758946	1234	Zone.4.Toilet.6.PartialFlushCount	48	758946	Counts the partial flushes of the device
PositiveIntegerValue:758947	1234	Zone.4.Toilet.6.HygieneFlushCount	48	758947	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:758970	1234	Zone.4.Toilet.6.WaterUsage	48	758970	Indicates the water usage of the device
MultiStateValue:759001	1234	Zone.4.Toilet.6.Locate	19	759001	Used to locate the device (writable)
PositiveIntegerValue:759003	1234	Zone.4.Toilet.6.DrainVolume	48	759003	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:759005	1234	Zone.4.Toilet.6.Flush	5	759005	Used to trigger a single flush at the device (writable)
MultiStateValue:759007	1234	Zone.4.Toilet.6.Cleaning	19	759007	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:759200	1234	Zone.4.Toilet.7	29	759200	WcFlush Automatic Mains
CharStringValue:759201	1234	Zone.4.Toilet.7.DeviceSerial	40	759201	Serial number of the device
CharStringValue:759202	1234	Zone.4.Toilet.7.ZoneName	40	759202	Name of the zone/room the device is assigned to
MultiStateValue:759301	1234	Zone.4.Toilet.7.ConnectionStatus	19	759301	State of the connection between gateway and device
BinaryValue:759303	1234	Zone.4.Toilet.7.GenericWarning	5	759303	The device has a warning
BinaryValue:759304	1234	Zone.4.Toilet.7.GenericError	5	759304	The device has an error
BinaryValue:759306	1234	Zone.4.Toilet.7.LowBattery	5	759306	Battery in the device is low
BinaryValue:759307	1234	Zone.4.Toilet.7.UsageActive	5	759307	Device is currently in use
BinaryValue:759308	1234	Zone.4.Toilet.7.ValveOpen	5	759308	Valve in the device is currently opened
PositiveIntegerValue:759340	1234	Zone.4.Toilet.7.UsageCount	48	759340	Counts the usages of the device
PositiveIntegerValue:759341	1234	Zone.4.Toilet.7.FlushCount	48	759341	Counts the flushes of the device
PositiveIntegerValue:759343	1234	Zone.4.Toilet.7.AutomaticFlushCount	48	759343	Counts the automatic flushes of the device
PositiveIntegerValue:759344	1234	Zone.4.Toilet.7.ManualFlushCount	48	759344	Counts the manual flushes of the device
PositiveIntegerValue:759345	1234	Zone.4.Toilet.7.FullFlushCount	48	759345	Counts the full flushes of the device
PositiveIntegerValue:759346	1234	Zone.4.Toilet.7.PartialFlushCount	48	759346	Counts the partial flushes of the device
PositiveIntegerValue:759347	1234	Zone.4.Toilet.7.HygieneFlushCount	48	759347	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:759370	1234	Zone.4.Toilet.7.WaterUsage	48	759370	Indicates the water usage of the device
MultiStateValue:759401	1234	Zone.4.Toilet.7.Locate	19	759401	Used to locate the device (writable)
PositiveIntegerValue:759403	1234	Zone.4.Toilet.7.DrainVolume	48	759403	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:759405	1234	Zone.4.Toilet.7.Flush	5	759405	Used to trigger a single flush at the device (writable)
MultiStateValue:759407	1234	Zone.4.Toilet.7.Cleaning	19	759407	Used to switch on and off the cleaning mode of the device (writable)
StructuredView:759600	1234	Zone.4.Toilet.8	29	759600	WcFlush Automatic Mains
CharStringValue:759601	1234	Zone.4.Toilet.8.DeviceSerial	40	759601	Serial number of the device
CharStringValue:759602	1234	Zone.4.Toilet.8.ZoneName	40	759602	Name of the zone/room the device is assigned to
MultiStateValue:759701	1234	Zone.4.Toilet.8.ConnectionStatus	19	759701	State of the connection between gateway and device
BinaryValue:759703	1234	Zone.4.Toilet.8.GenericWarning	5	759703	The device has a warning
BinaryValue:759704	1234	Zone.4.Toilet.8.GenericError	5	759704	The device has an error
BinaryValue:759706	1234	Zone.4.Toilet.8.LowBattery	5	759706	Battery in the device is low
BinaryValue:759707	1234	Zone.4.Toilet.8.UsageActive	5	759707	Device is currently in use
BinaryValue:759708	1234	Zone.4.Toilet.8.ValveOpen	5	759708	Valve in the device is currently opened
PositiveIntegerValue:759740	1234	Zone.4.Toilet.8.UsageCount	48	759740	Counts the usages of the device
PositiveIntegerValue:759741	1234	Zone.4.Toilet.8.FlushCount	48	759741	Counts the flushes of the device
PositiveIntegerValue:759743	1234	Zone.4.Toilet.8.AutomaticFlushCount	48	759743	Counts the automatic flushes of the device
PositiveIntegerValue:759744	1234	Zone.4.Toilet.8.ManualFlushCount	48	759744	Counts the manual flushes of the device
PositiveIntegerValue:759745	1234	Zone.4.Toilet.8.FullFlushCount	48	759745	Counts the full flushes of the device
PositiveIntegerValue:759746	1234	Zone.4.Toilet.8.PartialFlushCount	48	759746	Counts the partial flushes of the device
PositiveIntegerValue:759747	1234	Zone.4.Toilet.8.HygieneFlushCount	48	759747	Counts the flushes based on local hygiene programs of the device
PositiveIntegerValue:759770	1234	Zone.4.Toilet.8.WaterUsage	48	759770	Indicates the water usage of the device
MultiStateValue:759801	1234	Zone.4.Toilet.8.Locate	19	759801	Used to locate the device (writable)
PositiveIntegerValue:759803	1234	Zone.4.Toilet.8.DrainVolume	48	759803	Used to open the valve of the device for a requested amount of water (writable)
BinaryValue:759805	1234	Zone.4.Toilet.8.Flush	5	759805	Used to trigger a single flush at the device (writable)
MultiStateValue:759807	1234	Zone.4.Toilet.8.Cleaning	19	759807	Used to switch on and off the cleaning mode of the device (writable)

Geberit International AG
Schachenstrasse 77, CH-8645 Jona
documentation@geberit.com
www.geberit.com

